
Northern Cities Management Area 2017 Annual Monitoring Report

Prepared for

The Northern Cities Management Area Technical Group

City of Arroyo Grande
City of Grover Beach
Oceano Community Services District
City of Pismo Beach

April 22, 2018

Prepared by




5855 Capistrano Avenue, Suite C
Atascadero, CA 93422
P: 805.460.4621
info@gsiws.com www.gsiws.com

This page left blank intentionally.

Northern Cities Management Area 2017 Annual Monitoring Report

This report was prepared by the staff of GSI Water Solutions, Inc., in collaboration with GEI Consultants, Inc., under the supervision of professionals whose signatures appear below. The findings or professional opinion were prepared in accordance with generally accepted professional engineering and geologic practice.

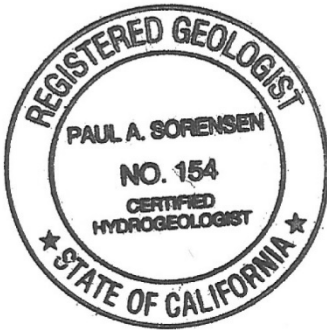

Paul A. Sorensen, PG, CHg
Principal Hydrogeologist
Project Manager



Timothy A. Nicely, PG, CHg
Supervising Hydrogeologist

GEI CONSULTANTS, INC.

Samuel W. Schaefer, PE
Senior Engineer



This page left blank intentionally.

CONTENTS

| | Page |
|---|------|
| Executive Summary | 1 |
| Groundwater Conditions | 1 |
| Groundwater Levels | 1 |
| Change in Groundwater in Storage | 3 |
| Groundwater Quality | 3 |
| Water Supply and Production/Deliveries..... | 3 |
| Threats to Water Supply | 4 |
| 1. Introduction | 1 |
| 1.1 Description of the NCMA Technical Group..... | 3 |
| 1.2 Coordination with Management Areas | 3 |
| 2. Area Description..... | 5 |
| 2.1 Setting | 5 |
| 2.2 Precipitation..... | 5 |
| 2.3 Evapotranspiration | 6 |
| 3. Groundwater Conditions | 7 |
| 3.1 Geology and Hydrogeology..... | 7 |
| 3.2 Groundwater Flow | 7 |
| 3.3 Groundwater Monitoring Network..... | 8 |
| 3.4 Groundwater Levels | 10 |
| 3.4.1 Groundwater Level Contour Maps..... | 10 |
| 3.4.2 Historical Water Level Trends..... | 11 |
| 3.4.3 Sentry Wells..... | 11 |
| 3.5 Change in Groundwater in Storage | 13 |
| 3.6 Water Quality..... | 13 |
| 3.6.1 Quarterly Groundwater Monitoring | 13 |
| 3.6.2 Analytical Results Summary | 14 |
| 4. Water Supply and Production/Delivery | 17 |
| 4.1 Water Supply..... | 17 |
| 4.1.1 Lopez Lake | 17 |
| 4.1.2 State Water Project..... | 20 |
| 4.1.3 Groundwater | 21 |
| 4.1.4 Developed Water | 22 |
| 4.1.5 Total Water Supply Availability | 23 |
| 4.2 Water Use | 24 |
| 4.2.1 Agricultural Water Supply Requirements..... | 24 |
| 4.2.2 Rural Use..... | 29 |
| 4.2.3 Urban Production..... | 30 |

| | | |
|-------|---|----|
| 4.2.4 | 2017 Groundwater Pumpage..... | 31 |
| 4.2.5 | Changes in Water Production..... | 32 |
| 5. | Comparison of Water Supply v. Water Production..... | 35 |
| 6. | Threats to Water Supply | 37 |
| 6.1 | Threats to Local Groundwater Supply..... | 37 |
| 6.1.1 | Declining Water Levels..... | 37 |
| 6.1.2 | Seawater Intrusion..... | 38 |
| 6.1.3 | Measures to Avoid Seawater Intrusion..... | 39 |
| 6.2 | Threats to State Water Project Supply..... | 39 |
| 6.3 | Threats to Lopez Lake Water Supply..... | 40 |
| 7. | Management Activities..... | 41 |
| 7.1 | Management Objectives..... | 41 |
| 7.1.1 | Share Groundwater Resources and Manage Pumping..... | 44 |
| 7.1.2 | Enhance Management of NCMA Groundwater..... | 46 |
| 7.1.3 | Monitor Supply and Demand and Share Information..... | 47 |
| 7.1.4 | Manage Groundwater Levels and Prevent Seawater Intrusion..... | 48 |
| 7.1.5 | Protect Groundwater Quality..... | 50 |
| 7.1.6 | Manage Cooperatively..... | 51 |
| 7.1.7 | Encourage Water Conservation..... | 52 |
| 7.1.8 | Evaluate Alternative Sources of Supply..... | 57 |
| 8. | References..... | 61 |

Tables

| | Page |
|---|------|
| Table 1. NCMA TG Representatives | 3 |
| Table 2. Lopez Lake (FCWCD Zone 3 Contractors) 2017 Water Allocation (AFY) | 17 |
| Table 3. Lopez Lake Municipal Diversion Reduction Strategy Low Reservoir Response Plan .. | 18 |
| Table 4. Lopez Lake Downstream Release Reduction Strategy Low Reservoir Response Plan | 18 |
| Table 5. 2017 Lopez Lake Deliveries..... | 19 |
| Table 6. 2017 NCMA SWP Deliveries | 20 |
| Table 7. NCMA Groundwater Pumpage from Santa Maria Groundwater Basin, 2017..... | 22 |
| Table 8. Baseline (Full Allotment) Available Urban Water Supplies (AFY)..... | 23 |
| Table 9. 2017 Available Urban Water Supply, (AF)..... | 24 |
| Table 10. 2017 NCMA Crop Acreages and Calculated Evapotranspiration | 26 |
| Table 11. 2017 IDC Model Results of Monthly Applied Water..... | 29 |
| Table 12. Estimated Rural Water Production..... | 30 |
| Table 13. Urban Water Production (Groundwater and Surface Water, AF)..... | 31 |
| Table 14. NCMA Groundwater Pumpage from Santa Maria Groundwater Basin, 2017 (AF)..... | 32 |
| Table 15. Total Water Use (Groundwater and Surface Water, AF) | 33 |
| Table 16. 2017 Water Production by Source (AF)..... | 35 |

Figures *(all figures are presented at the end of the report)*

- Figure 1. Santa Maria Groundwater Basin
- Figure 2. Northern Cities Management Area
- Figure 3. Annual Precipitation 1950 to 2017
- Figure 4. Location of Precipitation Stations
- Figure 5. Monthly 2017 and Average Precipitation and Evapotranspiration
- Figure 6. Locations of Monitoring Wells
- Figure 7. Depths of Monitoring Wells
- Figure 8. Groundwater Level Contours Spring 2017
- Figure 9. Groundwater Level Contours Fall 2017
- Figure 10. Selected Hydrographs
- Figure 11. Sentry Well Hydrographs
- Figure 12. Hydrograph of Deep Well Index Level
- Figure 13. Water Elevation, Conductivity, and Temperature, Well 24B03
- Figure 14. Water Elevation, Conductivity, and Temperature, Well 30F03
- Figure 15. Water Elevation, Conductivity, and Temperature, Well 30N02
- Figure 16. Water Elevation, Conductivity, and Temperature, Well 36L01
- Figure 17. Water Elevation, Conductivity, and Temperature, Well 36L02
- Figure 18. Water Elevation, Conductivity, and Temperature, Well 32C03
- Figure 19. Change in Groundwater Levels, April 2016 to April 2017
- Figure 20. Chloride Concentrations in Monitoring Wells
- Figure 21. Total Dissolved Solids Concentrations in Monitoring Wells
- Figure 22. Piper Diagram of Water Quality in Select Monitoring Wells
- Figure 23. NCMA Agricultural Land 2017
- Figure 24. 2017 NCMA Estimated Agricultural Water Demand and Monthly Precipitation at the CIMIS Nipomo Station
- Figure 25. Municipal Water Use by Source
- Figure 26. Total Water Use (Urban, Rural, Ag) by Source
- Figure 27. Historical TDS, Chloride and Sodium, Index Wells and 30N03
- Figure 28. Historical TDS, Chloride and Sodium, Wells 30N02, MW-Blue and 36L01

Appendices

- Appendix A NCMA Sentry Well Water Level and Water Quality Data

This page left blank intentionally.

Executive Summary

The 2017 Annual Monitoring Report for the Northern Cities Management Area (NCMA; Annual Report) is prepared pursuant to the requirements of the Stipulation and Judgment After Trial (Judgment) for the Santa Maria Groundwater Basin Adjudication. The Annual Report provides an assessment of hydrologic conditions for the NCMA based on data collected during the calendar year of record. As specified in the Judgment, the NCMA agencies, consisting of the City of Arroyo Grande, City of Grover Beach, City of Pismo Beach, and Oceano Community Services District (OCSD), regularly monitor groundwater in the NCMA and analyze other data pertinent to water supply and demand, including:

- Land and water uses in the basin
- Sources of supply to meet water demand
- Groundwater conditions (including water levels and water quality)
- Amount and disposition of NCMA water supplies that are not groundwater

Results of the data compilation and analysis for calendar year 2017 are documented and discussed in this Annual Report.

Groundwater Conditions

During 2017, water elevations throughout the area exhibited an overall increase in response to a relatively wet rainfall year and a continuation of ongoing efforts by all NCMA agencies to minimize groundwater extraction and maximize surface water supply sources while maintaining strict water conservation requirements.

Groundwater Levels

The best indicator of whether the NCMA portion of the basin can prevent seawater intrusion is the water elevation in the NCMA “sentry wells” near the coastline. The average water elevations of three of the key sentry wells make up the “Deep Well Index.” That index was developed by the NCMA in 2007 to gauge the health of the basin. A Deep Well Index value above 7.5 feet generally indicates that sufficient freshwater flow occurs from the east to the coastline to prevent seawater intrusion. History has shown that a prolonged period with the Deep Well Index level below 7.5 feet develops groundwater conditions at risk of seawater intrusion.

- *Spring 2017.* In the mostly urbanized areas north of Arroyo Grande Creek, groundwater contours in the spring of 2017 generally showed a westerly to southwesterly groundwater flow. These positive groundwater gradients have been developed and maintained primarily because the NCMA agencies have collaborated on water management and conservation efforts. Those efforts have been in response to changes in the Deep Well Index to ensure that flow to the ocean continues to prevent seawater intrusion. Because of a limited number of wells and water level data in the southernmost portion of the area dominated by sensitive-species dunes and State Parks land, the groundwater gradient and flow are

generally inferred on the basis of historical records and trends, and water level data from the NMMA farther east.

In the central portion of the NCMA, the Cienega Valley south of Arroyo Grande Creek, agricultural groundwater production resulted in a broad pumping trough. The water elevations in the Cienega Valley are in the range of 7 to 15 feet NAVD88. The Spring 2017 water elevations in the Cienega Valley are significantly improved compared to Spring 2016, when water elevations were in the range of -2.5 (negative 2.5) to -14.5 (negative 14.5) feet NAVD88, that is, below sea level. These data show an increase in water elevations of 8.5 to almost 30 feet from Spring 2016 to Spring 2017, in apparent response to the heavy rainfall in the winter of 2016-17 as well as from continued management of the resource by NCMA agencies. For the past several years, the pumping trough exhibited in the Cienega Valley usually manifested itself as a closed depression, with groundwater elevations generally below “sea level” (NAVD88) in the center of the depression, but the rise in water elevations this past year mitigated the formation of the depression in the Spring. Also in recent years, a second pumping depression often appeared north of Arroyo Grande Creek in the area of concentrated municipal pumping. That historical pumping depression did not form in 2017 due to municipal conservation, increased municipal use of surface water supplies, and increased precipitation. Water levels in the main production zone along the coast ranged from 7.3 to almost 11 feet NAVD88.

- *Fall 2017.* Groundwater conditions in the Fall of 2017 returned to the persistent pumping depression in the Cienega Valley, with groundwater elevations as deep as -13 (negative thirteen) feet NAVD88. The groundwater elevation in the pumping depression in October 2017 was more than 7 feet higher than was present in October 2016. Although groundwater elevations showed a normal (for this time of year) decline of 4 to 8 feet from April 2017 to October 2017, the Fall 2017 groundwater elevations were generally 2 to 5 feet higher than the October 2016. Groundwater elevations in the main production zone along the coast ranged from 5.5 to 8.5 feet NAVD88.
- *Deep Wells.* For a very brief period between August 18 and August 29, 2017, when the agencies were forced to increase groundwater pumping to maintain service to municipal customers during a shutdown of the Lopez Lake water supply, the Deep Well Index dropped below the 7.5-foot threshold. Otherwise, the index remained above the 7.5-foot threshold value throughout 2017. The Deep Well Index reached its high point of the year in March, with an index value of almost 12 feet NAVD88. Except for the previously mentioned period from August 18 to 29, the lowest index value was reached in October, when the index value was slightly above 7.5 feet NAVD88. The index value finished 2017 at about 9 feet NAVD88.
- *NCMA/NMMA Boundary.* The water elevation in the San Luis Obispo County monitoring well installed to monitor basin conditions along the NCMA/NMMA boundary typically exhibits regular seasonal fluctuations. Despite the fluctuations, the water elevation in the well remained above sea level throughout all of 2017, in contrast with the previous 4 years when the water level typically dropped below sea level in August and remained at a low elevation until early October.

Change in Groundwater in Storage

The change in groundwater in storage in the NCMA portion of the basin between April 2016 and April 2017 was estimated on the basis of a comparison of water level contour maps created for these periods. Comparison of the April water levels was chosen to comply with the California Department of Water Resources reporting requirements under the Sustainable Groundwater Management Act (SGMA).

During the period of April 2016 to April 2017, the NCMA portion of the basin experienced a net gain in groundwater in storage. An increase in groundwater in storage is a reflection of higher water levels across the basin. The net rise in groundwater levels represented a net increase of groundwater in storage from April 2016 to April 2017 of approximately 1,500 acre feet (AF), that is, there was approximately 1,500 AF more groundwater stored in the aquifer in April 2017 than in April 2016, due to continued emphasis by the municipal agencies on conservation efforts, increased municipal use of surface water supplies, and increased precipitation (recharge).

Groundwater Quality

Analytical results of key water quality data (chloride, TDS, and sodium) in 2017 were generally consistent with historical concentrations and observed ranges of constituent concentrations. In general, no water quality results were observed that are a cause of concern.

None of the water quality results from monitoring wells throughout 2017 indicate an incipient episode or immediate threat of seawater intrusion. Since the decline of TDS, sodium, and chloride concentrations following the 2009-2010 seasons, it is also clear that the location and inland extent of the seawater-fresh water interface is not known, except for the apparent indication that it was detected in 2009 in well 30N02, 30N03, and MW-Blue, all of which are screened in the Paso Robles Formation. No indications of seawater intrusion have been observed in wells screened in the underlying Careaga sandstone.

Water Supply and Production/Deliveries

- Total water use in the NCMA in 2017, including urban use by the NCMA agencies as well as agricultural irrigation and private pumping by rural water users, was 8,519 acre feet (AF), which, except for the 2016 water use, is the lowest estimated total water use in the past 30 years or more. Of this amount, Lopez Lake deliveries were 4,553 AF, State Water Project deliveries totaled 451 AF, and groundwater pumping from the NCMA portion of the Santa Maria Groundwater Basin (SMGB) accounted for approximately 3,456 AF (which is the lowest production volume from the SMGB in more than 20 years). Groundwater pumping from the Pismo Formation, outside the SMGB, accounted for 59 AF. The breakdown is shown in the following table (following page).
- Urban water use in 2017 among the NCMA agencies was 5,860 AF. That is the second lowest urban water use in the past 20 years (second only to 2016, at 5,477 AF). Urban water use has ranged from 5,477 AF (2016) to 8,982 AF (2007). Water use since 2007 has steadily declined, with only slight increases in the trend in 2012 and 2013, and then again in 2016. The decline in pumpage since 2013 was in direct response to a statewide

order by the governor to reduce the amount of water used in urban areas by 25%, which was achieved locally by conservation activities implemented by the NCMA agencies.

- Agricultural acreage has remained fairly constant. Thus, the annual applied water requirement for agricultural irrigation has been relatively stable though it varies with weather conditions. Acknowledging the variability resulting from weather conditions, agricultural applied water is not expected to change significantly given the relative stability of applied irrigation acreage and cropping patterns in the NCMA. Changes in rural domestic pumping have not been significant.

| Urban Area | Lopez Lake (AF) | State Water Project (AF) | SMGB Groundwater (AF) | Other Supplies (AF) | Total (AF) |
|--|-----------------|--------------------------|-----------------------|---------------------|--------------|
| Arroyo Grande | 2,060 | 0 | 75 | 59 | 2,194 |
| Grover Beach | 752 | 0 | 496 | 0 | 1,248 |
| Pismo Beach | 1,044 | 451 | 205 | 0 | 1,700 |
| Oceano CSD | 697 | 0 | 21 | 0 | 718 |
| Urban Water Use Total | 4,553 | 451 | 797 | 59 | 5,860 |
| Agricultural Water Supply Requirement | 0 | 0 | 2,536 | 0 | 2,536 |
| Rural Water Users | 0 | 0 | 80 | 0 | 80 |
| Nonpotable Irrigation by Arroyo Grande | 0 | 0 | 43 | 0 | 43 |
| Total | 4,553 | 451 | 3,456 | 59 | 8,519 |

Threats to Water Supply

- Total groundwater pumping from the SMGB in the NCMA (urban, agriculture, and rural domestic) was 3,456 AF in 2017, which is 36 percent of the calculated 9,500 acre feet per year (AFY) long-term basin yield of the NCMA portion of the SMGB.
- When pumping is less than the yield of an aquifer, groundwater in storage increases as shown by rising water levels. With several consecutive years of groundwater pumping at 30 to 40 percent of the safe yield, groundwater elevations throughout the NCMA portion of the basin should rise significantly. Although groundwater levels increased some during 2017 as a result of the relatively wet rainfall year, the data show that the basin is in a tenuous position. Water elevations at just a few feet above sea level, coupled with the formation of a pumping depression in the Cienega Valley just west of the NCMA/NMMA boundary, indicates that the basin has very little ability to withstand droughts, any increase in regional pumping, or any other changes that reduces recharge, either directly or through subsurface inflow from the east (Nipomo Mesa).
- During 2017, there were no indications of seawater intrusion.

1. Introduction

The 2017 Annual Monitoring Report (Annual Report) summarizes hydrologic conditions for calendar year 2017 in the Northern Cities Management Area (NCMA) of the Santa Maria River Valley Groundwater Basin (SMGB) in San Luis Obispo County (County), California. This report was prepared on behalf of four public agencies collectively referred to as the Northern Cities, which includes the City of Arroyo Grande (Arroyo Grande), City of Grover Beach (Grover Beach), City of Pismo Beach (Pismo Beach) and the Oceano Community Services District (OCSD; Oceano CSD) (NCMA agencies). These agencies, along with local landowners, the County, and the San Luis Obispo County Flood Control & Water Conservation District (FCWCD) have managed local surface water and groundwater resources in the area since the late 1970s to preserve the long-term integrity of water supplies.

The rights to pump groundwater from the SMGB has been in litigation (adjudication) since the late 1990s. The physical solution set forth in the 2005 Stipulation and the 2008 final order established requirements and goals for the management of the entire Santa Maria Basin. The Court established three separate management areas, including the NCMA, the Nipomo Mesa Management Area (NMMA), and the Santa Maria Valley Management Area (SMVMA). The Court mandated that each management area form a technical group to monitor the groundwater conditions of its area, to continuously assess the hydrologic conditions of each area, and to prepare an Annual Report each year to provide the Court with a summary of the previous year's conditions, actions, and threats.

The requirements of the annual report, as directed by the Court in the Stipulation (June 30, 2005 Version, paragraph IV.D.3), stated that:

Within one hundred and twenty days after each Year end, the Management Area Engineers will file an Annual Report with the Court. The Annual Report will summarize the results of the Monitoring Program, changes in groundwater supplies, and any threats to Groundwater supplies. The Annual Report shall also include a tabulation of Management Area water use, including Imported Water availability and use, Return Flow entitlement and use, other Developed Water availability and use, and Groundwater use. Any Stipulating Party may object to the Monitoring Program, the reported results, or the Annual Report by motion.

This 2017 Annual Report, satisfies the requirements of the Court. The Annual Report for each calendar year (January 1 to December 31) is submitted to the Court by April 30 of the following calendar year, pursuant to the Stipulation. As a result of legislation passed by the State of California related to the Sustainable Groundwater Management Act (SGMA) that requires submittal of annual reporting and attendant supporting information for each adjudicated groundwater basin by April 1 of each year, the NCMA Annual Report is also published to the California Department of Water Resources (DWR) adjudicated basin reporting website.

The collaborative water supply management approach of the NCMA agencies was recognized by the Court in the 2001 Groundwater Management Agreement (which was based on the 1983 "Gentlemen's Agreement"), formalized in the 2002 Settlement Agreement between the NCMA

agencies, Northern Landowners, and Other Parties (2002 Settlement Agreement), and incorporated in the 2005 Stipulation for the Santa Maria Groundwater Basin Adjudication (Stipulation). On June 30, 2005, the Stipulation was agreed upon by numerous parties, including the NCMA agencies. The Stipulation included the 2002 Settlement Agreement. The approach then was adopted by the Superior Court of California, County of Santa Clara, in its Judgment After Trial, entered January 25, 2008 (Judgment). Although appeals to that decision were filed, a subsequent decision by the Sixth Appellate District (filed November 21, 2012) upheld the Judgment. On February 13, 2013, the Supreme Court of California denied a petition to review the decision.

Pursuant to the Court's continuing jurisdiction, Arroyo Grande, Pismo Beach, and Grover Beach filed a motion on September 29, 2015, requesting that the Court impose moratoriums on certain water extraction and use by stipulating parties within the NMMA. Judge Kirwan denied the motion without prejudice. He did, however, order the parties to meet and confer to address the issues raised in the motion by the NCMA agencies. The meet and confer process continued throughout 2016 and 2017. The order by the Court precipitated a series of meetings and collaborative actions between the NCMA and NMMA management areas.

The Judgment orders the stipulating parties to comply with all terms of the Stipulation. As specified in the Judgment and as outlined in the *Monitoring Program for the Northern Cities Management Area* (Todd Groundwater, Inc. [Todd], 2008; *NCMA Monitoring Program*), the NCMA agencies are to conduct groundwater monitoring of wells in the NCMA. In accordance with requirements of the Judgment, the agencies comprising the NCMA group collect and analyze data pertinent to water supply and demand, including:

- Land and water uses in the basin
- Sources of supply to meet those uses
- Groundwater conditions (including water levels and water quality)
- Amount and disposition of other sources of water supply in the NCMA

The Monitoring Program requires that the NCMA gather and compile pertinent information on a calendar year basis; this is accomplished through data collected by NCMA agencies (including necessary field work), the FCWCD, and requests to other public agencies. Periodic reports, such as Urban Water Management Plans (UWMP) prepared by Arroyo Grande, Grover Beach, and Pismo Beach, provide information about demand, supply, and water supply facilities. Annual data are added to the comprehensive NCMA database and analyzed. Results of the data compilation and analysis for 2017 are documented and discussed in this Annual Report.

As shown in Figure 1, the NCMA represents the northernmost portion of the SMGB, as defined in the adjudication and by DWR (DWR, 1958) as the Santa Maria River Valley groundwater basin (Basin 3-12). Adjoining the NCMA to the south and east is the NMMA; the SMVMA encompasses the remainder of the groundwater basin. Figure 2 shows the locations of the four NCMA agencies within the NCMA.

1.1 Description of the NCMA Technical Group

Pursuant to a requirement within the Stipulation, the NCMA Technical Group (TG) was formed (Paragraph IV.C and Paragraph VII). The TG is composed of representatives of each of the NCMA agencies (Table 1).

Table 1. NCMA TG Representatives

| Agency | Representative |
|---------------|---|
| Arroyo Grande | Bill Robeson Public Works Director |
| | Shane Taylor Utilities Manager |
| Grover Beach | Gregory A. Ray, PE Director of Public Works/City Engineer |
| | R.J. (Jim) Garing, PE Consulting City Engineer for Water and Sewer |
| Pismo Beach | Benjamin A. Fine, PE Director of Public Works/City Engineer |
| Oceano CSD | Paavo Ogren General Manager |
| | Tony Marrassino Utility Systems Supervisor |

Arroyo Grande, Pismo Beach, and Grover Beach contract with Water Systems Consulting, Inc. (WSC) to serve as staff extension to assist the TG in its roles and responsibilities in managing the water supply resources. The full TG contracts with GSI Water Solutions, Inc. and its sub-consulting partner, GEI Consultants, Inc., to conduct the quarterly groundwater monitoring and sampling tasks, evaluate water demand and available supply, identify threats to water supply, and assist the TG in preparation of the Annual Report.

1.2 Coordination with Management Areas

Since 1983, management of the NCMA was based on cooperative efforts of the four NCMA agencies in continuing collaboration with the County, FCWCD, and other local and state agencies. Specifically, the NCMA agencies have limited their pumping and, in cooperation with the FCWCD, invested in surface water supplies so as to not exceed the accepted safe yield of the NCMA portion of the SMGB. In addition to the efforts discussed in this 2017 Annual Report, cooperative management occurs through many means including communication by the NCMA

agencies in their respective public meetings, participation in the FCWCD Zone 3 Advisory Committee and TG (related to the management and operation of Lopez Lake), and participation in the Water Resources Advisory Council (the County-wide advisory panel on water issues). The NCMA agencies participated in preparation and adoption of the 2007 San Luis Obispo County Integrated Regional Water Management Plan (2007 County IRWMP) as well as the 2014 update of the County IRWMP, and are active participants in current and ongoing IRWM efforts. The IRWMP promotes integrated regional water management to ensure sustainable water uses, reliable water supplies, better water quality, environmental stewardship, efficient urban development, protection of agriculture, and a strong economy.

Since the 2008 Judgment, the NCMA TG has taken the lead in cooperative management of its management area. The NCMA TG has met monthly for many years and continued to do so throughout 2017. The TG also participated in the Santa Maria Groundwater Basin Management Area (SMGBMA) technical subcommittee, which formed in 2009. The purpose of the SMGBMA technical subcommittee is to coordinate efforts among the three management areas (NCMA, NMMA, SMVMA) such as sharing data throughout the year and during preparation of the Annual Report, reviewing and commenting on technical work efforts of other management areas, standardization of monitoring protocols, consideration of projects and grant opportunities of joint interest and benefit, and sharing of information and data among the managers of the three management areas.

The outcomes of the motion that Arroyo Grande, Pismo Beach, and Grover Beach filed on September 29, 2015 include increased discussion and collaboration between the NCMA and NMMA. One of the initiatives was the formation of an NCMA-NMMA Management Coordination Committee that met four times in 2017 to discuss items of mutual concern and develop strategies for addressing the concerns. Another area of increased mutual collaboration between the NCMA and NMMA was the formation in 2016 of a technical team to collaboratively develop a single data set of water level data points to prepare a consistent set of semiannual water level contour maps for the NCMA and NMMA. That allows the maps from each management area to present a mutually agreed upon condition at the NCMA/NMMA boundary. Those efforts continued into and throughout 2017 and resulted in the development of consistent water level contouring (and enhanced understanding of groundwater conditions) throughout the NMMA and NCMA.

An NCMA Strategic Plan was developed in 2014 to provide the NCMA TG with a mission statement to guide future initiatives, providing a framework for identifying and communicating water resource planning goals and objectives, and formalizing a 10-year work plan for implementation of those efforts. Several key objectives were identified that are related to enhancing water supply reliability, improving water resource management, and increasing effective public outreach. Implementation of some of these efforts continued throughout 2017 and are described in detail in Section 7.1.

2. Area Description

2.1 Setting

The SMGB as defined in the adjudication has three jurisdictional or management areas. As shown in Figure 1, the NCMA represents the northernmost portion of the SMGB. Adjoining the NCMA to the south and east is the NMMA, and the SMVMA encompasses the remainder of the groundwater basin within the Santa Maria Valley.

The northern portion of the NCMA is dominantly urban (residential/commercial). The Cienega Valley, a low-lying coastal stream and valley regime, is the area south of Arroyo Grande Creek in the central part of the area and is predominantly agricultural. The southern and southwestern portions of the area are composed of beach dunes and small lakes. That area is primarily managed by California Department of Parks and Recreation as a recreational area and a sensitive species habitat.

2.2 Precipitation

Each year, climatological and hydrologic (stream flow) data for the NCMA are added to the NCMA database. Annual precipitation from 1950 to 2017 is presented in Figure 3.

Historical rainfall data are compiled on a monthly basis for the following three stations:

- Desert Research Institute (DRI): Western Regional Climate Center Pismo Station (Coop ID: 046943) for 1950 to present
- DWR California Irrigation Management Information System (CIMIS) Nipomo Station (No. 202) for 2006 to present
- San Luis Obispo County-operated rain gauge (No. SLO 759) in Oceano for 2000 to present

The locations of the three stations are shown in Figure 4. In recent years, it was noted that the CIMIS Nipomo station may have been recording irrigation overspray as precipitation and the precipitation data from the station may not be reliable (the evapotranspiration data, however is still considered to be reliable). For this reason, only the DRI and County gauges were used in this 2017 Annual Report for precipitation data. Note that precipitation values are averaged for station readings only for months when data are available. Average values are not weighted on the basis of station location versus the study area. Figure 3 is a composite graph combining data from the two stations and illustrating annual rainfall totals from available data from 1950 through 2017 (on a calendar year basis). Annual average rainfall for the NCMA is approximately 15.6 inches.

Monthly rainfall and evapotranspiration (ET) for 2017 as well as average monthly historical rainfall and ET are presented in Figure 5. During 2017, below-average rainfall occurred in 8 months. Above-average rainfall occurred in January and February, in May, then again in August. The total for the year was 18.9 inches, a little more than 3 inches greater than the average annual rainfall

for the area. The average rainfall total for 2017 is only the third time since 2001 that the area has experienced rainfall equal to or more than the long-term average.

Figure 3 illustrates annual rainfall and exhibits several multi-year drought cycles (e.g., 6 years, 1984-1990) followed by cycles of above-average rainfall (e.g., 7 years, 1991-1998). With the exception of 2010, the period 2007 through 2015 (8 years) experienced below-average annual rainfall indicating a “dry” hydrologic period. This pattern continued into late-2016, when the hydrologic pattern appeared to have broken the serious drought that the area (and state) experienced for the previous 5 years. The rainfall year of 2017 continued to bring hope that the drought cycle had transitioned to a relatively wet period, although as Figure 5 illustrates, the last 7 months of 2017, and continuing into early 2018, were remarkably dry.

Typically, most regional rainfall occurs from November through April. The year 2017 was marked by higher than average rainfall in early winter (January and February), but significantly dryer months throughout the remaining portion of 2017

2.3 Evapotranspiration

CIMIS maintains weather stations in locations throughout the state to provide real time wind speed, humidity, and evapotranspiration data. The nearest CIMIS station to the NCMA is the Nipomo station (see Figure 4). The Nipomo station has gathered data since 2006. While this station may have been subject to irrigation overspray in recent years (noted in the precipitation section above), the apparent irrigation overspray does not have a significant impact on the measurements used for calculating ET. The monthly ET data for the Nipomo station is shown in Figure 5 for 2017 and average (10 years) conditions. ET rate affects recharge potential of rainfall and the amount of outdoor water use (irrigation).

3. Groundwater Conditions

3.1 Geology and Hydrogeology

The current understanding of the geologic framework and hydrogeologic setting is based on numerous previous investigations, particularly Woodring and Bramlette (1950), Worts (1951), DWR (1979, 2002), and Fugro (2015).

The NCMA overlies the northwest portion of the SMGB. Groundwater pumped from the sedimentary deposits comprising the main production aquifer underlying the NCMA is derived principally from the Paso Robles Formation, although the underlying Careaga Sandstone also is an important producing aquifer. Quaternary-age alluvial sediments fill the alluvial valleys.

Several faults either cross or form the boundary of the NCMA, as identified by DWR (2002), Pacific Gas & Electric (PG&E; PG&E, 2014), and others. The Oceano Fault (USGS, 2006) trends northwest-southeast across the central portion of NCMA and has been extensively studied by PG&E (2014). Offshore, the Oceano Fault connects with the Hosgri and Shoreline fault systems several miles west of the coast. Onshore, the Oceano Fault consists of two mapped fault splays, including the main trace of the Oceano Fault as well as the Santa Maria River Fault, which diverges northward of the Oceano Fault through the Cienega Valley before trending into and across the Nipomo Mesa.

The extent that the Oceano and Santa Maria River faults impede groundwater flow within the aquifer materials is unknown, but movement on the faults as mapped by PG&E (2014) may suggest a possible impediment to flow with the Careaga Formation and, possibly, the Paso Robles Formation. PG&E (2014) suggests that the existence of the Santa Maria River Fault is “uncertain,” but the water elevation contour maps of the NCMA (Figures 8 and 9, discussed in more detail in Section 3.3.1), may suggest that the Santa Maria River Fault plays a potential, but unknown, role in groundwater flow across the NCMA.

The Wilmar Avenue Fault generally forms the northern boundary of the NCMA, apparently acting as a barrier to groundwater flow from the older consolidated materials north of the fault, southward into the SMGB. There is no evidence, however, that the Wilmar Avenue Fault impedes alluvial flow in the Pismo Creek, Meadow Creek, or Arroyo Grande Creek alluvial valleys.

3.2 Groundwater Flow

The groundwater system of the NCMA has several sources of recharge: precipitation, agricultural return flow, seepage from stream flow, and subsurface inflow from adjacent areas. In addition, some return flows occur from imported surface supply sources including Lopez Lake and the State Water Project (SWP). Discharge in the region is dominated by groundwater production from pumping wells, but minor discharge certainly occurs through phreatophyte consumption and surface water outflow. Historically, groundwater elevations in wells throughout the NCMA and resulting hydraulic gradients show that subsurface outflow discharge occurs westward from the groundwater basin to the ocean, which is an important control to limit the potential of seawater intrusion. This westward gradient and direction of groundwater flow still is prevalent throughout

the northern portion of NCMA, although there is some evidence recently that the westward gradient may have reversed in the area of Cienega Valley.

The following descriptions of the boundary conditions of the NCMA are derived primarily from Todd (2007). The eastern boundary is coincident with the FCWCD Zone 3 management boundary and with the northwestern boundary of the NMMA. Aquifer materials of similar formation, provenance, and characteristics are present across the majority of this boundary, which allows subsurface flow to occur between the NCMA and NMMA.

The northern and northwestern boundary is coincident with the Wilmar Avenue Fault, which is located approximately along Highway 101 from Pismo Creek to the southeastern edge of the Arroyo Grande Valley and was established by the Court during the adjudication procedures. There is likely insignificant subsurface flow from the consolidated materials (primarily Pismo Formation) north of the Wilmar Avenue Fault across the boundary into the SMGB; however, basin inflow occurs within the underflow associated with alluvial valleys of Arroyo Grande and Pismo creeks.

The southern boundary of the NCMA is an east-west line, roughly along the trend of Black Lake Canyon and perpendicular to the coastline. Historically, and typically, it appears that groundwater flow is roughly parallel to the boundary, suggesting that little to no subsurface inflow occurs across this boundary.

The western boundary of the NCMA follows the coastline from Pismo Creek in the north to Black Lake Canyon. Given the generally westward groundwater gradient in the area, this boundary is the site of subsurface outflow, and is an important impediment to seawater intrusion. The boundary is, however, susceptible to seawater intrusion if groundwater elevations onshore decline, such as may be imminently occurring in the central portion of NCMA along the Cienega Valley.

3.3 Groundwater Monitoring Network

The NCMA Monitoring Program includes: (1) compilation of groundwater elevation data from the County, (2) water quality and groundwater elevation monitoring data from the network of sentry and monitoring wells in the NCMA, (3) water quality data from the State Water Resources Control Board (SWRCB) Division of Drinking Water (DDW), and (4) groundwater elevation data from municipal pumping wells. Analysis of these data is summarized below in accordance with the *Monitoring Program for the Northern Cities Management Area* (Todd, 2008) and as modified over the years as additional well data and data sources have become available.

Approximately 150 wells within the NCMA were monitored by the County at some time during the past few decades. The County currently monitors 75 wells on a semiannual basis (April and October) within the NCMA. Included within the County monitoring program are four “sentry well” clusters (piezometers) along the coast, a four-well cluster in Oceano, and the County Monitoring Well No. 3 (12N/35W-32C03) located on the eastern NCMA boundary between the NCMA and NMMA (Figure 6). The County monitors more than 125 additional wells in the SMGB within the County. Beginning in 2009, the NCMA agencies initiated a quarterly sentry well monitoring program to supplement the County’s semiannual schedule.

To monitor overall changes in groundwater conditions, representative wells within the NCMA were selected for preparation of hydrographs and evaluation of water level changes. Wells were selected based on the following criteria:

- The wells must be part of the County's current monitoring program, or part of a public agency's regular monitoring program.
- Detailed location information must be available.
- Construction details of the wells must be available.
- The locations of the wells should have a wide geographic distribution.
- The historical record of water level data must be long and relatively complete.

Many of the wells that have been used in the program are production wells that were not designed for monitoring purposes and may be screened in various producing zones. Moreover, many of the wells are active production wells or located near active wells and, therefore, potentially subject to localized pumping effects that result in measurements that are lower than the regionally representative water level. These effects are not always apparent at the time of measurement. As a result, data cannot easily be identified as representing static groundwater levels in specific zones (e.g., unconfined or deep confined to semi-confined). Hence, data should be considered as a whole in developing a general representation of groundwater conditions.

The "sentry" wells (32S/12E-24Bxx, 32S/13E-30Fxx, 32S/13E-30Nxx, and 12N/36W-36Lxx) are a critical element of the groundwater monitoring network and are designed to provide an early warning system to identify potential seawater intrusion in the basin (Figure 6). Each sentry well consists of a cluster of multiple wells allowing for the measurement of groundwater elevation and quality from discrete depths. Also shown in Figure 6 is the OCSD observation well cluster, a dedicated monitoring well cluster located just seaward of OCSD production wells 7 and 8, and County Monitoring Well #3 (12N/35W-32C03). Figure 7 shows the depth and well names of the sentry well clusters, the OCSD observation well cluster, and County Monitoring Well #3.

Traditionally, the wells were divided into three basic depth categories: shallow, intermediate, and deep, which describes the relative depths of each monitoring well within the cluster and does not necessarily describe the geologic unit and relative depth of the unit that the screened portion of the well monitors. More recently, however, it is becoming apparent that it is important to recognize and identify the geologic unit that each well monitors; the water level responses and water quality changes are quite different between the shallow alluvial unit (24B01, 30F01, and 30N01), the Paso Robles Formation (24B02, 30F02, 30N02, 30N03, 36L01, Oceano Green, Oceano Blue, and 32C03), and the deeper Careaga Sandstone (24B03, 30F03, 36L02, Oceano Silver, and Oceano Yellow). The significance of this level of differentiation, and the impact of the value of the Deep Well Index, will be studied more extensively in the future.

Since beginning the sentry well monitoring program in 2009, 37 quarterly events have been conducted with one each in May, August, and October 2009, and winter, spring, summer and fall 2010 through 2017, and January and April 2018 (the 2018 data will be included in the 2018 Annual Report). These monitoring events include collection of synoptic groundwater elevation data and water quality samples for laboratory analysis.

3.4 Groundwater Levels

Groundwater elevation data are gathered from the network of wells throughout the NCMA. Water level measurements in these wells are used to monitor effects of groundwater use, groundwater recharge, and as an indicator of risk of seawater intrusion. Analysis of these groundwater elevation data has included development of groundwater surface contour maps, hydrographs, and an index of key sentry well water elevations over time.

3.4.1 Groundwater Level Contour Maps

Contoured groundwater elevations for the spring (April 2017) and fall (October 2017) monitoring events, including data from the County monitoring program, are shown in Figures 8 and 9, respectively.

Groundwater level contours for April 2017 are presented in Figure 8. North of the Santa Maria River Fault, groundwater contours in April show a westerly to southwesterly groundwater flow. Because of a limited number of wells and water level data in the southernmost portion of the area dominated by sensitive-species dunes and State Parks land, the groundwater gradient and flow are generally inferred on the basis of historical records and trends, and water level data from the NMMA farther east.

In the central portion of the NCMA, in Cienega Valley south of Arroyo Grande Creek, agricultural groundwater production resulted in a broad, but subdued, pumping trough. As shown on Figure 8, the water elevations in the Cienega Valley are in the range of 7 to 15 feet NAVD88. However, the Spring 2017 water elevations in the Cienega Valley are considerably and dramatically improved compared to Spring 2016, when water elevations were in the range of (-)2.5 to (-)14.5. These data show an increase in water elevations of 8.5 to almost 30 feet from Spring 2016 to Spring 2017, in apparent response to the relatively heavy rainfall in the winter of 2016-17. For the past several years, the subdued pumping trough exhibited in the Cienega Valley usually manifested itself as a closed depression, with groundwater elevations generally below “sea level” (NAVD88) in the center of the depression.

In recent years, in part in response to the drought, a second pumping depression often appeared north of Arroyo Grande Creek in the area of concentrated municipal pumping, but that historical pumping depression did not form in 2017. Water levels in the main production zone along the coast ranged from 7.3 to almost 11 feet NAVD88.

Groundwater level contours for October 2017 are presented in Figure 9. The groundwater conditions in October 2017 exhibited a return to the previously prevalent pumping depression in the Cienega Valley, with groundwater elevations as deep as (-)13 feet NAVD88. The groundwater elevation in the pumping depression in October 2017 was, however, more than 7 feet higher than was present in October 2016.

Although groundwater elevations showed an unsurprising decline of 4 to 8 feet from April 2017 to October 2017, the Fall 2017 groundwater elevations are generally 2 to 5 feet higher than one year previously (October 2016) and 3 to 8 feet higher than groundwater elevations during this time period throughout the previous drought years. Groundwater elevations in the main production zone along the coast ranged from 5.5 to 8.5 feet NAVD88.

3.4.2 Historical Water Level Trends

Hydrographs of several water wells in the NCMA that have been a part of the County well monitoring program since at least 1995 are presented in Figure 10.

The hydrographs for wells 32D03 and 32D11 (Figure 10) are paired hydrographs for wells in the vicinity of the municipal wellfields. Depending on duration of pumping of the municipal wells, water levels in these wells historically have been below levels in other areas of the basin for prolonged periods of time. The hydrographs show that, historically, groundwater elevations in these wells generally have been above mean sea level. However, an area of lower groundwater elevations (“trough”) beneath the active wellfield appeared during the period of reduced rainfall in 2007 to 2009, when groundwater pumping was the greatest it has been in the past 30 years and which led up to the apparent seawater intrusion event in the coastal wells in 2009.

As illustrated in Figure 10, the water elevations of all the wells, including the paired wells 32D03 and 32D11, exhibited a steady decline from 2011 to 2016 (during which time rainfall was below normal every year). During this time, groundwater elevations declined to near sea level or, in the case of 33K03, to below sea level. The groundwater elevations in these wells were, by October 2016, generally below the levels observed in 2009-10, before water quality degradation was observed in the coastal wells.

However, beginning in 2016 and throughout 2017, all of the wells exhibited an overall increase in water levels (except for the normal, seasonal decline during the summer). The water level in well 33K03 (located near the NCMA/NMMA boundary) is now several feet above sea level (NAVD88).

3.4.3 Sentry Wells

Regular monitoring of water elevations in clustered sentry wells located along the coast are an essential tool for tracking critical groundwater elevation changes at the coast. Groundwater elevations in these wells are monitored quarterly as part of the sentry well monitoring program. As shown by the hydrographs for the five sentry well clusters (Figure 11), the sentry wells provide a long history of groundwater elevations.

Inspection of the recent data shown in Figure 11 compared to the historical record illustrates some noteworthy trends:

- From 2013 until near the end of 2016, the water level signature of 30N02, one of the wells that experienced elevated total dissolved solids (TDS) and chloride levels in 2009-2010, looked quite similar to the water level signature of the well in 2007-2010, immediately before and during the period of water quality degradation. This trend was noteworthy and alarming. However, since the end of 2016 and throughout 2017, the water level reversed the downward trend and now has water elevations seasonally fluctuating around 10 feet NAVD88.
- The decline in water levels since 2005-06 to 2016 in the Oceano Dunes wells (36L01 and 36L02) was also notable and potentially significant, particularly in 36L01 which is screened across the Paso Robles Formation. In 2016, both wells reached historic low water elevations. However, since late 2016, both wells have started recovering to less-alarming levels.

The deepest wells in the clusters (24B03, 30F03, and 30N02) previously were identified as key wells to monitor for potential seawater intrusion, and were suggested to reflect the net effect of changing groundwater recharge and discharge conditions in the primary production aquifer. One of the thresholds to track the status and apparent health of the basin is to average the groundwater elevations from these three deep sentry wells to generate a single, representative index, called the Deep Well Index. Previous studies suggested a Deep Well Index value of 7.5 feet NAVD88 as a minimum threshold, below which the basin is at risk for eastward migration of seawater and a subsequent threat of encroaching seawater intrusion. Historical variation of this index is represented by the average deep sentry well elevations in Figure 12.

Inspection of the Deep Well Index in 2008-09, prior to the period of water quality degradation in 30N02 and 30N03, the Deep Well Index dropped below the 7.5-foot threshold and remained below that level for almost 2 years. It appears that prolonged levels below the threshold may be the key; since the start of the recent drought in 2012, the Deep Well Index dropped several times below the threshold, but usually for only a few months at a time.

What was notable about 2016 was that the Deep Well Index started the year above the trigger value, with an index value of 9.18 in January 2016. By April, the index value dropped to 8.53 (1.03 feet above the trigger value). The index value continued to decline and on June 8, 2016 dropped below the 7.5-foot threshold. For more than 6 months, the Deep Well Index remained below the index trigger value, reaching an index value of 5.39 feet in October. In late October, the Deep Well Index began to rise and on November 28, 2016, it rose above the threshold value (Figure 12).

Except for a very brief period between August 18 and August 29, 2017, when the agencies were forced to increase groundwater pumping due to a maintenance shutdown of the Lopez Lake water supply, the Deep Well Index remained above the 7.5-foot threshold value the entire year.

Key wells (24B03, 30F03, 30N02, 36L01, 36L02, and 32C03) are instrumented with pressure transducers equipped with conductivity probes that periodically record water level, water temperature, and conductivity (Figures 13 through 18). (Note that transducer malfunctions in early to mid-2015 resulted in variable conductivity data in some of the wells; all transducers were replaced and are working properly). Wells 24B03, 30F03, and 30N02 comprise the wells used to calculate the Deep Well Index. Wells 36L01 and 36L02 are adjacent the coast. Well 32C03 is the easternmost well and adjacent to the boundary between the NCMA and NMMA. The following discusses 2017 water levels for these key wells:

- *Deep Well Index Wells:* The Deep Well Index wells exhibited a pattern throughout 2017 consistent with previous years, that is, water levels in wells 30N02 and 30F03 generally declined starting in April or May 2017 and continued declining into October when they began to rise. The water elevation in well 24B03 remained relatively stable throughout 2017, with a slight rise in water levels in late 2017.

Also consistent with patterns seen in previous years is the variability of aquifer response among the three wells. Well 24B03, the northernmost well located in the North Beach Campground, maintains a relatively stable and moderated water level throughout the year, and consistently sustains groundwater elevations higher than the Deep Well Index value. The water level in 24B03 mitigates the water levels in 30N02, which typically maintain

levels consistently deeper than the Deep Well Index. Well 30F03 generally closely follows the Deep Well Index value.

- *Coastal Wells:* The water level in well 36L01, which is screened within the Paso Robles Formation, remained 5 to 10 feet above sea level (NAVD88) throughout 2017, and remained stable within a relatively narrow historical range. The water level in well 36L02, which is screened within the Careaga Sandstone, illustrates a much greater seasonal fluctuation than is observed in 36L01. The water elevation in 36L02 remained above sea level throughout 2017, in comparison with 2015 and 2016 when the water elevation in the well dropped below sea level in late September and remained below sea level into mid-October.
- *NCMA/NMMA Boundary:* Well 32C03, which shows regular seasonal fluctuations, remained above sea level throughout all of 2017, in contrast with the previous 4 years when the water level dropped below sea level in August and remained at a low elevation until early October.

3.5 Change in Groundwater in Storage

The relative change of groundwater levels and associated change in groundwater in storage in the NCMA portion of the SMGB between April 2016 and April 2017 were estimated on the basis of a comparison of water level contour maps created for these periods. Comparison of the April water levels was chosen to comply with the DWR reporting requirements and SGMA.

The groundwater contour lines from each period were compared and the volumetric difference between the two was calculated. The results are presented in Figure 19, which shows contours of equal difference between water elevations of April 2016 and April 2017. Figure 19 shows that the entire NCMA portion of the basin experienced a net gain in groundwater in storage.

From the change of water levels, a volumetric change in groundwater storage was estimated, based on aquifer properties (storage coefficient of 0.02) representative of the Paso Robles Formation in the area as documented in the SMGB Characterization Project (Fugro, 2015). The net rise in groundwater levels represented a net increase of groundwater in storage from April 2016 to April 2017 of approximately 1,500 acre feet (AF).

3.6 Water Quality

Water is used in several ways in the NCMA, each use requiring a certain minimum water quality. Because contaminants from seawater intrusion or from anthropogenic sources potentially can impact the quality of water in the basin, water quality is monitored at each of the sentry well locations in the NCMA and County Well No. 3 (32C03).

3.6.1 Quarterly Groundwater Monitoring

Quarterly groundwater monitoring events occurred in January, April, July, and October 2017. During each event, depths to groundwater were measured, and wells were sampled using procedures, sampling equipment, and in-field sample preservation protocol pursuant to ASTM International Standard D4448-01. The water quality data from these events and historical data

from these wells are provided in Appendix A. Graphs of historical chloride and TDS concentrations over time are presented in Figures 20 and 21, respectively, to monitor for trends that may aid in the detection of impending seawater intrusion.

The historical water quality data show that concentration levels of TDS and chlorides (and other constituents, as well) remain relatively stable within a very narrow historical range. There have been a few notable abnormal occurrences, however (see Figures 20 and 21). The *NCMA 2009 Annual Monitoring Report* (Todd, 2010) suggested that the observed historical variation in water quality data could be caused by several reasons, such as variable permeability of geologic materials, potential mixing with seawater, ion exchange in clay-rich units, and variability in surface recharge sources such as Arroyo Grande and Meadow Creeks (Todd, 2010). Improved management of municipal groundwater use (overall reduction in pumping) since 2009 likely has contributed to groundwater quality becoming relatively stable in the past few years.

3.6.2 Analytical Results Summary

Analytical results of key water quality data (chloride, TDS, and sodium) were generally consistent with historical concentrations and observed ranges of constituent concentrations during 2017. In general, no water quality results were observed that are a cause of concern.

As discussed in the *Third Quarter 2017 Sentry Well Monitoring Report* (GSI, 2017), several wells exhibited elevated TDS concentrations outside of the historical range, as shown on Figure 21 and Appendix A. Notably, based on the normal TDS laboratory test methods, 9 of the 13 wells sampled exhibited elevated TDS concentrations compared to the previous quarter and year. Of these 9 wells, concentrations in all but one well were at historic high values.

To evaluate whether the observed elevated TDS concentrations represented a new trend or abnormal occurrence, the purge logs were inspected and the laboratory was contacted. Although the purge logs documenting the sample collection indicated that the water quality parameters measured in the field were similar to those of previous sampling events, the laboratory data indicated that the relationship between the specific conductance and TDS were outside of the normal range for natural waters for these samples. Based on the ratio between specific conductivity and TDS, the laboratory reanalyzed several of the samples by “fixed total dissolved solids” methods. These results were more consistent with historic ranges. Whatever the cause of the abnormal readings in July 2017, all the water quality results exhibited “normal” concentrations in October 2017 (Q4 monitoring event).

Figure 22 is a Piper diagram, one of several means of graphically representing water quality. Of interest is that there appear to be three separate water quality types found in the monitoring wells:

1. The Pier Avenue deep well (30N02, screened in the Paso Robles Formation from 175 to 255 feet) and Oceano Dunes intermediate well (36L01, screened in the Paso Robles Formation from 227 to 237 feet) are, despite their different nomenclature as “deep” vs. “intermediate” wells, screened in the same production zone in the Paso Robles Formation. These two wells are high in sulfates relative to the other wells in the area, and represent calcium-magnesium-sulfate rich water. Interestingly, both wells are relatively low in chloride, which is significant because this zone, and well 30N02 in particular, was the site of the apparent seawater intrusion event in 2009-2010.

2. The County Monitoring Well #3 (32C03) has an apparent water quality that is different than any of the other wells in the area. It is relatively high in sodium, chloride, and potassium. Its location in the right quadrant of the diamond-shaped part of the diagram commonly characterizes a sodium-chloride-rich groundwater representative of marine or deep ancient groundwater, even though it is a relatively shallow well and screened within the Paso Robles Formation, which is a Plio-Pleistocene age alluvial deposit. Although its overall water quality signature is quite different than seawater, it is more closely representative of seawater than any of the other wells in the area. Well 32C03 is screened from 90 to 170 feet, in the Paso Robles Formation.
3. All of the other wells in the monitoring network fall into the third category of groundwater. These wells are all generally a calcium-bicarbonate groundwater that is commonly associated with shallow groundwater. Of interest is that this grouping of water quality represents groundwater from wells that are screened in both the Paso Robles Formation and the Careaga sandstone (wells 24B03, 30F03, and 36L02 are screened in the Careaga sandstone; the others are screened in the Paso Robles Formation).

None of the water quality results from monitoring wells throughout 2017 indicate an incipient episode or immediate threat of seawater intrusion. Since the decline of TDS, sodium, and chloride concentrations following the 2009-2010 seasons, it is also clear that the location and inland extent of the seawater-fresh water interface is not known, except for the apparent indication that it was detected in well 30N02, 30N03, and MW-Blue, all of which are screened in the Paso Robles Formation. No indications of seawater intrusion have been observed in wells screened in the underlying Careaga sandstone. At this time, without additional offshore data, the location of the interface or mixing zone is not known and will not be known unless and until it intercepts a monitoring well.

This page left blank intentionally.

4. Water Supply and Production/Delivery

4.1 Water Supply

The NCMA water supply consists of three major sources: Lopez Lake, the SWP, and groundwater. Each source of supply has a defined delivery volume that varies from year to year.

4.1.1 Lopez Lake

Lopez Lake and Water Treatment Plant (Lopez Lake, which also is referred to as Lopez Reservoir) is operated by FCWCD Zone 3, which provides water to the NCMA agencies and releases water to Arroyo Grande Creek for habitat conservation and agricultural use. The operational safe yield of Lopez Lake is 8,730 acre feet per year (AFY), which reflects the amount of sustainable water supply during a drought of defined severity. Of this yield, 4,530 AFY have been apportioned by agreements to contractors including each of the NCMA agencies plus County Service Area (CSA) 12 (in the Avila Beach area). Of the 8,730 AFY safe yield, 4,200 AFY are reserved for downstream releases to maintain flows in Arroyo Grande Creek and provide groundwater recharge. The 2017 FCWCD Zone 3 allocations are shown in Table 2.

Table 2. Lopez Lake (FCWCD Zone 3 Contractors) 2017 Water Allocation (AFY)

| Contractor | Normal Water Allocation, (AFY) |
|---------------------------------|--------------------------------|
| Arroyo Grande | 2,290 |
| Grover Beach | 800 |
| Pismo Beach | 892 |
| Oceano CSD | 303 |
| CSA 12 (not in NCMA) | 245 |
| Total | 4,530 |
| <i>Downstream Releases</i> | <i>4,200</i> |
| <i>Safe Yield of Lopez Lake</i> | <i>8,730</i> |

Notes:

AFY = acre-feet per year, CSA = County Service Area, CSD = Community Services District, FCWCD = Flood Control & Water Conservation District, LRRP = Low Reservoir Response Plan, NCMA = Northern Cities Management Area

In December 2014, FCWCD Zone 3 adopted the Low Reservoir Response Plan (LRRP). The LRRP establishes actions that FCWCD Zone 3 can take when the amount of water in storage in the reservoir drops below 20,000 AF, provided that the FCWCD Board of Supervisors declares a drought emergency. The purpose of the LRRP is to limit downstream releases and municipal diversions from Lopez Reservoir to preserve water within the reservoir, above the minimum pool, for a minimum of 3 to 4 years under drought conditions.

The reduction strategies for the LRRP are tied to the amount of water in the reservoir. As the amount of water in the reservoir drops below the triggers (20,000; 15,000; 10,000; 5,000; and 4,000 AF), the hydrologic conditions are reviewed and adaptive management used to meet the LRRP objectives. The municipal diversions are to be reduced according to the strategies shown in Table 3.

Table 3. Lopez Lake Municipal Diversion Reduction Strategy Low Reservoir Response Plan

| Amount of Water in Storage (AF) | Municipal Diversion Reduction | Municipal Diversion (AFY) |
|---------------------------------|-------------------------------|---------------------------|
| 20,000 | 0% | 4,530 |
| 15,000 | 10% | 4,077 |
| 10,000 | 20% | 3,624 |
| 5,000 | 35% | 2,941 |
| 4,000 | 100% | 0 |

Notes:
AF= acre-feet, AFY = acre-feet per year

The mandatory actions after the LRRP is enacted include: reductions in entitlement water deliveries; reductions in downstream releases; no new allocations of Surplus Water from unreleased downstream releases; and extension of time that agencies can take delivery of existing unused water, throughout the duration that the Drought Emergency is in effect, subject to evaporation losses if the water is not used in the year originally allocated. Included in the LRRP is an adaptive management provision that allows modification of the terms of the LRRP to match the initially prescribed reductions based on actual hydrologic conditions.

The downstream releases are to be reduced according to the strategies described in Table 4. The release strategies represent the maximum amount of water that can be released. The FCWCD controls the timing of the reduced releases to meet the needs of the agricultural stakeholders and to address environmental requirements.

Table 4. Lopez Lake Downstream Release Reduction Strategy Low Reservoir Response Plan

| Amount of Water in Storage (AF) | Downstream Release Reduction | Downstream Releases (AFY) |
|---------------------------------|------------------------------|---------------------------|
| 20,000 | 9.5% | 3,800 |
| 15,000 | 9.5% | 3,800 |
| 10,000 | 75.6% | 1,026 |
| 5,000 | 92.9% | 300 |
| 4,000 | 100% | 0 |

Notes:
AF= acre-feet, AFY = acre-feet per year

The LRRP was put into effect on April 1, 2015. Throughout 2015 and all of 2016, Lopez operated pursuant to the 15,000 AF diversion reduction trigger, which required a 10% reduction in municipal diversions. With the agencies enacting mandatory water conservation, utilizing other sources such as SWP, and some minimal rainfall, the 10,000 AF trigger requiring a 20% reduction was avoided.

As a result of the relatively heavy rainfall year of late 2016 and into 2017, Lopez Reservoir recovered from a low of 11,000 AF in storage to a peak of more than 30,000 AF in May 2017, to approximately 25,000 AF at the start of 2018. Although contractually the LRRP is no longer in effect when both triggers rescind (Board of Supervisors declaration of water emergency and reservoir levels drop below 20,000 AF), the Zone 3 agencies resolved to keep the LRRP in effect until there is clear evidence that the drought is over. However, because the reservoir volume was above 20,000 AF, no mandatory reductions in municipal deliveries were required in 2017.

Total discharge from Lopez Lake in 2017 was 7,652 AF, of which 4,553 AF were delivered to NCMA contractors, 88 AF were delivered to CSA 12, and 3,011 AF were released downstream to maintain flow in Arroyo Grande Creek (Table 5).

In the past, when management of releases resulted in a portion of the 4,200 AFY remaining in the reservoir, or the contractors did not use their full entitlement for the year, the water was offered to the contractors as surplus water. Surplus water deliveries to the NCMA agencies in 2017 equaled 451 AF (Table 5).

Table 5. 2017 Lopez Lake Deliveries

| Agency | 2017 Allocation Usage (AF) | 2017 Surplus Usage (AF) | 2017 Total Lopez Lake Water Delivery (AF) |
|---|----------------------------|-------------------------|---|
| Arroyo Grande | 2,060 | 0 | 2,060 |
| Grover Beach | 698 | 54 | 752 |
| Pismo Beach | 900 | 144 | 1,044 |
| Oceano CSD | 444 | 253 | 697 |
| Total NCMA 2017 Usage | 4,102 | 451 | 4,553 |
| CSA 12 (not in NCMA) | 88 | 0 | 88 |
| Downstream Releases | 3,011 | -- | 3,011 |
| Total 2017 Lopez Lake Deliveries | 7,201 | 451 | 7,652 |

Notes:

AF= acre-feet, AFY = acre-feet per year, CSD = Community Services District, NCMA = Northern Cities Management Area

Source: FCWCD Zone 3 Monthly Operations Report

Throughout 2017, the reservoir was operated under the LRRP at the 20,000 AF trigger, which does not require a reduction in deliveries. The status of the reservoir and management actions related to the LRRP will be monitored throughout 2018 and adjusted accordingly based on winter 2018 rainfall and storage in Lopez Lake.

4.1.2 State Water Project

Pismo Beach and OCSD have contracts with FCWCD to receive water from the SWP. The FCWCD serves as the SWP contractor, providing imported water to local retailers through the Coastal Branch pipeline. Pismo Beach and OCSD have contractual water delivery allocations (commonly referred to as “Table A” water) of 1,100 AFY and 750 AFY, respectively (Table 6). (Pismo Beach contracts for 1,240 AF of SWP, but 140 AF are owned by private parties). In addition to their Table A allocation, Pismo Beach holds 1,240 AFY of additional allocation with FCWCD, and OCSD holds an additional allocation of 750 AFY. The additional allocation held by the agencies (usually referred to as a “drought buffer”) is available to augment their SWP water supply when the SWP annual allocation (i.e., percent of SWP water available) is less than 100 percent. The additional allocations also increases each agencies water held in storage. In any given year, however, Pismo Beach’s and OCSD’s total SWP deliveries cannot exceed 1,240 AF and 750 AF, respectively.

Table 6. 2017 NCMA SWP Deliveries

| Agency | Table A Allocation, AFY | Drought Buffer, AFY | 2017 Delivery, AFY |
|------------------------------------|-------------------------|---------------------|--------------------|
| Arroyo Grande | -- | -- | -- |
| Grover Beach | -- | -- | -- |
| Pismo Beach | 1,100 | 1,240 | 451 |
| Oceano CSD | 750 | 750 | -- |
| Total Allocation/Usage, AFY | 1,850 | 1,990 | 451 |

Notes:

Pismo Beach contracts for 1,240 AF of Table A SWP, but 140 AF are owned by private parties

Drought Buffer = Additional supplies when Table A allocation is less than 100%; total SWP deliveries (Table A and drought) cannot exceed 1,240 AFY

AFY= acre-feet per year, CSD = Community Services District, NCMA = Northern Cities Management Area

The SWP annual allocation for contractors for 2017 was set at 60 percent of Table A contractual allocation amounts on January 18, 2017. On April 14, 2017, the 2017 SWP allocation was increased to 85 percent of Table A contractual allocations. Because SWP contractors have the opportunity to store or bank a portion of their allocated water in any one year for delivery during the next year, the volume of delivered SWP water may exceed that year’s Table A allocation. Normally, carryover water is water that has been exported during the year from the Delta, but has not been delivered, although storage for carryover water no longer becomes available if it interferes with storage of SWP water for project needs.

For 2018, the initial allocation of the SWP contractors was set at 15 percent of Table A contractual allocation amounts on November 29, 2017. On January 29, 2018, the Table A contractual allocation was increased to 20 percent.

The SWP supply has the potential to be affected by drought and environmental issues, particularly involving the Delta smelt in the Sacramento-San Joaquin Delta. However, OCSD and

Pismo Beach have not been negatively affected to date by reduced SWP supplies because FCWCD allocations to its subcontractors typically are fulfilled, even in dry years. This is a result of FCWCD's maintenance of excess, unused SWP entitlement. Therefore, even when SWP supplies are decreased, the FCWCD's excess SWP entitlement provides a buffer so that contracted volumes to water purveyors, such as OCSD and Pismo Beach, still may be provided in full. During 2017, Pismo Beach took delivery of 451 AF of SWP water, and OCSD did not take any SWP water delivery.

4.1.3 Groundwater

Each of the NCMA agencies has the capability to extract groundwater from municipal water supply wells located in the central and northern portions of the NCMA. Groundwater also satisfies agricultural irrigation and rural domestic use throughout the NCMA. Groundwater use in the NCMA is governed by the Judgment and the 2002 Settlement Agreement, which establishes that groundwater will continue to be allotted and independently managed by the "Northern Parties" (NCMA agencies, NCMA overlying owners, and FCWCD).

A calculated, consensus "safe yield" value of 9,500 AFY for the NCMA portion of the SMGB was cited in the 2002 Settlement Agreement (through affirmation of the 2001 Groundwater Management Agreement) among the NCMA agencies with allotments for agricultural irrigation (5,300 AFY), subsurface outflow to the ocean (200 AFY), and urban use (4,000 AFY). The volume of the allotment for urban use was subdivided as follows:

- Arroyo Grande: 1,202 AFY
- Grover Beach: 1,198 AFY
- Pismo Beach: 700 AFY
- OCSD: 900 AFY

The basis of the safe yield was established in 1982 by a Technical Advisory Committee, consisting of representatives from Arroyo Grande, Grover Beach, Pismo Beach, OCSD, Avila Beach Community Water District, Port San Luis Harbor District, the Farm Bureau, and the County to deal with an safe yield allocation strategy and agreement not to exceed the safe yield of the "Arroyo Grande Groundwater Basin." The basis for the committee's analysis was DWR (1979). The Technical Advisory Committee concluded that the safe yield was 9,500 AFY. These findings and the allocation of the safe yield then were incorporated into a voluntary groundwater management plan (1983 "Gentlemen's Agreement") and were further formalized in the 2002 Settlement Agreement and the 2005 Stipulation for the SMGB Adjudication.

According to Todd (2007), the "safe yield" allotment for agricultural irrigation is significantly higher than the actual agricultural irrigation demand, and the calculated amount for subsurface outflow is unreasonably low. Todd (2007) recognized that maintaining sufficient subsurface outflow to the coast and preservation of a westward groundwater gradient are essential to preventing seawater intrusion, and although the minimum subsurface outflow necessary to prevent seawater intrusion is unknown, a regional outflow of 3,000 AFY was estimated as a reasonable approximation.

The 2001 Groundwater Management Agreement provides that groundwater allotments of each of the urban agencies can be increased when land within the corporate boundaries is converted

from agricultural use to urban use, referred to as an agricultural conversion credit. Agricultural conversion credits equal to 121 AFY and 209 AFY were developed in 2011 for Arroyo Grande and Grover Beach, respectively. These agricultural credits were unchanged during 2017 (Table 7).

Total groundwater use in the NCMA, including agricultural irrigation and rural uses, is shown in Table 7 (descriptions of agricultural irrigation applied water and rural use estimation are provided in Sections 4.2.1 and 4.2.2, respectively). Total estimated groundwater pumpage in the NCMA in 2017 from the SMGB was 3,456 AF.

Table 7. NCMA Groundwater Pumpage from Santa Maria Groundwater Basin, 2017

| Agency | Groundwater Allotment + Ag Conversion Credit (AF) | 2017 Groundwater Use from SMGB (AF) | Percent Pumped of Groundwater Allotment |
|---|---|-------------------------------------|---|
| Arroyo Grande | 1,202 + 121 = 1,323 | 75 | 6% |
| Grover Beach | 1,198 + 209 = 1,407 | 496 | 35% |
| Pismo Beach | 700 | 205 | 29% |
| Oceano CSD | 900 | 21 | 2% |
| Total Urban Groundwater Allotment / Use | 4,000 + 330 = 4,330 | 797 | 18% |
| Agricultural Irrigation Applied Water | 5,300 - 330 = 4,970 | 2,536 | 51% |
| Nonpotable Irrigation by Arroyo Grande | -- | 43 | -- |
| Rural Water Users | -- | 80 | -- |
| Estimated Subsurface Outflow to Ocean (2001 Groundwater Management Agreement) | 200 | -- | -- |
| Total NCMA Groundwater Allotment / Use | 9,500 | 3,456 | 36% |

Notes:

AF= acre-feet, SMGB = Santa Maria Groundwater Basin, CSD = Community Services District, NCMA = Northern Cities Management Area

4.1.4 Developed Water

As defined in the Stipulation, “developed water” is “groundwater derived from human intervention” and includes infiltration from the following sources: “Lopez Lake water, return flow, and recharge resulting from storm water percolation ponds.” Return flow results from deep percolation of water used in irrigation that is in excess of the plant’s requirements and from outdoor uses of Lopez Lake and SWP deliveries, and a minor component of return flows from other supplies pumped from outside the NCMA boundaries (see Section 4.1.5). These return flows have not been estimated recently, but would be considered part of the groundwater basin yield.

In 2008, Arroyo Grande, Grover Beach, and Pismo Beach prepared stormwater management plans. To control stormwater runoff, and to increase groundwater recharge, each city now

requires that new development construct onsite retention or detention ponds. As these new ponds or basins are constructed, the increase in groundwater recharge could result in recognition of substantial augmentation of basin yield and provision of recharge credits to one or more of the NCMA agencies (Todd, 2007). Thus a re-evaluation of estimated stormwater recharge is warranted as new recharge facilities are installed and as additional information on flow rates, pond size, infiltration rates, and tributary watershed area becomes available. Pursuant to the 2001 Groundwater Management Agreement, recharge credits would be based on a mutually accepted methodology to evaluate the amount of recharge that would involve quantification of factors such as Lopez Lake and SWP recharge, stormwater runoff amounts, determination of effective recharge under various conditions, and methods to document actual recharge to developed aquifers.

4.1.5 Total Water Supply Availability

The baseline (full allocation) water supply available to the NCMA agencies is summarized in Table 8. The baseline water supplies include 100 percent Lopez Lake allocation, SMGB groundwater allotments, agricultural credits, and 100 percent delivery of SWP allocations. This baseline water supply does not include Lopez Lake surplus or SWP carryover because these supplies vary from year to year and are not always available. The category “Other Supplies” includes groundwater pumped from outside the NCMA boundaries (outside the SMGB). The baseline supply for the NCMA agencies totals 10,625 AFY.

Table 8. Baseline (Full Allotment) Available Urban Water Supplies (AFY)

| Urban Area | Lopez Lake | SWP Allocation (at 100%) | Groundwater Allotment | Ag Credit | Other Supplies | Total |
|---------------|--------------|--------------------------|-----------------------|------------|----------------|---------------|
| Arroyo Grande | 2,290 | 0 | 1,202 | 121 | 160 | 3,773 |
| Grover Beach | 800 | 0 | 1,198 | 209 | 0 | 2,207 |
| Pismo Beach | 892 | 1,100 | 700 | 0 | 0 | 2,692 |
| Oceano CSD | 303 | 750 | 900 | 0 | 0 | 1,953 |
| Total | 4,285 | 1,850 | 4,000 | 330 | 160 | 10,625 |

Notes:

AFY= acre-feet per year, CSD = Community Services District, SWP = State Water Project

Table 9 summarizes the available water supply to the NCMA agencies in 2017, including Lopez Lake, Lopez Lake carryover (surplus) water, the 2017 SWP 85 percent Table A delivery schedule, and the available SWP carryover water. The total available water supply is a compilation of all components of each agency’s portfolio.

Table 9. 2017 Available Urban Water Supply, (AF)

| Urban Area | Lopez Lake Allocation | Lopez Lake Surplus | 2017 SWP Allocation (at 85% Delivery) | 2017 SWP Drought Buffer | 2017 SWP Carryover | Ground-water Allotment | Ag Credit | Other Supplies | Total (2017) |
|---------------|-----------------------|--------------------|---------------------------------------|-------------------------|--------------------|------------------------|------------|----------------|--------------------------|
| Arroyo Grande | 2,290 | 937 | 0 | 0 | 0 | 1,202 | 121 | 160 | 4,710 |
| Grover Beach | 800 | 308 | 0 | 0 | 0 | 1,198 | 209 | 0 | 2,515 |
| Pismo Beach | 892 | 1,228 | 935 | 0 ¹ | 511 | 700 | 0 | 0 | 4,266¹ |
| Oceano CSD | 303 | 713 | 638 | 112 ¹ | 0 | 900 | 0 | 0 | 2,666¹ |
| Total | 4,285 | 3,186 | 1,573 | 112 | 511 | 4,000 | 330 | 160 | 14,157 |

Notes:

¹In any given year, Pismo Beach’s total SWP deliveries cannot exceed 1,240 AF and OCSD’s deliveries cannot exceed 750 AF. In years when the Table A SWP allocation, plus drought buffer, plus carryover exceed 1,240 AF for Pismo Beach and 750 AF for OCSD, the total available SWP supply is capped at 1,240 AF or 750 AF for Pismo Beach and OCSD, respectively. AF = acre-feet, CSD = Community Services District, SWP = State Water Project

4.2 Water Use

Water use refers to the total amount of water used to satisfy the needs of all water user groups. In the NCMA, water use predominantly serves urban production and agricultural applied water, and a relatively small component of rural domestic use (including small community water systems), and domestic, recreational, and agriculture-related businesses.

4.2.1 Agricultural Water Supply Requirements

For this 2017 NCMA Annual Monitoring Report, the irrigation applied water estimations were updated using the 2015 Integrated Water Flow Model (IWFM) Demand Calculator (IDC). The IDC is a stand-alone program that simulates land surface and root zone flow processes, and, importantly for this report, the agricultural water supply requirements for each crop type. IDC applies user specified soil, weather, and land-use data to estimate and track the soil moisture balances. More specifically, available water within the root zone is tracked for each of the crops to and simulate when irrigation events take place based on crop requirements and cultural irrigation practices.

Data Used in the IDC:

- *Land-use.* The San Luis Obispo County Agricultural Commissioner’s Office (ACO) annually compiles an estimate of irrigated acres in the County. A view displaying the irrigated agricultural lands within NCMA for 2017 is shown in Figure 23. The 2017 survey indicates a total of 1,447 acres of irrigated agriculture in the NCMA consisting predominantly of

rotational crops. Table 10 lists the crop types and acreages found in the NCMA that were used in the IDC program.

- *Climate Data.* 2017 weather data from the FCWCD rain gauge in Oceano and the CIMIS Nipomo Station (202) were used for precipitation and data related to reference ET values, respectively. The data needed to calculate reference ET include solar radiation, humidity, air temperature, and wind speed. Both weather stations are shown in Figure 4 along with another rain gauge located in Pismo Beach.
- *ET Values by Crop Category.* The DWR Consumptive Use Program (CUP) was used to estimate potential ET values based on specific annual climate data and crop type. The CUP used monthly climate data from the closest CIMIS station (202, Nipomo) and includes crop coefficients to calculate ET values for the irrigated crop categories.
- Assumptions used in the analysis include:
 - Since the NCMA is located near the coast, agricultural practices are influenced significantly by the marine layer. As seen in Figure 4, the Nipomo CIMIS station used for climatological data in both the CUP and IDC is located farther inland than the easternmost boundary of NCMA and the recorded weather data do not fully account for the cooling and moisture effects of the marine layer.
 - Use of an unadjusted calculated ET results in a higher value than that actually taking place in the NCMA. Studies have identified that ET values within the marine layer can be as much as 20 to 25 percent lower than that of the same crop located just outside of the marine layer influence. Irrigation Training and Research Center <<http://www.itrc.org/etdata/etmain.htm>> provides typical year (1997 Hydrology) ET values using various irrigation methods for Zone 3 (coastal outside marine layer) and Zone 1 (marine layer). The computed percent reduction in ET to Zone 3 values range from 11% for rotational crops (small vegetables) to 19% for strawberries. The distance the marine layer extends inland can vary from less than ½ mile to as much as 4 to 5 miles, depending on land topography. Low-lying areas have a higher frequency of marine layer coverage, and for longer periods throughout the day.
 - The NCMA is considered to be a low-lying area with boundaries extending between 2 and 5 miles inland. Recognizing that not all the crops would be affected by the marine layer, but also accounting for the cooling influence over some of the area, monthly ET values calculated on the basis of the CIMIS Nipomo Station data were adjusted lower by 12 percent and are shown in Table 10.
- *Soil Data.* The Natural Resources Conservation Service (NRCS) Soil Survey Geographic Database (SSURGO) was used to collect soil parameters in the NCMA for use in the IDC. The soil properties used include saturated hydraulic conductivity, porosity, and the runoff curve numbers. The field capacity and wilting points were developed on the basis of the described soil textures (i.e., sand, loam, sandy clay, etc.) and industry standards. The IDC

relies on soil properties for estimating water storage, deep percolation, and runoff; all of which lead to a refined estimation of applied water.

Table 10. 2017 NCMA Crop Acreages and Calculated Evapotranspiration

| Crop Type | Acreage | 2017 Potential ET ¹ (AF per acre) |
|------------------|---------|---|
| Rotational Crops | 1,256 | 1.9 ² |
| Strawberry | 168 | 0.8 |
| Nursery Plants | 12 | 1.9 |
| Potatoes | 11 | 1.2 |

Notes:

¹See “ET Values by Crop Category,” in text section above.

²Rotational crops ET is based on a two- to three-crop rotation.

ET = evapotranspiration, AF = acre-feet


Model Development and Computations

The IDC is written in FORTRAN 2003 using an object-oriented programming approach. The program consists of three main components: (1) input data files, (2) output data files, and (3) the numerical engine that reads data from input files, computes applied water demands, routes water through the root zone, and prints out the results to the output files. The flow terms used in the root zone routing are defined in the table below and shown in the graphic on the following page. Drainage from ponded areas (D_r) was not applicable because there are no ponded crops in the NCMA; and data related to generic soil moisture (G) were not available.

| | | |
|----------------------|---|---|
| P | Precipitation | <i>User Specified</i> |
| ET | Evapotranspiration | <i>IDC Output</i> |
| G | Generic source of moisture (i.e., fog, dew) | <i>Data Not Available</i> |
| A_w | Applied water | <i>IDC Output</i> |
| D_r | Outflow resulting from drainage of ponded areas (rice, refuges, etc.) | <i>Not Applicable</i> |
| R_P | Direct runoff | <i>IDC Output</i> |
| R_f | Return flow | <i>User Specified (fraction of applied water)</i> |
| U | Re-used portion of return flow | <i>User Specified (fraction of return flow)</i> |
| D | Deep percolation | <i>IDC Output</i> |

Notes:

Integrated Water Flow Model (IWFM) Demand Calculator (IDC)

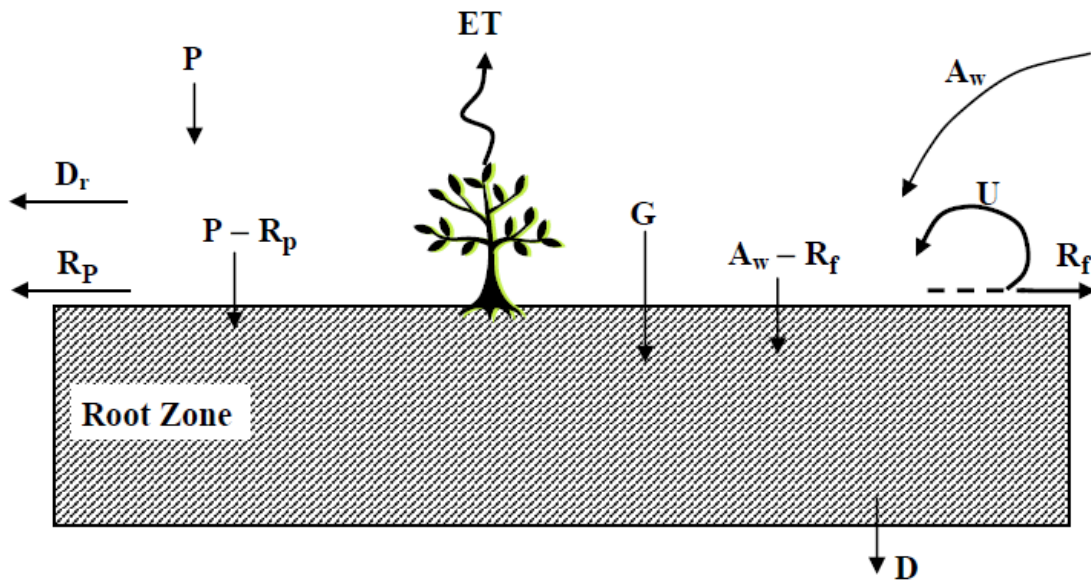

Source: California DWR (2016).

All extracted geospatial information was applied to a computational grid within the IDC framework to simulate the root zone moisture for 2017 in NCMA agricultural areas. The IDC provides the total water supply requirement for each crop category met through rainfall and applied irrigation water in agricultural areas based on user-defined parameters for crop evaporation and transpiration requirements, climate conditions, soil properties, and agricultural management practices. Sources for data related to crop demands (i.e., potential ET), climate conditions, and soil properties are discussed above. The computations for actual crop ET (versus potential ET), applied water, and deep percolation are described below.

The potential ET is the amount of water a given crop will consume through evaporation and/or transpiration under ideal conditions (i.e., fully irrigated 100 percent of the time). Fully irrigated conditions mean that the water required to meet all crop demands is available. Water is available to the crops when the soil moisture content within the root zone is between the field capacity and the wilting point. When the soil moisture is above the field capacity, some water will go to runoff and/or deep percolation; when the soil moisture is below the wilting point, it is contained in the smallest pore spaces within the root zone and considered unavailable to the crops.

The difference between the field capacity and the wilting point is the total available water (TAW). In IDC, when the soil moisture is above one-half of the TAW, the crop ET will be equal to the potential ET. However, if the soil moisture is below one-half of the TAW, the plants will experience water stress and ET decreases linearly until it reaches zero at the wilting point. This method of simulating water stress is similar to the method described in Allen et al. (1998) to compute non-standard crop ET under water stress conditions.

The IDC monitors the moisture content within the root zone and applies water by triggering an irrigation event when the calculated soil moisture is below a user-specified minimum allowable soil moisture requirement. For this application of the IDC, the minimum soil moisture requirement was set to trigger an irrigation event when the soil moisture fell below one-half the TAW to limit

water stress in the crops. During an irrigation event, the soil moisture content in the root zone reaches field capacity. If precipitation occurs, soil moisture may increase above field capacity, generating deep percolation, and potentially runoff, both depending on the quantity and temporal distribution of rainfall.

Deep percolation is the vertical movement of water through the soil column flowing out of the root zone resulting in the potential for groundwater recharge. The IDC applies the van Genuchten-Mualem equation (Mualem, 1976; van Genuchten, 1985) to compute deep percolation using the user-defined saturated hydraulic conductivity and pore size distribution.

Results

The total agricultural water supply requirements for 2017 was estimated to be 2,536 AF, and the effective precipitation (i.e., rainwater used by the crop) was 450 AF. Figure 24 illustrates the estimated crop water requirement in the NCMA as calculated by the IDC, and displays the four identified crop types and their estimated monthly applied water. The rotational crops have the highest water supply requirement because they cover the greatest area (see Figure 23) and have the greatest annual ET (Table 11).

The estimated agricultural water supply requirement of 2,536 AF in 2017 compares with estimated 2,551 AF in 2016, 3,008 AF in 2015, and 2,955 AF in 2014. In 2014, the methodology of estimating agricultural water requirements was modified from an estimated applied rate based on hydrologic conditions to the IWFM IDC methodology described here.

Table 11. 2017 IDC Model Results of Monthly Applied Water

| | Monthly Applied Water (AF) | | | | | | | | | | | | Annual Total (AF) |
|---------------------------------|-------------------------------------|------|------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|------|------------------------|
| | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | |
| Rotational Crops (AF) | - | - | - | 214 | 329 | 274 | 374 | 341 | 312 | 253 | 277 | - | 2,373 |
| Strawberry (AF) | - | - | - | - | - | 19 | 26 | 38 | 31 | -27 | - | - | 141 |
| Potatoes (AF) | - | - | - | - | 1 | 3 | 5 | 3 | - | - | - | - | 12 |
| Flowering and Nursery (AF) | - | - | - | - | - | - | 1 | 3 | 3 | 2 | 2 | - | 11 |
| Total | - | - | - | 214 | 330 | 295 | 406 | 385 | 345 | 281 | 279 | - | 2,536 |
| | Monthly Precipitation (inches) | | | | | | | | | | | | Annual Total (inches) |
| | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | |
| Precipitation (inches) | 8.90 | 5.99 | 1.26 | 0.83 | 0.35 | - | - | - | 0.20 | 0.08 | 0.15 | - | 17.76 |
| | | | | | | | | | | | | | |
| | Monthly Unit Water Demand (AF/Acre) | | | | | | | | | | | | Annual Total (AF/Acre) |
| | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec | |
| Rotational Crops (AF/Acre) | - | - | - | 0.17 | 0.26 | 0.22 | 0.30 | 0.27 | 0.25 | 0.20 | 0.22 | - | 1.89 |
| Strawberry (AF/Acre) | - | - | - | - | - | 0.11 | 0.16 | 0.23 | 0.18 | 0.16 | - | - | 0.84 |
| Potatoes (AF/Acre) | - | - | - | - | 0.8 | 0.21 | 0.43 | 0.26 | - | - | - | - | 0.98 |
| Flowering and Nursery (AF/Acre) | - | - | - | - | - | - | 0.05 | 0.31 | 0.24 | 0.15 | 0.19 | 0.03 | 0.96 |
| Area Weighted Average | - | - | - | 0.15 | 0.23 | 0.20 | 0.28 | 0.27 | 0.24 | 0.19 | 0.19 | 0.00 | 1.75 |

Notes:
 AF = acre-feet, AF/Acre = acre-feet per acre

4.2.2 Rural Use

In the NCMA, rural water use refers to groundwater pumping not designated as urban use or agricultural irrigation applied water and includes small community water systems, individual domestic water systems, recreational uses, and agriculture-related business systems. Small community water systems using groundwater in the NCMA were identified initially through a

review of a list of water purveyors compiled in the 2007 County IRWMP. These include the Halcyon Water System, Ken Mar Gardens, and Pacific Dunes RV Resort. The Halcyon Water System serves 35 homes in the community of Halcyon, while Ken Mar Gardens provides water supply to 48 mobile homes on South Halcyon Road. The Pacific Dunes RV Resort, with 215 RV sites, provides water supply to a largely transitory population and a nearby riding stable. In addition, about 25 homes and businesses have been identified as served by private wells through inspection of aerial photographs of rural areas within NCMA. Two mobile home communities, Grande Mobile and Halcyon Estates, are served by OCSD through the distribution system of Arroyo Grande; thus the production summary of OCSD includes these two communities. Based on prior reports, it is assumed that the number of private wells is negligible within the service areas of the NCMA agencies.

The Pismo Beach Golf Course (Le Sage Riviera Campground) uses an onsite water well for turf irrigation. The pumped water is not metered, and total water use is not known by the golf course operators. An estimate of water demand for the golf course is based on the irrigated acreage, sandy soils, near-ocean climate, and water duty factors from the U.S. Golf Association, Alliance for Water Efficiency, U.S. Golf Courses Organization of America, and several other sources. The estimated rural water demand is provided in Table 12.

Table 12. Estimated Rural Water Production

| Groundwater User | No. of Units | Estimated Water Production, AFY per Unit | Estimated Annual Water Production, AFY | Notes |
|------------------------------------|--------------|--|--|-------|
| Halcyon Water System | 35 | 0.40 | 14 | 1 |
| Ken Mar Gardens | 48 | -- | 5 | 2 |
| Pacific Dunes RV Resort | 215 | 0.03 | 6 | 3 |
| Pismo Beach Golf Course | -- | -- | 45 | 4 |
| Rural Users | 25 | 0.40 | 10 | 1 |
| Current Estimated Rural Use | | | 80 | |

Notes:

¹ Water use/unit based on 2000 and 2005 Grover Beach water use per connection, 2005 UWMP.

² Demand based on metered water usage.

³ Water use/unit assumes 50 percent annual occupancy and 0.06 AFY per occupied site.

⁴ Estimated golf course demand, based on estimated water duty factor, annual ET, and irrigated acreage.

AFY = acre-feet per year

UWMP = Urban Water Management Plan

ET = evapotranspiration

4.2.3 Urban Production

Urban water production is presented in Table 13 for each of the NCMA agencies from 2005 through 2017. These values reflect Lopez Lake deliveries, SWP deliveries, and groundwater production data, and represent all water used within the service areas of the four NCMA agencies (including the portions of Arroyo Grande and Pismo Beach that extend outside the NCMA), and system losses. In general, urban water production has ranged from 5,476 AF (2016) to 8,982 AF (2007). There has been an overall decline in urban production since 2009, although there were

slight increases in 2012 and 2013, and again this past year in 2017. The long-term declining trend in production is likely attributed to the relatively slower economy from 2009 through 2012 and, since then, because of conservation activities implemented by the NCMA agencies in response to the historic drought. Since 2013, when urban production was 7,939 AF, urban production declined dramatically to 2016 to the lowest level in at least the past 12 years. The urban production in 2017 is up slightly from 2016, at 5,690 AF.

Table 13. Urban Water Production (Groundwater and Surface Water, AF)

| Year | Arroyo Grande | Grover Beach | Pismo Beach | OCSD | Total Urban |
|------|---------------|--------------|-------------|------|-------------|
| 2005 | 3,460 | 2,082 | 2,142 | 931 | 8,615 |
| 2006 | 3,425 | 2,025 | 2,121 | 882 | 8,453 |
| 2007 | 3,690 | 2,087 | 2,261 | 944 | 8,982 |
| 2008 | 3,579 | 2,051 | 2,208 | 933 | 8,771 |
| 2009 | 3,315 | 1,941 | 2,039 | 885 | 8,180 |
| 2010 | 2,956 | 1,787 | 1,944 | 855 | 7,542 |
| 2011 | 2,922 | 1,787 | 1,912 | 852 | 7,473 |
| 2012 | 3,022 | 1,757 | 2,029 | 838 | 7,646 |
| 2013 | 3,111 | 1,792 | 2,148 | 888 | 7,939 |
| 2014 | 2,752 | 1,347 | 1,949 | 807 | 6,856 |
| 2015 | 2,239 | 1,265 | 1,736 | 703 | 5,943 |
| 2016 | 1,948 | 1,210 | 1,646 | 672 | 5,476 |
| 2017 | 2,194 | 1,248 | 1,700 | 718 | 5,860 |

Notes:

AF = acre-feet, CSD = Community Services District

4.2.4 2017 Groundwater Pumpage

Total SMGB groundwater use in the NCMA, including urban production, applied agricultural water requirements, and rural pumping, is shown in Table 14 (replication of Table 7). Total estimated SMGB groundwater pumpage in the NCMA in 2017 was 3,456 AF, which represents a slight increase over 2016 (3,284 AF), which was the lowest volume of groundwater production from the NCMA portion of the basin in at least the past 20 years.

Table 14. NCMA Groundwater Pumpage from Santa Maria Groundwater Basin, 2017 (AF)

| Agency | Groundwater Allotment + Ag Conversion Credit (AF) | 2017 Groundwater Use (AF) | Percent Pumped of Groundwater Allotment |
|---|---|---------------------------|---|
| Arroyo Grande | 1,202 + 121 = 1,323 | 75 | 6% |
| Grover Beach | 1,198 + 209 = 1,407 | 496 | 35% |
| Pismo Beach | 700 | 205 | 29% |
| Oceano CSD | 900 | 21 | 2% |
| Total Urban Groundwater Allotment / Use | 4,000 + 330 = 4,330 | 797 | 18% |
| Agricultural Irrigation Applied Water | 5,300 - 330 = 4,970 | 2,536 | 51 |
| Nonpotable Irrigation by Arroyo Grande | -- | 43 | -- |
| Rural Water Users | -- | 80 | -- |
| Estimated Subsurface Outflow to Ocean (2001 Groundwater Management Agreement) | 200 | -- | -- |
| Total NCMA Groundwater Allotment / Use | 9,500 | 3,456 | 36% |

Notes:

AF = acre-feet, CSD = Community Services District, NCMA = Northern Cities Management Area

The estimated groundwater pumpage of 3,456 in 2017 represents about 36 percent of the calculated yield of 9,500 AFY for the NCMA portion of the Santa Maria Basin.

A graphical depiction of water use by supply source for each NCMA agency since 1999 is presented as Figure 25. The graphs depict changes in water supply availability and use over time, including the increased use of SWP water during the early years of the period when SWP Table A deliveries were greater. The increased dependence in 2017 on Lopez Reservoir is illustrated in this graphic. Although all four agencies pumped groundwater as part of their supply portfolio in 2017, groundwater pumped from the SMGB constituted a minor part of the overall water supply (797 AF, or 14 percent of overall urban use).

As shown in Figure 26, groundwater pumpage reached a peak in 2007, and then declined in 2008, 2009, and 2010. From 2010 through 2013, pumpage increased slightly every year, but even so, overall groundwater use remained significantly lower than historical annual pumpage rates. From 2013 through 2016, pumpage steadily declined. In 2017, urban groundwater use declined to 797 AF, which is 18 percent of the 4,330 AF of combined urban groundwater allotment and agricultural conversion credit.

4.2.5 Changes in Water Production

The historical water use for urban uses, agricultural irrigation, and rural uses are shown in Table 15.

Table 15. Total Water Use (Groundwater and Surface Water, AF)

| Year | Arroyo Grande | Grover Beach | Pismo Beach | OCSD | Total Urban | Agricultural Irrigation ¹ | Rural Water | Total Use |
|-------------|---------------|--------------|-------------|------|-------------|--------------------------------------|-------------|---------------|
| 2005 | 3,460 | 2,082 | 2,142 | 931 | 8,615 | 2,056 | 36 | 10,707 |
| 2006 | 3,425 | 2,025 | 2,121 | 882 | 8,453 | 2,056 | 36 | 10,545 |
| 2007 | 3,690 | 2,087 | 2,261 | 944 | 8,982 | 2,742 | 36 | 11,760 |
| 2008 | 3,579 | 2,051 | 2,208 | 933 | 8,771 | 2,742 | 36 | 11,549 |
| 2009 | 3,315 | 1,941 | 2,039 | 885 | 8,180 | 2,742 | 36 | 10,958 |
| 2010 | 2,956 | 1,787 | 1,944 | 855 | 7,542 | 2,056 | 38 | 9,636 |
| 2011 | 2,922 | 1,787 | 1,912 | 852 | 7,473 | 2,742 | 38 | 10,253 |
| 2012 | 3,022 | 1,757 | 2,029 | 838 | 7,646 | 2,742 | 41 | 10,429 |
| 2013 | 3,111 | 1,792 | 2,148 | 888 | 7,939 | 2,742 | 42 | 10,722 |
| 2014 | 2,752 | 1,347 | 1,949 | 807 | 6,855 | 2,955 | 38 | 9,848 |
| 2015 | 2,239 | 1,266 | 1,736 | 703 | 5,943 | 3,008 | 38 | 8,990 |
| 2016 | 1,948 | 1,210 | 1,646 | 672 | 5,476 | 2,551 | 81 | 8,108 |
| 2017 | 2,194 | 1,248 | 1,700 | 718 | 5,860 | 2,579 | 80 | 8,519 |

Notes:

¹Irrigation applied water includes agricultural irrigation plus SMGB non-potable irrigation by Arroyo Grande.

AF = acre-feet, CSD = Community Services District

In general, urban water production has ranged from 5,476 AF (2016) to 8,982 AF (2007; Table 15). Water use since 2007 shows an overall decline each year with a slight increase in 2012 and 2013; this overall decline in water use may be attributed to the relatively slower economy and, particularly in recent years, conservation activities implemented by the NCMA agencies in response to the drought.

In the agricultural irrigation category, agricultural acreage has remained fairly constant. Thus, annual applied water for agricultural irrigation varies mostly with weather conditions.

Acknowledging the variability caused by weather conditions, agricultural irrigation applied water is not expected to change significantly given the relative stability of applied irrigation acreage and cropping patterns in the NCMA south of Arroyo Grande Creek.

Changes in rural domestic pumping have not been significant.

This page left blank intentionally.

5. Comparison of Water Supply v. Water Production

The Baseline Available Urban Water Supplies for each of the NCMA agencies is 10,625 AFY (assuming 100 percent delivery of SWP allocation and assuming no Lopez Lake surplus water or SWP carryover; refer to Table 8). In 2017, because of the availability of Lopez Lake surplus water and SWP carryover water and a relatively robust SWP delivery, the total available urban water supply was 14,157 AF (Table 9).

As described in the 2001 Groundwater Management Agreement and affirmed in the 2002 Settlement Agreement, the calculated historical “safe yield” from the NCMA portion of the groundwater basin is 9,500 AFY. Because all of the agricultural irrigation water use is supplied by groundwater, the total available agricultural irrigation supply is a portion of the estimated safe yield; this portion was allocated as 5,300 AFY for agricultural and rural use. The agricultural conversion of 330 AFY reduces this allocation to 4,970 AFY. Of the estimated safe yield of 9,500 AFY, other than what is allocated for agricultural irrigation and rural use, the remaining 4,330 AFY is allocated for urban water use (4,330 AFY, including 4,000 AFY groundwater allocation plus 330 AFY in agricultural conversion credit) and an estimated 200 AFY for subsurface outflow to the ocean.

In 2017, the total estimated NCMA water production was 8,519 AF (Table 16). The 2017 water production, by source, of each city and agency is shown in Table 16. Note that the production volumes described here are gross production (if pumped groundwater) and gross deliveries (if surface water deliveries) and equals net consumptive demand plus losses and return water.

Table 16. 2017 Water Production by Source (AF)

| Urban Area | Lopez Lake | State Water Project | SMGB Groundwater | Other Supplies | Total |
|---|--------------|---------------------|------------------|----------------|--------------|
| Arroyo Grande | 2,060 | 0 | 75 | 59 | 2,194 |
| Grover Beach | 752 | 0 | 496 | 0 | 1,248 |
| Pismo Beach | 1,044 | 451 | 205 | 0 | 1,700 |
| Oceano CSD | 697 | 0 | 21 | 0 | 718 |
| Urban Water Use Total | 4,553 | 451 | 797 | 59 | 5,860 |
| Agricultural Irrigation Applied Water | 0 | 0 | 2,536 | 0 | 2,536 |
| Rural Water Users | 0 | 0 | 80 | 0 | 80 |
| Non-potable Irrigation by Arroyo Grande | 0 | 0 | 43 | 0 | 43 |
| Total | 4,553 | 451 | 3,456 | 59 | 8,519 |

Notes:

AF = acre-feet, SMGB = Santa Maria Groundwater Basin, CSD = Community Services District

As shown in Table 16, urban water use in 2017 to the NCMA was supplied from 4,553 AF of Lopez Lake water, 451 AF of SWP water, and 797 AF of groundwater. The 59 AF of “Other Supplies” delivered to Arroyo Grande consists of groundwater pumped from the Pismo Formation, which is located outside of the shared groundwater basin.

Based on the calculated yield of the NCMA portion of the basin, the baseline (full allocation) total available supply for all uses is 15,595 AFY, which is the sum of 10,625 AFY for urban use plus the allocation for agricultural irrigation and rural area of 4,970 AFY. In 2017, factoring in the SWP delivery schedule and availability of SWP carryover water and Lopez Lake surplus, the total available supply for all uses (in 2017) was 14,157 AF (Table 9), compared to actual 2017 NCMA water use of 8,519 AF (Table 15). It must be noted, however, that this comparative review of available 2017 supply versus production must be viewed with caution because of the potential threats to the groundwater supply (see Section 6.1, below). As described earlier, the NCMA agencies pumped only 18 percent of their “available” groundwater allotment. Such minimal utilization of the groundwater resource, coupled with the relatively wet rainfall year, resulted in a positive increase in groundwater in storage in the basin and a slight rise in overall water level elevations. It is clear, however, that the NCMA agencies could not have used their entire groundwater allotment in 2017 without significantly lowering water elevations below current conditions and potentially seriously exacerbating the threat of seawater intrusion.

6. Threats to Water Supply

Because the NCMA agencies depend on both local and imported water supplies, changes in either state-wide or local conditions can threaten the NCMA water supply. Water supply imported from other areas of the state may be threatened by state-wide drought, effects of climate change in the SWP source area, management and environmental protection issues in the Sacramento-San Joaquin Delta that affect the amount and reliability of SWP deliveries, and risk of seismic damage to the SWP delivery system. Local threats to the NCMA water supply similarly include extended drought and climate change that may affect the yield from Lopez Lake and reduced recharge to the NCMA. In addition, the NCMA is not hydrologically isolated from the NMMA and the rest of the SMGB, and water supply threats in the NMMA are a potential threat to the water supply sustainability of the NCMA.

There is a potential impact from seawater intrusion if the groundwater system as a whole, including the entire SMGB, is not adequately monitored and managed. In particular, the management of the basin may need to account for sea level rise and the relative change in groundwater gradient along the shore line.

6.1 Threats to Local Groundwater Supply

6.1.1 Declining Water Levels

Water levels continue to exhibit an overall declining trend in the NCMA. Important factors to maintaining water levels are managing inflow and outflow.

- **Inflow:** An important inflow component to the NCMA area is subsurface inflow into the aquifers that supply water wells serving the NCMA. Historically, subsurface inflow to the NCMA from the Nipomo Mesa along the southeast boundary of the NCMA is an important component of groundwater recharge. This inflow is reduced from historical levels, as recognized in 2008-2009, to “something approaching no subsurface flow” because of lower groundwater levels in the NMMA (*NMMA 2nd Annual Report CY 2009*, page 43). This condition continues to worsen, as described in all subsequent NMMA Annual Reports (NMMA, 2011, 2012, 2013, 2014, 2015, 2016, and 2017).
- **Outflow:** A major outflow component is groundwater pumpage. Total SMGB groundwater pumping in the NCMA (urban, agriculture, and rural domestic) was 3,456 AF in 2017, which is 36 percent of the court-accepted 9,500 AFY safe yield of the NCMA portion of the basin. Such minimal utilization of the groundwater resource, coupled with the relatively wet rainfall year, resulted in a positive increase in groundwater in storage in the basin and a slight rise in overall water level elevations. It is clear, however, that the NCMA agencies could not have used their entire groundwater allotment in 2017 without significantly lowering water elevations below current conditions and potentially seriously exacerbating the threat of seawater intrusion.

The current condition, with groundwater pumping at 36 percent of the safe yield and a moderate increase in groundwater in storage for the first time in several years, illustrates the impacts of the

drought that essentially started in 2002, with the only years since then of higher than normal rainfall in 2010 and 2017, that manifested itself in significantly reduced recharge. But it also illustrates the impacts of reduced subsurface inflow recharge from the east (Nipomo Mesa). This condition of declining water levels in the NCMA, even though total pumping is currently 36 percent of the basin safe yield, will be exacerbated if the NCMA agencies are required to increase groundwater withdrawals because of a reduction or total loss in local surface water supplies or SWP deliveries.

6.1.2 Seawater Intrusion

The NCMA is underlain by an accumulation of alluvial materials that slope gently offshore and extend for many miles under the ocean (DWR 1970, 1975). Coarser materials within the alluvial materials comprise aquifer zones that receive freshwater recharge in areas above sea level. If sufficient outflow from the aquifer occurs, the dynamic interface between seawater and fresh water will be prevented from moving onshore. Sufficient differential pressure to maintain a net outflow is indicated by onshore groundwater elevations that are above mean sea level and establish a seaward gradient to maintain that outflow.

The 2008 NCMA Annual Report documented that a portion of the NCMA groundwater basin exhibited water surface elevations below sea level (*NCMA 2008 Annual Monitoring Report (Todd, 2009)*). Hydrographs for NCMA sentry wells (Figures 11 and 12) show coastal groundwater elevations that were at relatively low levels for as long as 2 years. Such sustained low levels had not occurred previously in the historical record and reflected the impact of drought on groundwater levels. The low coastal groundwater levels indicated a potential for seawater intrusion.

Elevated concentrations of TDS, chloride, and sodium were observed in wells 30N03 and 30N02 beginning in May 2009, indicating potential seawater intrusion (Figures 27 and 28). (MW-Blue well also showed elevated concentrations of TDS and chlorides, but a concomitant decline in sodium.) Concentrations declined to historical levels in well 30N03 by July 2010, and declined in well 30N02 (one of the sentry wells comprising the Deep Well Index) to historical levels by October 2009. Comparing well 30N02 to the other deep index wells, the other deep index wells showed no elevated concentrations during the same time period. However, comparing well 30N02 to wells with similar screen elevations (Figure 7), wells 36L01 (approximately 11,950 feet south of well 30N02) and the MW-Blue well (approximately 3,300 feet east-southeast of well 30N02) suggested that seawater intrusion perhaps progressed eastward as far as the MW-Blue well, but not as far south as well 36L01 (Figure 28). While the TDS and chloride concentrations were elevated from August 2009 to July 2011 in the MW-Blue well, the sodium concentrations remained within historical levels. During the same time period, TDS, chloride, and sodium concentrations remained within historical levels in well 36L01. The well cluster at 32S/13E 30N may be relatively prone to seawater intrusion because of the location near the more permeable sediments deposited by the ancestral Arroyo Creek (NCMA 2009 Annual Monitoring Report) and the lower groundwater elevations typical to the east (Figures 8 and 9).

During 2017, there were no indications of seawater intrusion.

6.1.3 Measures to Avoid Seawater Intrusion

In recognition of the risk of seawater intrusion, the NCMA agencies have developed and implemented a water quality monitoring program for the sentry wells and OCSD observation wells. The NCMA agencies, FCWCD, and the State of California also have worked cooperatively toward the protection of the sentry wells as long-term monitoring sites. Several measures are employed by the NCMA agencies to reduce the potential for seawater intrusion. Specifically, the NCMA agencies have voluntarily reduced coastal groundwater pumping, decreased overall water use via conservation, and initiated plans, studies, and institutional arrangements to secure additional surface water supplies. As a result, each of the four major municipal water users reduced groundwater use between 25 and 95 percent during the past several years. In 2017, municipal groundwater use was 797 AF, which constitutes 18 percent of the urban user's groundwater allotment (including agricultural conversion credits) of the basin safe yield (Table 7).

Central Coast Blue is a regional recycled water project that includes advanced treatment of water from Pismo Beach's and South San Luis Obispo County's (SSLOCSD) wastewater treatment plants and injection into the SMGB to reduce the risk of seawater intrusion and improve water supply sustainability for the region. Tasks related to the development of the project that were performed prior to and throughout 2017 include plant design and upgrade, pilot plant development and testing, funding appropriation, and groundwater modeling.

Reduced groundwater recharge, whether it is from drought or reduction of subsurface inflow from the north and east, reduces subsurface outflow to the ocean and increases the potential threat of seawater intrusion.

6.2 Threats to State Water Project Supply

Both extended drought and long-term reduction in snowpack from climate change can affect SWP deliveries. Despite the predictions of a strong El Niño hydrologic year in 2016, the rainfall patterns in the central coast of California did not result in the "drought-buster" that was hoped to pull California from the impacts of the recent 5-year severe drought. However, rainfall in March/April, and again in November/December of 2016 in the SWP source area resulted in storage capacity levels of the state's two largest reservoirs, Lake Shasta and Lake Oroville, at 73 and 56 percent capacity, respectively, as of the start of 2017.

Leading into 2018, rainfall during the last 8 months of 2017 resulted in 0.62 inches of rain. The initial allocation announcement by DWR, announced on November 29, 2017, informed SWP contractors that their 2018 allocation would be 15 percent of requests for deliveries. The Table A allocation was subsequently increased on January 29, 2018 to 20 percent. As the winter rainfall season progresses, the allocations often increase by March or April. The last 100 percent allocation—difficult to achieve even in wet years largely because of Delta pumping restrictions to protect threatened and endangered fish species—was in 2006.

The immediate threat of allocation reductions to Pismo Beach and OCSD (the only SWP contractors in the NCMA) has not significantly materialized during the past several years, as the FCWCD's excess SWP entitlement provides a buffer, in addition to the agency's drought buffer, so that contracted volumes to water purveyors, such as the OCSD and Pismo Beach, still may be

provided in full. However, the SWP supply has the potential to be affected by drought as well as environmental issues, particularly involving the Delta smelt in the Sacramento-San Joaquin Delta.

6.3 Threats to Lopez Lake Water Supply

Extended drought conditions in recent years have contributed to record low water levels in Lopez Lake and impacts of climate change may affect future precipitation amounts in the Lopez Creek watershed. As discussed in Section 4.1.1, the Zone 3 agencies developed and implemented the LRRP in response to reduced water in storage in the lake. The LRRP is intended to reduce municipal diversions and downstream releases as water levels drop in order to preserve water within the reservoir for an extended drought. The relatively heavy rainfall of late 2016 and early 2017 created hope that the drought of 2012 to 2016 had ended; however, the rainfall year of 2016-17 started out as the driest year in record. A relatively wet March, 2018 increased the 2017-18 rainfall totals to the area to approximately 60 percent of normal, which would still constitute a continuation of the long-term drought. If drought conditions continue, even with reduced diversions and releases, water from Lopez Lake may be unavailable, or at least significantly reduced, to the Zone 3 agencies. Without access to water from Lopez Lake, the NCMA agencies and local agriculture stakeholders may be forced to rely more heavily on their groundwater supplies and increase pumping during extended drought conditions, which could result in lowering water levels in the aquifer and an increased threat from seawater intrusion. Moreover, a reduction in downstream releases from the reservoir, as mandated by the LRRP, likely will lead to reduced recharge to the NCMA portion of the SMGB and further contribute to declining groundwater levels.

7. Management Activities

The NCMA and overlying private well users have actively managed surface water and groundwater resources in the NCMA agencies area for more than 30 years. Management objectives and responsibilities were first established in the 1983 “Gentlemen’s Agreement,” recognized in the 2001 Groundwater Management Agreement, and affirmed in the 2002 Settlement Agreement. The responsibility and authority of the Northern Parties for NCMA groundwater management was formally established through the 2002 Settlement Agreement, Stipulation, and Judgment After Trial. Throughout the long history of collaborative management, which was formalized through the Agreement, Stipulation, and Judgment, the overall management goal for the NCMA agencies is to preserve the long-term integrity of water supplies in the NCMA portion of the SMGB.

7.1 Management Objectives

Eight basic Water Management Objectives have been established for ongoing NCMA groundwater management:

1. Share Groundwater Resources and Manage Pumping
2. Enhance Management of NCMA Groundwater
3. Monitor Supply and Demand and Share Information
4. Manage Groundwater Levels and Prevent Seawater Intrusion
5. Protect Groundwater Quality
6. Manage Cooperatively
7. Encourage Water Conservation
8. Evaluate Alternative Sources of Supply

Each of these objectives is discussed in the following sections. Under each objective, the NCMA TG has identified strategies to meet the objectives. These strategies are listed and then discussed under each of the eight objectives listed below. Other potential objectives are outlined in the final section.

A major management undertaking of the NCMA TG was the development in 2014 of a Strategic Plan (WSC, 2014) to provide the NCMA with:

1. A mission statement to guide ongoing and future initiatives as well as capture the requirements outlined in the Gentlemen’s Agreement, the Settlement Agreement, and the Stipulation. The mission statement said:

Preserve and enhance the *sustainability* of water supplies for the Northern Cities Area by:

- **Enhancing supply *reliability***
- **Protecting water *quality***
- **Maintaining *cost-effective* water supplies**
- **Advancing the legacy of *cooperative* water resources management**

2. A framework for communicating water resource goals
3. A formalized Work Plan for the next 10 years

Through the strategic planning process, the NCMA TG identified several key strategic objectives to guide its efforts. These efforts include:

A. Enhance Water Supply Reliability

- Prepare the NCMA agencies for prolonged drought conditions.
- Develop a coordinated response plan for seawater intrusion and other supply emergencies.
- Analyze impacts of pumping on the groundwater basin.
- Better protect against threats to groundwater sustainability.

B. Improve Water Resource Management

- Update the 2001 Groundwater Management Agreement.
- Develop more formalized structure/governance for the NCMA TG.

C. Increase Effective Outreach

- Engage agriculture stakeholders.
- Improve coordination with FCWCD and other regional efforts.
- Increase communication with various City Councils and Boards of Directors.

The Strategic Plan formalized many of the water resource management projects, programs, and planning efforts that the NCMA agencies, both individually and jointly, have been engaged in that address water supply and demand issues, particularly with respect to efforts to ensure a long-term sustainable supply. The following section discusses the major management activities that the NCMA agencies have pursued during 2017 that incorporate the planning objectives outlined in the 2014 Strategic Plan.

In January 2015, the NCMA agencies developed a Water Supply, Production and Delivery Plan (WSPDP) that applies the strategic objectives to the various supplies available to the area. The NCMA area receives supplies from Lopez Lake, the SWP, and the underlying groundwater basin.

The purpose of the FY 2014/15 Water Supply, Production and Delivery Plan is to provide the NCMA agencies with a delivery plan that optimizes use of existing infrastructure and minimizes groundwater pumping from the SMGB. The plan includes the development of a water supply and delivery modeling tool for the NCMA agencies, evaluation of three delivery scenarios, and development of recommendations for water delivery for FY 2014/15.

The WSPDP made recommendations that were implemented or subject to further study. These recommendations are summarized in subsequent sections, and include:

- Continue ongoing water conservation efforts to limit demand and make additional supply available for potentially future dry years.
- Immediately implement the strategies identified in Scenario 1 Baseline Delivery to minimize SMGB groundwater pumping in the near term.

These recommendations reinforce the ongoing management efforts by the NCMA and provide potential projects to improve water supply reliability and protect water quality during the ongoing drought. Ongoing work to implement the recommendations includes evaluation of additional delivery facilities to add operational flexibility to ensure optimum use of all supplies.

Implementing the WSPDP has allowed the NCMA to minimize the use of groundwater thereby protecting against seawater intrusion while meeting the needs of its customers and other water users in the basin.

The NCMA agencies, in conjunction with the other Zone 3 agencies and the FCWCD, continue efforts to evaluate and implement potential drought emergency options. This initiative includes identification, evaluation, and ranking of potential options available to Zone 3 to improve the reliability of its water supplies. This evaluation of options was completed by the Zone 3 Technical Advisory Committee and presented to the Zone 3 Advisory Committee and the County Board of Supervisors (BOS). As a result of these efforts, the Zone 3 agencies and the County have pledged to work collaboratively together to continue to evaluate and implement emergency water supply reliability options as required in conditions of extended drought. Potential options that the Zone 3 agencies have evaluated in the past few years include:

Zone 3 Extended Drought Emergency Options:

- **Cloud Seeding.** Investigate opportunities to use cloud seeding to enhance rainfall in the Lopez Watershed. This could involve a cooperative agreement with the County.
- **State Water Project.** Maximize importation of FCWCD SWP supplies, including subcontractor and “Excess Entitlement” supplies.
 - Evaluate delivery of SWP water to non-SWP subcontractors under emergency provisions (e.g., Arroyo Grande, Grover Beach, etc.).
- **Unsubscribed Nacimiento Water Project (NWP) Water.** Investigate transfer/exchange opportunities to obtain unsubscribed NWP water for the Zone 3 agencies (i.e., exchange agreements with the City of San Luis Obispo and the Chorro Valley pipeline SWP subcontractors).
- **Water Market Purchases.** Investigate opportunities to obtain additional imported water and deliver it to the Zone 3 agencies through the SWP infrastructure (e.g., exchange agreements with San Joaquin/Sacramento Valley farmers, water broker consultation, groundwater banking exchange agreements, etc.).
- **Morro Bay Desalination Plant Exchanges.** Investigate opportunities to obtain SWP water from Morro Bay by providing incentives for Morro Bay to fully utilize its desalination plant capacity.
- **Land Fallowing.** Evaluate potential agreements with local agriculture representatives to offer financial incentives to fallow land within the Arroyo Grande and Cienega Valleys and make that water available for municipal use.
- **Enhanced Conservation.** Evaluate opportunities for enhanced water conservation by the Zone 3 agencies beyond the Governor’s Mandatory Water Conservation Order (e.g., water

rationing, no outdoor watering, agriculture water restrictions, etc.) to preserve additional water.

- **Nacimiento/California Men's Colony Intertie.** Complete design of a pipeline that would connect the NWP pipeline to the California Men's Colony (CMC) Water Treatment Plant. Investigate opportunities for Zone 3 agencies to purchase NWP water and use exchange agreements and existing infrastructure to deliver additional water to Zone 3 through the Coastal Branch pipeline.

7.1.1 Share Groundwater Resources and Manage Pumping

Strategies:

- Continued reduction of groundwater pumping, maintain below safe yield.
- Coordinated delivery of Lopez Lake water to the maximum amount available, pursuant to the Lopez Lake LRRP.
- Continue to import SWP supplies to OCSD and Pismo Beach.
- Maintain surface water delivery infrastructure to maximize capacity.
- Utilize Lopez Lake to store additional SWP water within San Luis Obispo County

Discussion:

A longstanding objective of water users in the NCMA has been to cooperatively share and manage groundwater resources. In 1983, the Northern Parties (including water users in the NCMA area) mutually agreed on an initial safe yield estimate and an allotment of pumping between the urban users and agricultural irrigation users of 57 percent and 43 percent, respectively. In this agreement, the NCMA agencies also established pumping allotments among themselves. Subsequently, the 2001 Groundwater Management Agreement included provisions to account for changes such as agricultural land conversions. The agreements provide that any change in the accepted safe yield based on ongoing assessments would be shared on a pro rata basis. Pursuant to the stipulation, the NCMA agencies conducted a water balance study to update the safe yield estimate (Todd, 2007). As a result, the NCMA agencies agreed to maintain the existing pumping allotment among the urban users and established a consistent methodology to address agricultural land use conversion.

In addition to cooperatively sharing and managing groundwater resources, the NCMA agencies have coordinated delivery of water from Lopez Lake. At the same time, Pismo Beach and OCSD have continued to import SWP water. Both actions maximize use of available surface water supplies. In 2016, in response to the ongoing drought at that time and the threat of diminishing water supplies, Arroyo Grande approved a measure authorizing the City to purchase SWP water from the FCWCD's excess allotment on a temporary basis and only during a declared local water emergency; that condition was not reached in 2017 and Arroyo Grande did not purchase SWP water.

The WSPDP now provides a framework for the NCMA, as a whole, to actively and effectively manage the groundwater resource, particularly in years of below normal rainfall and below “normal” SWP delivery schedules. The WSPDP outlined a strategy to provide sufficient supplies to NCMA water users in instances of reduced SWP delivery. Specifically, in 2017, municipal groundwater pumpage at 797 AF was less than any year during the 19-year period from 1999 through 2017 (inclusive).

Many aspects of the NCMA’s water management strategy that shifted direction in 2014 as a result of the severity of the 2012-16 drought continued into 2017. Adoption of the LRRP by FCWCD resulted in the implementation of the first stage of LRRP reduction triggers, which protect the Lopez Lake from running dry in any single year while providing flows for habitat protection in Arroyo Grande Creek. Although the drought emergency was lifted, the Zone 3 agencies continued operating under the LRRP throughout 2017, until there is some assurance that the drought is truly relieved. In addition, the NCMA agencies have increased conservation efforts even more than in previous years to adequately and safely manage the water resource (additional discussion in Section 7.1.7).

Seawater intrusion is the most important potential adverse impact for the NCMA agencies to consider in their efforts to effectively manage the basin. Seawater intrusion, a concern since the 1960s, would degrade the quality of water in the aquifer and potentially render portions of the basin unsuitable for groundwater production (DWR, 1970). A Deep Well Index of the three primary deep sentry wells of 7.5 feet (NAVD 88) has been recognized as the index, above which it is thought that there is sufficient fresh water (groundwater) outflow to prevent seawater intrusion. From late 2009 to April 2013, the NCMA agencies’ management of groundwater levels and groundwater pumpage maintained the sentry well index above the 7.5-foot level. However, for several weeks in April and May 2013, from early July through mid-December 2013, and from mid-April 2014 through mid-December 2014, the index value dropped below the target. In 2015, the index value was above the Deep Well Index threshold from January through February; however, the index remained below the target level from March through December 2015, generally between 4 and 7 feet below the 7.5-foot target.

Similarly, in 2016, the Deep Well Index started the year above the threshold value, with an index value of 9.18 in January. By mid-May the index value dropped below the 7.5-foot index level. Between mid-May and October 2016, the Deep Well Index remained below the index threshold value, reaching an index value of 5.64 feet in October. In late October 2016, the Deep Well Index began to rise and in mid-December 2016, the index value has been above the threshold value.

Except for a very brief period between August 18 and August 29, 2017, when the agencies were forced to increase groundwater pumping due to a maintenance shutdown of the Lopez Lake water supply, the Deep Well Index remained above the 7.5-foot threshold value throughout the entirety of 2017.

Another potential adverse impact of localized pumping includes reduction of flow in local streams, notably Arroyo Grande Creek (Todd, 2007). The NCMA agencies (as Zone 3 contractors) have participated with FCWCD in preparation of the Arroyo Grande Creek Habitat Conservation Plan (HCP) that addresses reservoir releases to maintain both groundwater levels and habitat diversity in the creek. The FCWCD contracted with ECORP Consulting in 2015 to conduct the additional

hydraulic studies to finalize the HCP. The work continued throughout 2017; the scheduled completion of the HCP is not certain.

7.1.2 Enhance Management of NCMA Groundwater

Strategies:

- Develop a groundwater model for the NCMA/NMMA or the entire SMGB.
- Coordinate with the County and NMMA to develop new monitoring well(s) in key locations within the SMGB.
- Develop a Salt and Nutrient Management Plan (SNMP) for the NCMA/NMMA.
- Develop and implement a framework for groundwater storage/conjunctive use, including return flows.
- Update the 2001 Agreement Regarding Management of the Arroyo Groundwater Basin, approved in 2002.

Discussion:

The NCMA agencies participated in the oversight of the performance of the SMGB characterization study (Fugro, 2015), which was finalized with the distribution of the complete datasets in March 2016. The project was conducted as part of the County IRWMP 2014 updated, in part to prepare for and to provide the foundational data for development of a numerical groundwater flow model and preparation of a basin-wide SNMP. To date, the SNMP has not been initiated, but significant progress was made in 2017 toward development of a numerical groundwater flow model, associated with a recycled water project referred to as Central Coast Blue (formerly referred to as the Regional Groundwater Sustainability Project). The intent of Central Coast Blue is to enable Pismo Beach and the South San Luis Obispo County Sanitation District (SSLOCSD) to construct an Advanced Treatment Facility (ATF) to produce Advanced Purified Water (APW) to augment its water supply through injection to recharge the groundwater basin and provide a new, drought-proof, source of water supply for the area. As part of Central Coast Blue planning and technical studies, a localized groundwater flow model (the Phase 1A model) was developed for the northern portion of the NCMA that evaluated the concept of injecting APW into the SMGB to increase the recharge to the basin, improve water supply reliability and help prevent future occurrences of seawater intrusion.

Based on the results of the Phase 1A model and through funding by SSLOCSD Supplemental Environmental Program (SEP), work was initiated in 2017 for development of the Phase 1B groundwater flow model. The model domain of the Phase 1B model covers the entire NCMA, NMMA, and the portion of the SMVMA north of the Santa Maria River. The purpose of the model is to evaluate groundwater injection and extraction scenarios to support Central Coast Blue. It will be utilized to identify the locations of the proposed injection wells, quantify the amount of water that can be injected, evaluate strategies for preventing seawater intrusion, and develop estimates of the overall yield that the Central Coast Blue stakeholders will be able to receive from the project. This modeling work is expected to be completed in mid-2018.

As part of the FCWCD's SMGB characterization study (Fugro, 2015), continuous monitoring transducers were installed in 2015 in coastal sentry wells 36L01 and 36L02 (which are part of the

NCMA monitoring program) and in wells 11N/36W-12C01 and 11N/36W-12C02. As a result, continuous water level and field-parameter water quality data were collected from these wells throughout 2017.

The monthly NCMA TG meetings provide for collaborative development of joint budget proposals for studies and plans, and shared water resources. In addition, the monthly meetings provide a forum for discussing the data collected as part of the quarterly monitoring reports.

7.1.3 Monitor Supply and Demand and Share Information

Strategies:

- Develop coordinated Urban Water Management Plans (UWMPs) for the NCMA agencies.
- Develop a coordinated Water Shortage Contingency Plan to respond to a severe water shortage condition in the NCMA.
- Share groundwater pumping data at monthly NCMA TG meetings.
- Evaluate future water demands through comparison to UWMP projections:
 - Arroyo Grande 2015 UWMP (revised and updated, January 2017)
 - Pismo Beach 2015 UWMP (June 2016)
 - Grover Beach 2010 UWMP
 - OCSD is not required to prepare an UWMP because the community population does not meet the minimum requirement threshold.

Discussion:

Pismo Beach and Arroyo Grande prepared updated UWMPs in 2016 and 2017, respectively. OCSD is not required to prepare an UWMP because the community population does not meet the minimum requirement threshold; however, many of the aspects of a UWMP are addressed through participation in the NCMA planning process.

Regular monitoring of activities that affect the groundwater basin, and sharing that information, have occurred for many years. The monitoring efforts include gathering data on hydrologic conditions, water supply and demand, and groundwater pumping, levels, and quality. The current monitoring program is managed by the NCMA agencies in accordance with the Stipulation and the Judgment, guided by the July 2008 Monitoring Program for the NCMA. The monitoring data and a summary of groundwater management activities are summarized in the Annual Reports. Arroyo Grande, Grover Beach, and Pismo Beach each have evaluated their future water demands as part of their respective 2010 UWMPs and 2015 UWMP updates. The NCMA shares information with the two other management areas (NMMA and SMVMA) through data exchange and regular meetings throughout the Annual Report preparation cycle.

Management activities have become more closely coordinated among the NCMA agencies as a result of the 2012-16 drought. In particular, the NCMA agencies implemented the LRRP to limit municipal diversions and downstream releases from Lopez Reservoir to ensure that water is available for future potentially dry years. In addition, the Zone 3 agencies (which include the

NCMA TG) initiated a long-term drought planning effort. The planning effort is intended to plan water supplies for periods of extended drought conditions.

7.1.4 Manage Groundwater Levels and Prevent Seawater Intrusion

Strategies:

- Use stormwater ponds to capture stormwater runoff and recharge the groundwater basin.
- Install transducers in key monitoring wells to provide continuous groundwater elevation data; the following wells have transducers:
 - 24B03
 - 30F03
 - 30N02
 - 36L01
 - 36L02
 - 32C03 (County Monitoring Well No. 3)
- Collect and evaluate daily municipal pumping data to determine the impact on local groundwater elevation levels.

Discussion:

Prevention of seawater intrusion through the management of groundwater levels is essential to protect the shared resource. The NCMA agencies increase groundwater recharge with stormwater infiltration and closely monitoring groundwater levels and water quality in sentry wells along the coast.

Arroyo Grande and Grover Beach each maintain stormwater retention ponds within their jurisdiction; the FCWCD maintains the stormwater system, including retention ponds, in OCSD. These ponds collect stormwater runoff, allowing it to recharge the underlying aquifers. There are approximately 140 acres of detention ponds in Arroyo Grande and 48 acres of detention ponds in Grover Beach. The stormwater detention pond in OCSD is approximately one-half acre. Grover Beach modified its stormwater system in 2012 to direct additional flow into one of its recharge basins.

Although closely related to the objectives to manage pumping, monitor supply and demand, and share information, this objective also specifically recognizes the proximity of production wells to the coast and the threat of seawater intrusion. The NCMA agencies and FCWCD have long cooperated in the monitoring of groundwater levels, including quarterly measurement by the NCMA of groundwater levels in sentry wells at the coast. Upon assuming responsibility for the coastal monitoring wells, the NCMA became aware of the need to upgrade their condition. In July 2010 the wellheads (surface completions) at four sentry monitoring well clusters in the NCMA were renovated:

- 24B01, -B02, and -B03
- 30F01, -F02, and -F03

- 30N01, -N02, and -N03
- 36L01 and -L02

The renovations included raising the elevations of the top of each individual well casing by 2 to 3 feet and resurveying relative to the NAVD88 standard in late September 2010 (Wallace Group, 2010). The individual well casings are now above the ground surface and protective locking steel risers enclose each cluster. As a result of this work, the sentry wells in the NCMA now are protected from surface contamination and tampering.

Quarterly measurement of groundwater levels aids in assessing the risk of seawater intrusion along the coast. To enhance the data collection and assessment efforts, the NCMA installed transducers in five of the key sentry monitoring wells to provide continuous groundwater levels at key locations. By combining this with the collection and evaluation of daily municipal pumping data, the NCMA is better able to determine the response of local groundwater levels to extractions and, therefore, better manage the basin.

To gain insight into water level fluctuation and water quality variation in the area between the NCMA and NMMA, a continuous monitor was installed in well 32C03 (County Well No. 3), which was constructed and is owned by the County as part of the County-wide groundwater monitoring network. Water level monitoring was initiated in April 2012, when sensors were installed to document water level, temperature, and specific conductivity.

In 2015, continuous monitoring sensors were installed in coastal monitoring wells 36L01 and 36L02 located in the Oceano Dunes. Data from the transducers in these wells now are collected on a quarterly basis along with the other sentry wells.

Additional studies to enhance basin management efforts that have been discussed by the NCMA TG include:

- Consider implementation of a monthly water level elevation data analysis of the sentry wells during periods when the Deep Well Index value is below the index target of 7.5 feet NAVD88 for an extended period of time. Given that the index generally has remained steady because of reduced groundwater pumping, the NCMA has deferred the issue of monthly analysis.
- Consider implementation of a monthly analysis of electrical conductivity data from the wells with downhole transducers during periods when the Deep Well Index value is below the index target of 7.5 feet to track potential water quality degradation (an enhanced monitoring schedule of County Well No. 3 is not necessary because background water quality does not change or fluctuate significantly). If electrical conductivity data suggest water quality degradation, implement a monthly sampling and monitoring program. Given that the index generally has remained steady because of reductions in groundwater pumping, the NCMA has deferred the issue of monthly analysis.
- Assess the potential impacts on sentry well water level elevations from extended periods of increased groundwater pumping by conducting analytical modeling analyses to predict water level responses given certain pumping scenarios. These analyses may prove fruitful as scenarios unfold regarding decreased SWP deliveries or short-term emergency cuts to

Lopez Lake deliveries. Utilization of the Phase 1B model, in preparation in 2017 in support of Central Coast Blue, may be used for the purpose in 2018 and beyond.

- The 2005 Stipulation requires Nipomo Community Services District (NCSD) and the other NMMA parties to develop a Nipomo Supplemental Water Project (NSWP) to import a minimum of 2,500 AFY to mitigate overpumping that may impact groundwater inflow to the NCMA, and thus may facilitate seawater intrusion in both NCMA and NMMA. On July 2, 2015, the NCSD began taking deliveries of SWP from the City of Santa Maria. The NSWP is designed to deliver 3,000 AFY, however current deliveries are about 800 AFY. The additional stages of the NSWP and funding sources to implement the project to allow increased water delivery to meet the requirements of the Judgment are being planned; full implementation of the project is apparently planned for 2025-26.

7.1.5 Protect Groundwater Quality

Strategies:

- Perform quarterly water quality monitoring at all sentry wells and County Well No. 3.
- Gather temperature and electrical conductivity data from monitoring wells to continuously track water quality indicators for seawater intrusion.
- Prepare an SNMP pursuant to state policy using the results of the SMGB characterization study (Fugro, 2015).
- Construct a recycled water system in Pismo Beach, pursuant to the results of Pismo Beach's Recycled Water Facilities Planning Study (RWFPS), completed in 2015 (WSC, 2015) and Central Coast Blue.
- Support regional recycled water project planning through performance of a RWFPS by the South San Luis Obispo County Sanitation District. The RWFPS was completed in 2017.

Discussion:

The objective to protect groundwater quality is closely linked with the objective for monitoring and data sharing. To meet this objective all sources of water quality degradation, including the threat of seawater intrusion, need to be recognized. Water quality threats and possible degradation affect the integrity of the groundwater basin, potentially resulting in loss of use or the need for expensive water treatment processes. Sentry wells are monitored quarterly and data from other NCMA production wells are assessed annually. The monitoring program includes evaluation of potential contaminants in addition to those that might indicate seawater intrusion. Temperature and electrical conductivity probes have been installed in five monitoring wells to provide continuous water quality tracking for early indication of seawater intrusion. A sixth sentry well cluster (36L) in the Oceano Dunes was instrumented in April 2015 as part of the SMGB characterization study (Fugro, 2015). The results of the SMGB characterization study provide the foundation for preparation of an SNMP.

Investigations continued throughout 2017 for work associated with Pismo Beach's Central Coast Blue project. These efforts followed up on Pismo Beach's RWFPS to investigate alternatives for constructing a recycled water system that will enable the NCMA agencies to beneficially use recycled water to augment their groundwater supply and provide a new, drought-proof source of

water supply for the area. Engineering was performed throughout 2017, and the environmental review process was initiated along with development of the groundwater flow model.

7.1.6 Manage Cooperatively

Strategies:

- Improve agriculture outreach by enhancing coordination with local growers.
- Coordinate groundwater monitoring data sharing and annual report preparation with the NCMA, NMMA, and the SMVMA.
- Improve interagency coordination among the NCMA agencies and include the County.

Discussion:

Since 1983, NCMA management has been based on cooperative efforts of the affected parties, including the NCMA agencies, private agricultural groundwater users, the County, the FCWCD, and other local and state agencies. Specifically, the NCMA agencies have limited their pumping and, in cooperation with FCWCD, invested in surface water supplies so as to not exceed the safe yield of the NCMA portion of the SMGB. Other organizations participate, as appropriate. In addition to the efforts discussed in this 2017 Annual Report, cooperative management occurs through many other venues and forums, including communication by the NCMA agencies in their respective public meetings and participation in the Water Resources Advisory Council (the County-wide advisory panel on water issues).

The NCMA agencies participated in preparation and adoption of the 2014 update of the County IRWMP. The IRWMP promotes integrated regional water management to ensure sustainable water uses, reliable water supplies, better water quality, environmental stewardship, efficient urban development, protection of agriculture, and a strong economy. The IRWMP integrates all of the programs, plans, and projects within the region into water supply, water quality, ecosystem preservation and restoration, groundwater monitoring and management, and flood management programs.

Since the Judgment, the NCMA has taken the lead in cooperative management of its management area. The NCMA TG met monthly throughout 2017 and has been a willing and active participant in the SMGBMA technical subcommittee, which first met in 2009 (the SMGBMA technical subcommittee did not meet in 2017). The purpose of the SMGBMA technical subcommittee is to coordinate efforts among the management areas, such as enhanced monitoring of groundwater levels and improved sharing of data. With the current threats to water supply in all management areas, greater communication, analytical collaboration, and data sharing, especially between NCMA and NMMA, are encouraged.

An outcome of actions initiated by NCMA in early 2016 resulted in several activities of increased discussion and collaboration between the NCMA and NMMA throughout 2017. The NCMA-NMMA Management Coordination Committee met four times in 2017 to discuss items of mutual concern and develop strategies for addressing the concerns.

Another area of increased mutual collaboration between the NCMA and NMMA was the formation of a technical team, consisting of representatives from the NCMA and NMMA, to collaboratively develop a single data set of water level data points to prepare a consistent set of semiannual

water level contour maps for the NCMA and NMMA, so that the maps from each management area would represent a mutually agreed upon condition at the NCMA/NMMA boundary. This collaboration continued throughout 2017.

A third initiative was to create a Modeling Subcommittee, composed of a select set of representatives from the NCMA and NMMA, to discuss the feasibility and possible work scope for the development of a numerical groundwater flow model of the SMGB, or at least that portion of the basin north of the Santa Maria River. When the Phase 1B groundwater flow model project was initiated in 2017, representatives from this subcommittee formed a technical review and advisory committee to provide input to the modeling consultant and monitor progress.

7.1.7 Encourage Water Conservation

Strategies:

- Share updated water conservation information.
- Implement UWMPs.

Discussion:

Water conservation, or water use efficiency, is linked to the monitoring of supply and demand and the management of pumping. Water conservation reduces overall demand on all sources, including groundwater, and supports management objectives to manage groundwater levels and prevent seawater intrusion. In addition, water conservation is consistent with state policies seeking to achieve a 20 percent reduction in water use by the year 2020. Water conservation activities in the NCMA are summarized in various documents produced by the NCMA agencies, including the 2015 Urban Water Management Plans (UWMP) of Arroyo Grande and Pismo Beach and the 2010 UWMP of Grover Beach. OCSD is not required to prepare an UWMP.

In addition to ongoing water conservation efforts, the drought conditions that extended throughout 2016 led the NCMA agencies to increase their effort to reduce water use. The statewide mandatory water conservation requirements, signed into law on April 1, 2015, by the governor (Executive Order B-29-15), which enacted mandatory water conservation requirements because of the ongoing drought conditions and the historic low Sierra snowpack measurements, were continued throughout 2016 and into early 2017. On April 7, 2017, the State of California took action to lift the drought emergency and State mandated water use restrictions throughout the state.

The water conservation measures instituted by each NCMA agency are summarized below.

Arroyo Grande

On April 7, 2017, the State of California took action to lift the drought emergency and State mandated water use restrictions throughout the state. The action also eliminated the State's mandate for Arroyo Grande to save 28 percent of its water use. In response, the Arroyo Grande City Council approved and adopted a resolution in May 2017 rescinding the Stage 1 Water Shortage Emergency in the City, which removes temporary water use limitations that established individualized water budgets for all residential customers. During the State-mandated Stage 1 restrictions, Arroyo Grande water use reduction was on average 42% compared to 2013, thereby meeting and exceeding the State mandates.

The City Council's action was based on a determination that there is no immediate or imminent threat to the City's ability to meet the community's water supply needs. However, all established mandatory water use restrictions remained in effect, including limitations on outdoor irrigation and continued adherence to four-day outdoor irrigation based on the property address.

Mandatory water conservation measures include:

- Use of water that results in excessive gutter runoff is prohibited.
- No water will be used for cleaning driveways, patios, parking lots, sidewalks, streets, or other such use except where necessary to protect the public health and safety.
- Outdoor water use for washing vehicles will be attended and have hand-controlled water devices.
- Outdoor irrigation is prohibited between 10 a.m. and 4 p.m.
- Irrigation of private and public landscaping, turf areas, and gardens is permitted at even-numbered addresses only on Mondays and Thursdays, and at odd-numbered addresses only on Tuesdays and Fridays.
- No irrigation of private and public landscaping, turf areas, and gardens is permitted on Wednesdays. Irrigation is permitted at all addresses on Saturdays and Sundays.
- In all cases, customers are directed to use no more water than necessary to maintain landscaping.
- Emptying and refilling swimming pools and commercial spas are prohibited except to prevent structural damage and/or to provide for the public health and safety.
- New swimming pools may be constructed, however, they will have a cover that conforms to the size and shape of the pool and acts as an effective barrier to evaporation. The cover must be in place during periods when use of the pool is not reasonably expected to occur.
- Use of potable water for soil compaction or dust control purposes in construction activities is prohibited.
- Hotel, motel, or other commercial lodging establishments will offer their patrons the option to forego the daily laundering of towels, sheets, and other linens.
- Restaurants or other commercial food service establishments will not serve water except upon the request of a patron.
- The City may impose fines for violation of mandatory conservation measures. Customers who received a financial penalty may have their penalty waived if they attend a 2-hour water conservation class.

In addition to the mandatory water conservation measures outlined above, the Water Shortage Emergency resolution included a tiered billing system, whereby residential customers were assigned a baseline amount of water, based on the amount of water used during the billing period of 2013. Residential customers in Tier 1 then were required to reduce consumption by 10 percent, customers in Tier 2 were required to reduce consumption by 20 percent, and customers in Tier 3 were required to reduce consumption by 30 percent.

To help manage the use of water, the City offers several water conservation incentive programs designed to decrease overall water use, particularly outside (irrigation) use in the summer. The conservation and incentive programs include:

- **Plumbing Retrofit Program.** This program includes installation or adjustment of showerheads, toilets, faucet aerators, and pressure regulators for single-family and multi-family residential units constructed before 1992. This program has been in place since 2004 at an expense to the City of more than \$1.55 million.
- **Cash for Grass.** Because of its popularity and limited funding, this program was suspended.
- **StormRewards Program.** This rebate program (administered by Coastal San Luis Resource Conservation District) provides an incentive for landowners to install rain gardens, rain barrels, dry wells, and porous pavement, and to remove impervious pavement.
- **Sustainable Landscape Seminar Series.** This program offers monthly seminars on sustainable landscaping practices. DVDs of the seminars are available at the County library located at 800 West Branch Street in Arroyo Grande.
- **Smart Irrigation Controller and Sensor Program.** This program offers Smart Irrigation Controllers and Sensors at no charge to customers to encourage residents to upgrade their old irrigation controllers with new weather-based sensor technology.
- **Washing Machine Rebate.** This program pays water customers a one-time rebate for the installation of a certified energy efficient Tier 3 washing machine.
- **Mandatory Plumbing Retrofit.** Upon change of ownership of any residential property, the seller must retrofit the property's plumbing fixtures to meet defined low-water use criteria.

Pismo Beach

In 2014, Pismo Beach introduced the first-in-the-state waterless urinal mandate and a 0.5-gallon per minute (gpm) restroom aerator retrofit requirement. The components of this program includes:

- **Waterless urinal retrofits.** All existing urinals in the City will be retrofitted to waterless urinals before February 14, 2016. Exemptions to this section may be granted at the discretion of the City Engineer under certain conditions.
- **Faucet aerators.** Residential restroom construction will be fitted with aerators that emit no more than 0.5 gpm. Exemptions may be granted at the discretion of the City Engineer in cases to protect public health and safety. Restroom faucets in all publicly accessible restrooms, including those in hotel rooms, lobbies and restrooms, restaurants, schools, commercial and retail buildings, public buildings, and similar publicly accessible restrooms were retrofitted to install aerators that emit no more than 0.5 gpm.
- **Sub-meters in new construction.** All new multi-unit buildings, regardless of proposed use, will be required to have a separate sub-meter capable of measuring the water use of every usable unit, separate common space, and landscaping that is expected to use at least 25 gallons of water per day on average for the course of a year, regardless of the

overall size of the building. Buildings that have a separate water meter for each unit are exempt.

Also in 2014, Pismo Beach adopted several Water Conservation Incentive Programs to help reduce water consumption and ensure reliable future water supply. The programs include:

- **Cash for Grass.** This program reimburses residents for each square foot of lawn removed (minimum 300 square feet) and replaced with drought-tolerant landscaping, which is required to have drip or micro-spray irrigation and be on an automatic timer.
- **Free Catch Bucket Program.** This program gives residents one free shower catch bucket for capturing unused shower water and re-purposing it for irrigation or utility purposes.
- **Rain Barrel Rebate Program.** This program reimburses residents up to \$100 (\$50 per rain barrel) when up to two rain barrels are purchased and installed to use rain water, conserve potable water, and reduce stormwater runoff.
- **Washing Machine Rebate.** This program pays a one-time amount for the purchase and installation of a certified energy-efficient Tier 3 washing machine.
- **Smart Irrigation Controller Program.** This program pays a one-time amount toward the cost of a new irrigation controller and associated sensors.
- **Irrigation Retrofit Program.** This program provides a one-time rebate for conversion of a manually operated irrigation system to automatic irrigation.
- **Waterless Urinal Rebate Program.** This program provides a one-time rebate for each conventional flushing urinal that is replaced with a flushless urinal.
- **High Efficiency Toilet Rebate Program.** This program provides a one-time rebate for each 3.5-gallon per flush or higher toilet replaced with a 1.28-gallon per flush or lower toilet.

In January, 2017, Pismo Beach adopted an updated schedule of development impact fees to include new recycled water fees for all new development, redevelopment, and additions to existing buildings that create additional dwelling units or additional non-residential floor area, to help fund the cost of Central Coast Blue.

In June, 2017, in response to the State of California action to lift the drought emergency and State mandated water use restrictions throughout the state, Pismo Beach declared a “Normal Water Supply” and adopted an Urgency Ordinance O-2017-003, revising the restrictions associated with each water supply status to conform to State mandates. The restrictions for a Normal Water Supply include:

- Use of water which causes runoff onto adjacent properties, non-irrigated areas, private and public walkways, roadways, gutters, parking lots or structures is prohibited.
- Outdoor water use for washing vehicles, boats, paved surfaces, buildings, and similar uses shall be attended and have hand-controlled water devices, which shut off the water immediately when not in use.

- No water will be used for cleaning driveways, patios, parking lots, sidewalks, streets, or other such uses except as found necessary by the city to protect the public health or safety.
- Outdoor Irrigation.
 - Outdoor irrigation is prohibited between 10 a.m. and 4 p.m.
 - Applying water to outdoor landscapes during and within 48 hours following measurable precipitation is prohibited.
- Restaurants will serve drinking water only in response to a specific request by a customer.
- Using water in a fountain or other decorative water feature, except where the water is part of a recirculating system, is prohibited.

Grover Beach

In June 2014, Grover Beach declared a Stage III Water Shortage that required all water customers to reduce their water usage by 10 percent. Many of the prohibitions that had previously been voluntary since declaration of the Stage II Water Shortage Declaration became mandatory with the Stage III declaration. The declaration also provided the City with the authority to impose penalties for failure to comply with the water reduction or use prohibitions. The Stage III Water Shortage declaration, with associated prohibitions, continued throughout 2017. These prohibitions include:

- Washing of sidewalks, driveways, or roadways where air-blowers or sweeping provides a reasonable alternative.
- Refilling of private pools except to maintain water levels.
- Planting of turf and other new landscaping, unless it consists of drought-tolerant plants.
- Washing vehicles, boats, etc. without a quick-acting shut-off nozzle on the hose.
- Washing any exterior surfaces unless using a quick-acting shut-off nozzle on the hose.
- Restaurant water service, unless requested.
- Use of potable water for construction purposes, unless no other source of water or method can be used.
- Operation of ornamental fountain or car wash unless water is re-circulated.

Grover Beach has implemented demand management rebate programs including:

- Cash for Grass Rebate Program
- Smart Irrigation Controller and Sensor Rebate Program
- Toilet Fixtures, Showerheads, and Aerators Retrofit Rebate Program
- Washing Machine Rebate Program

Oceano CSD

Given the population of its service area, OCSD is not required to prepare an UWMP or reduce water consumption as mandated by the Governor for Urban Water Suppliers. Outdoor water use restrictions have been adopted, as required. In April 2015, OCSD adopted a rate increase that included tiered rates to promote water conservation; the conditions continued throughout 2017.

OCSD has essentially eliminated groundwater pumping (OCSD pumped 0.5 percent of its groundwater allotment), and is maintaining its annual allocation of Lopez Lake water in storage as allowed pursuant to the LRRP. Meanwhile, OCSD's conservation efforts continue to exceed the Governor's drought-mandated goal (since rescinded) of 25 percent. Overall consumption has declined to approximately 85 gallons per capita daily (gpcd) after the implementation of drought conservation rates, illustrating that as a disadvantaged community, it is responding effectively to conservation rates.

OCSD's demand is less than its annual allocation of SWP water, preserving local supplies if needed in subsequent years, depending on SWP deliveries. In the event that SWP deliveries are decreased to a level that is insufficient to meet OCSD demand, then mandatory conservation efforts will be implemented to match the available supply. If the supply is less than 55 gpcd needed to meet health and safety needs, then the supply shortfall will be supplemented from Lopez Lake supplies. Current SWP reliability analyses prepared by the DWR illustrate a low probability that SWP water will not be able to meet OCSD demands in any two consecutive years.

Additional strategies exist in the event of temporary non-delivery of SWP and Lopez Lake water and other unforeseen circumstances. Post-drought strategies include resumption of groundwater pumping, resumption of Lopez Lake deliveries, and storage of SWP water as provided in SWP contracts.

7.1.8 Evaluate Alternative Sources of Supply

Strategies:

- Evaluate expanded use of recycled water, including development and implementation of Central Coast Blue.
- Analyze capacity of the Lopez Lake and Coastal Branch pipelines to maximize deliveries of surface water. The following analyses have been completed:
 - Lopez Lake Pipeline Capacity Evaluation
 - Lopez Lake Pipeline Capacity Re-Evaluation
 - Coastal Branch Capacity Assessment
 - Lopez Bypass and State Water Delivery Evaluation
- Optimize existing surface water supplies, including surface water storage through the development of a framework for interagency exchanges and transfers, including SWP and Lopez Lake supplies.
- Maximize Lopez Lake pipeline capacity.

Discussion:

The NCMA agencies continue to evaluate alternative sources of water supply that could provide a more reliable and sustainable water supply for the NCMA. An expanded portfolio of water supply sources will support sustainable management of the groundwater resource and help to reduce the risk of water shortages. These alternative sources include:

- **State Water Project.** OCSD and Pismo Beach are currently SWP customers. Both agencies increased their SWP allocations by securing “drought buffers” to increase the availability of supply during periods of SWP shortfalls. Grover Beach and Arroyo Grande are not SWP customers; however, Arroyo Grande approved a measure in 2016 authorizing the City to purchase SWP water from the FCWCD’s excess allotment on a temporary basis and only during a declared local water emergency. To date, Arroyo Grande has not declared such an emergency and has not purchased SWP water.
- **Water Recycling.** As discussed in Section 7.1.5, Pismo Beach and the SSLOCSD both prepared RWFPSs to evaluate alternatives for a recycled water program that could provide a supplemental water supply source and improve the water supply reliability for the Pismo Beach and the SSLOCSD member agencies (Arroyo Grande, Grover Beach, and OCSD).

Section 7.1.5 also describes ongoing efforts for Central Coast Blue that will enable the NCMA agencies to produce recycled water to augment their water supplies. Construction of the new facility will allow for the use of recycled water to recharge the groundwater basin and provide a new, drought-proof source of water supply for the area. As conceived, the project includes construction of a distribution system that will inject advanced purified water into the SMGB and will allow the NCMA agencies to increase recharge to the basin, improve water supply reliability, and help to prevent future occurrences of seawater intrusion.

Lopez Lake Expansion. In 2008, the County sponsored a preliminary assessment of the concept of installing an inflatable rubber dam at the Lopez Dam spillway. Subsequently, the FCWCD Service Area 12 and Arroyo Grande, Grover Beach, and Pismo Beach funded a study to further analyze the feasibility of increasing the yield of Lopez Lake by raising the spillway height with an inflatable dam or permanent extension. The study was finalized in 2013 and identified the potential to increase the annual yield from Lopez Lake by 500 AFY with a spillway height increase by 6 feet (Stetson, 2013). The NCMA agencies are continuing to evaluate other aspects of the project, including pipeline capacity and impacts on the HCP process.

- **Desalination.** In 2006, Arroyo Grande, Grover Beach, and OCSD used Prop 50 funds to complete a feasibility study on desalination as an additional water supply option for the NCMA. This alternative supply is not considered to be a viable option at this time.

Previous efforts by the FCWCD to (1) evaluate the potential to expand the existing desalination facility at the PG&E Diablo Canyon Power Plant and (2) connect it to the Lopez Lake pipeline to provide a supplemental water supply for the Zone 3 agencies have been terminated since PG&E announced plans to close the power plant.

- **Nacimiento Pipeline Extension.** In 2006, Arroyo Grande, Grover Beach, and OCSD completed a Nacimiento pipeline extension evaluation to determine the feasibility of delivery of water from the Nacimiento reservoir to the NCMA. This alternative supply is not considered to be a viable option at this time.

This page left blank intentionally.

8. References

- Allen, R.G., Pereira, L.S., Raes, D., and Smith, M. 1998. Crop evapotranspiration- Guidelines for computing crop water requirements: Food and Agriculture Organization of the United Nations, Irrigation and Drainage Paper 56, 300p.
- California Department of Water Resources (DWR). 1958. San Luis Obispo County Investigation, Bulletin No. 18, vol 1 and 2.
- California Department of Water Resources (DWR). 1970. Sea-Water Intrusion: Pismo-Guadalupe Area. Bulletin No. 63-3, 76 p.
- California Department of Water Resources (DWR). 1975. Sea-Water Intrusion in California, Inventory of Coastal Ground Water Basins, Bulletin 63-5.
- California Department of Water Resources (DWR). 1979. Ground Water in the Arroyo Grande Area, Southern District Report.
- California Department of Water Resources. 2002. Water resources of the Arroyo Grande – Nipomo Mesa area: Southern District Report, 156 p.
- California Department of Water Resources Bay Delta Office. 2016. IWFM Demand Calculator IDC 2015: Theoretical Documentation and User's Manual. Central Valley Modeling Unit.
- California Polytechnic State University. 2012. California Evapotranspiration Data for Irrigation District Water Balances, Irrigation Training & Research Center, San Luis Obispo, CA 93407-0730.
- Carollo Engineers. 2011. City of Pismo Beach 2010 Urban Water Management Plan.
- City of Arroyo Grande. 2010. City of Arroyo Grande 2010 Urban Water Management Plan.
- City of Grover Beach. 2010. City of Grover Beach 2010 Urban Water Management Plan.
- EDAW, Inc. August 1998. San Luis Obispo County Master Water Plan Update.
- Fugro Consultants, Inc. 2015. Santa Maria Groundwater Basin Characterization and Planning Activities Study, Final Report. Prepared for San Luis Obispo County Flood Control and Water Conservation District, December 30, 2015.
- Miller, G. A. and Evenson, R. E. 1966. Utilization of Groundwater in the Santa Maria Valley Area, California. USGS Water Supply Paper 1819-A.
- Mualem, Y. 1976. A new model for predicting the hydraulic conductivity of unsaturated porous media. *Water Resources Res.*, 12, 513-522.
- Northern Cities Management Area. 2008. Annual Monitoring Report, prepared by Todd Engineers. April 2009.
- Northern Cities Management Area. 2009. Annual Monitoring Report, prepared by Todd Engineers. April 2010.
- Northern Cities Management Area. 2010. Annual Monitoring Report, prepared by GEI Consultants. April 2011.

- Northern Cities Management Area. 2011. Annual Monitoring Report, prepared by GEI Consultants. May 2012.
- Northern Cities Management Area. 2012. Annual Monitoring Report, prepared by GEI Consultants. April 2013.
- Northern Cities Management Area. 2013. Annual Monitoring Report, prepared by Fugro Consultants. April 2014.
- Northern Cities Management Area. 2014. Annual Monitoring Report, prepared by Fugro Consultants. April 2015.
- Northern Cities Management Area. 2015. Annual Monitoring Report, prepared by Fugro Consultants. April 2016.
- Northern Cities Management Area. 2016. Annual Monitoring Report, prepared by GSI Water Solutions, Inc. April 2017.
- Nipomo Mesa Management Area. 2010. 2nd Annual Report, Calendar Year 2009, prepared by the NMMA Technical Group, April 2010.
- Nipomo Mesa Management Area. 2011. 3rd Annual Report, Calendar Year 2010, prepared by the NMMA Technical Group, April 2011.
- Nipomo Mesa Management Area. 2012. 4th Annual Report, Calendar Year 2011, prepared by the NMMA Technical Group, April 2012.
- Nipomo Mesa Management Area. 2013. 5th Annual Report, Calendar Year 2012, prepared by the NMMA Technical Group, April 2013.
- Nipomo Mesa Management Area. 2014. 6th Annual Report, Calendar Year 2013, prepared by the NMMA Technical Group, April 2014.
- Nipomo Mesa Management Area. 2015. 7th Annual Report, Calendar Year 2014, prepared by the NMMA Technical Group, April 2015.
- Nipomo Mesa Management Area. 2016. 8th Annual Report, Calendar Year 2015, prepared by the NMMA Technical Group, April 2016.
- Nipomo Mesa Management Area, 9th Annual Report, Calendar Year 2016, prepared by the NMMA Technical Group, April 2017.
- Pacific Gas and Electric Company (PG&E). 2014. Central Coastal California Seismic Imaging Project (CCSIP), report to the California Public Utilities Commission.
<http://www.pge.com/en/safety/systemworks/dcpp/seismicsafety/report.page>
- Stetson Engineers. 2013. Lopez Lake Spillway Raise Project Report.
- Superior Court of California, County of Santa Clara, in Judgment After Trial, entered January 25, 2008 incorporating 2002 Settlement Agreement among the Northern Cities, Northern Landowners, and Other Parties, and 2005 Settlement Stipulation for the Santa Maria Groundwater Basin adjudication.
- Todd Engineers. 2007. Water Balance Study for the Northern Cities Area. Todd Engineers. April 2007.

- Todd. Engineers. 2008. Monitoring Program for the Northern Cities Management Area. Todd Engineers, July 2008.
- Todd Engineers. 2010. Summary of Renovations for the Northern Cities Management Area Sentry Wells, San Luis Obispo County, California.
- U.S. Geological Survey. 2006. Quaternary fault and fold database for the United States. <http://earthquake.usgs.gov/regional/qfaults>
- Van Genuchten, M.T. 1985. A Closed-form solution for predicting the conductivity of unsaturated soils. Soil Sci. Soc. Am. J., 44, 892-898.
- Wallace Group. 2010. Survey Report on the “Sentry” Well Elevation Establishment for Cities of Arroyo Grande, Grover Beach, Pismo Beach and the Oceano Community Services District.
- Water Systems Consulting, Inc. (WSC). 2014. Final Draft Strategic Plan for the Northern Cities Management Area Technical Group, June 2014.
- Water Systems Consulting, Inc. (WSC). 2015. Recycled Water Facilities Planning Study – Final: prepared for the City of Pismo Beach, April 2015.
- Woodring, W.P and Bramlette, M.N. 1950. Geology and Paleontology of the Santa Maria District, California: U.S. Geological Survey, Professional Paper 222, 142 p.
- Worts, G.G., Jr. 1951. Geology and ground-water resources of the Santa Maria Valley area, California: U.S. Geological Survey Water-Supply Paper 1000, 176 p.

This page left blank intentionally.

FIGURES

This page left blank intentionally.

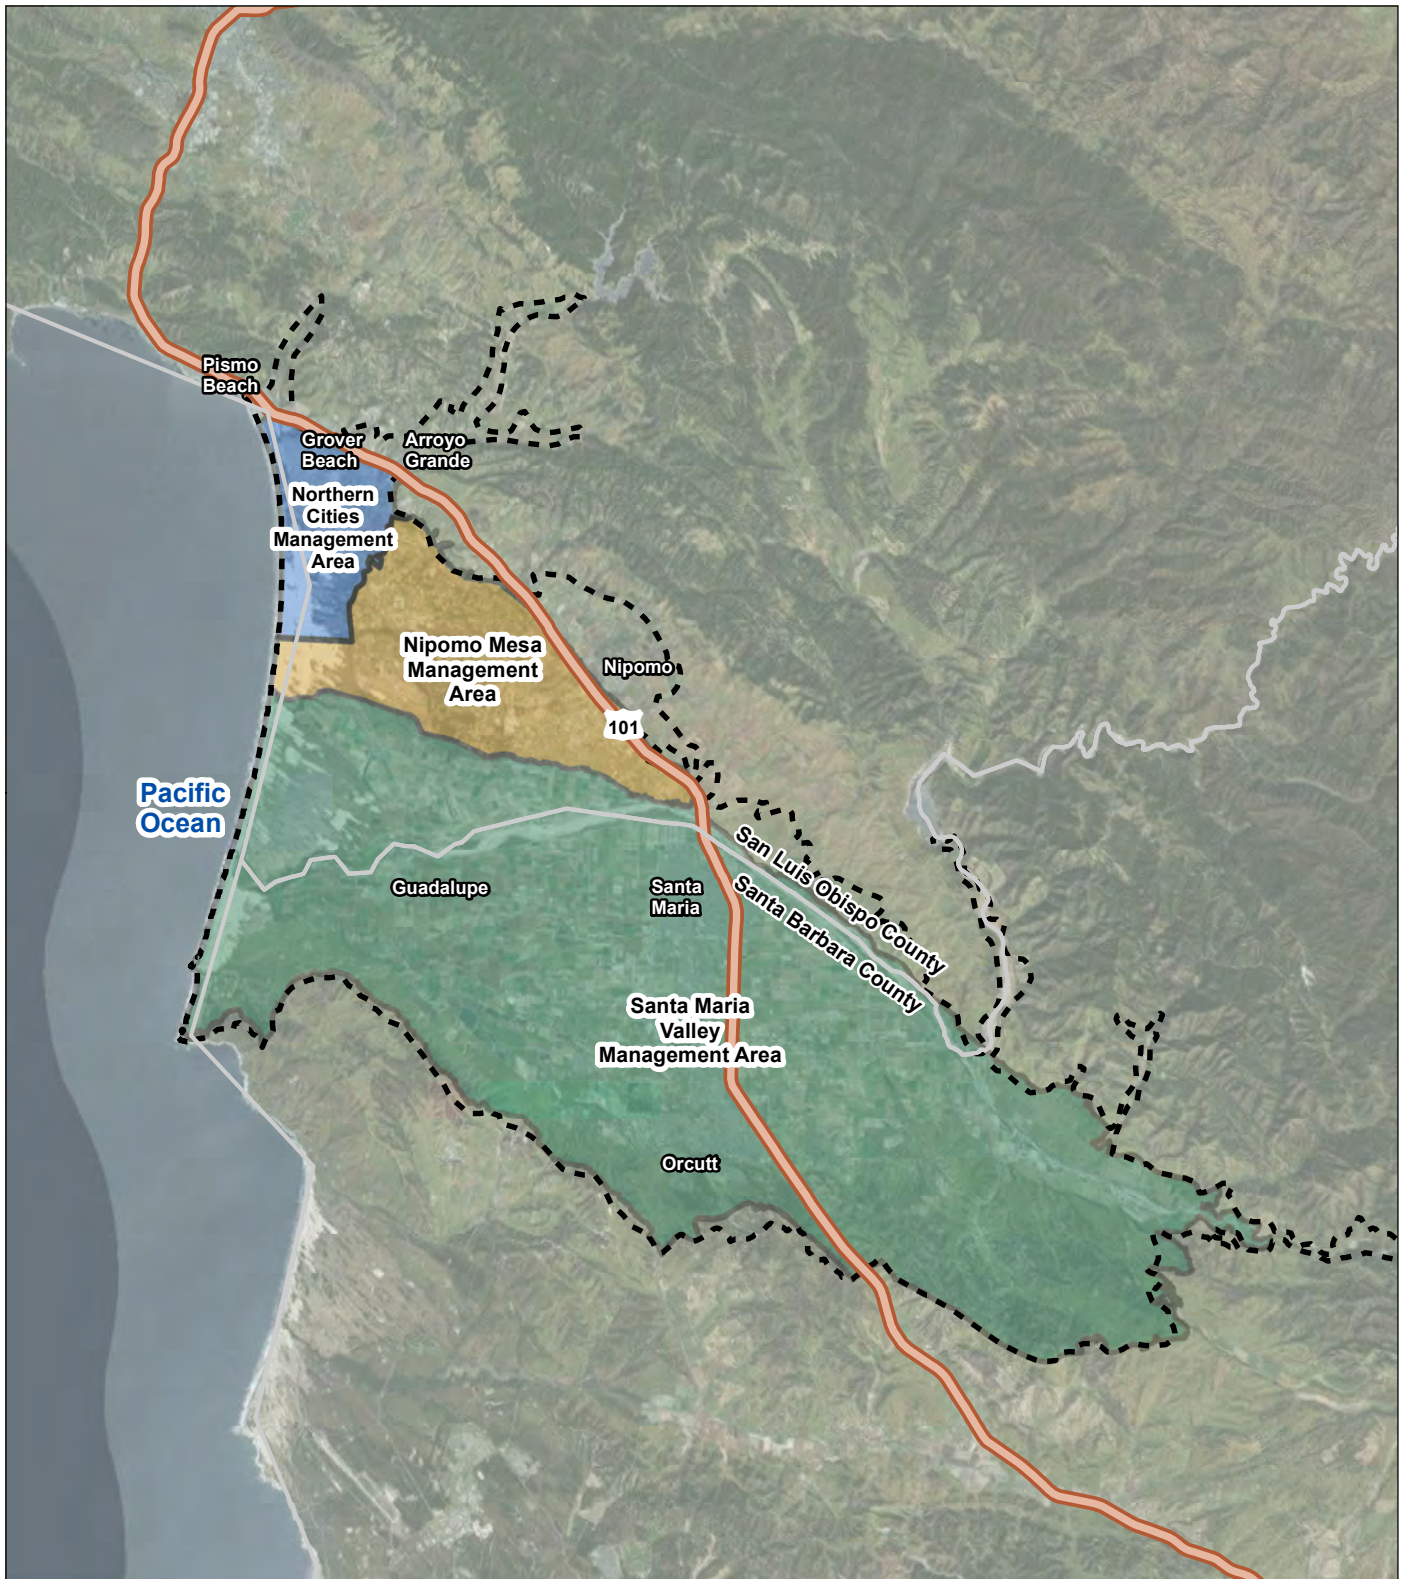


FIGURE 1


Santa Maria Groundwater Basin
 Northern Cities Management Area
 San Luis Obispo County, California

LEGEND

- Northern Cities Management Area
- Nipomo Mesa Management Area
- Santa Maria Valley Management Area
- Santa Maria Groundwater Basin (DWR 2016)
- County Borders




Date: December 23, 2016
 Data Sources:

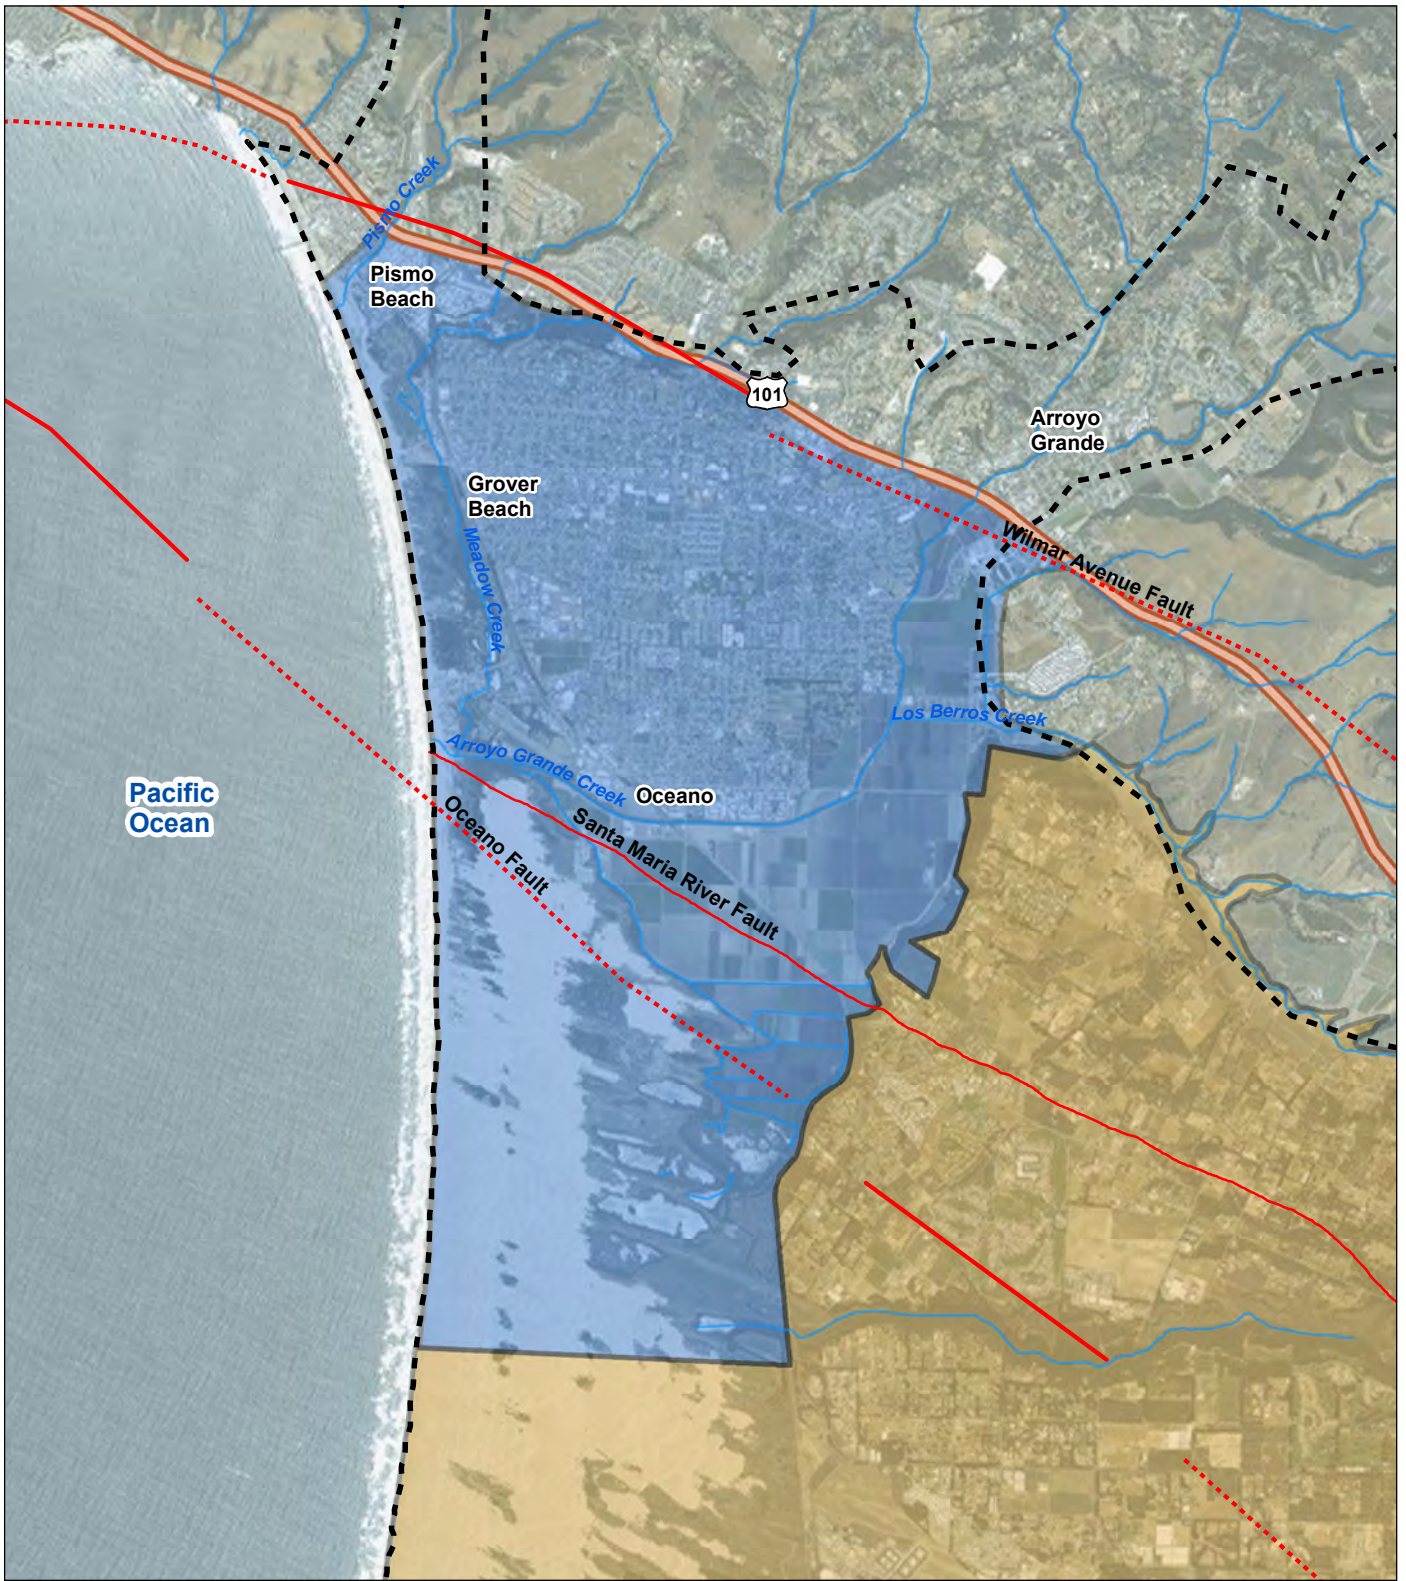


LEGEND

- Northern Cities Management Area
- Nipomo Mesa Management Area
- Santa Maria Groundwater Basin (DWR 2016)
- Faults
- Streams

FIGURE 2
Northern Cities Management Area
 San Luis Obispo County, California



Date: December 23, 2016
 Data Sources:

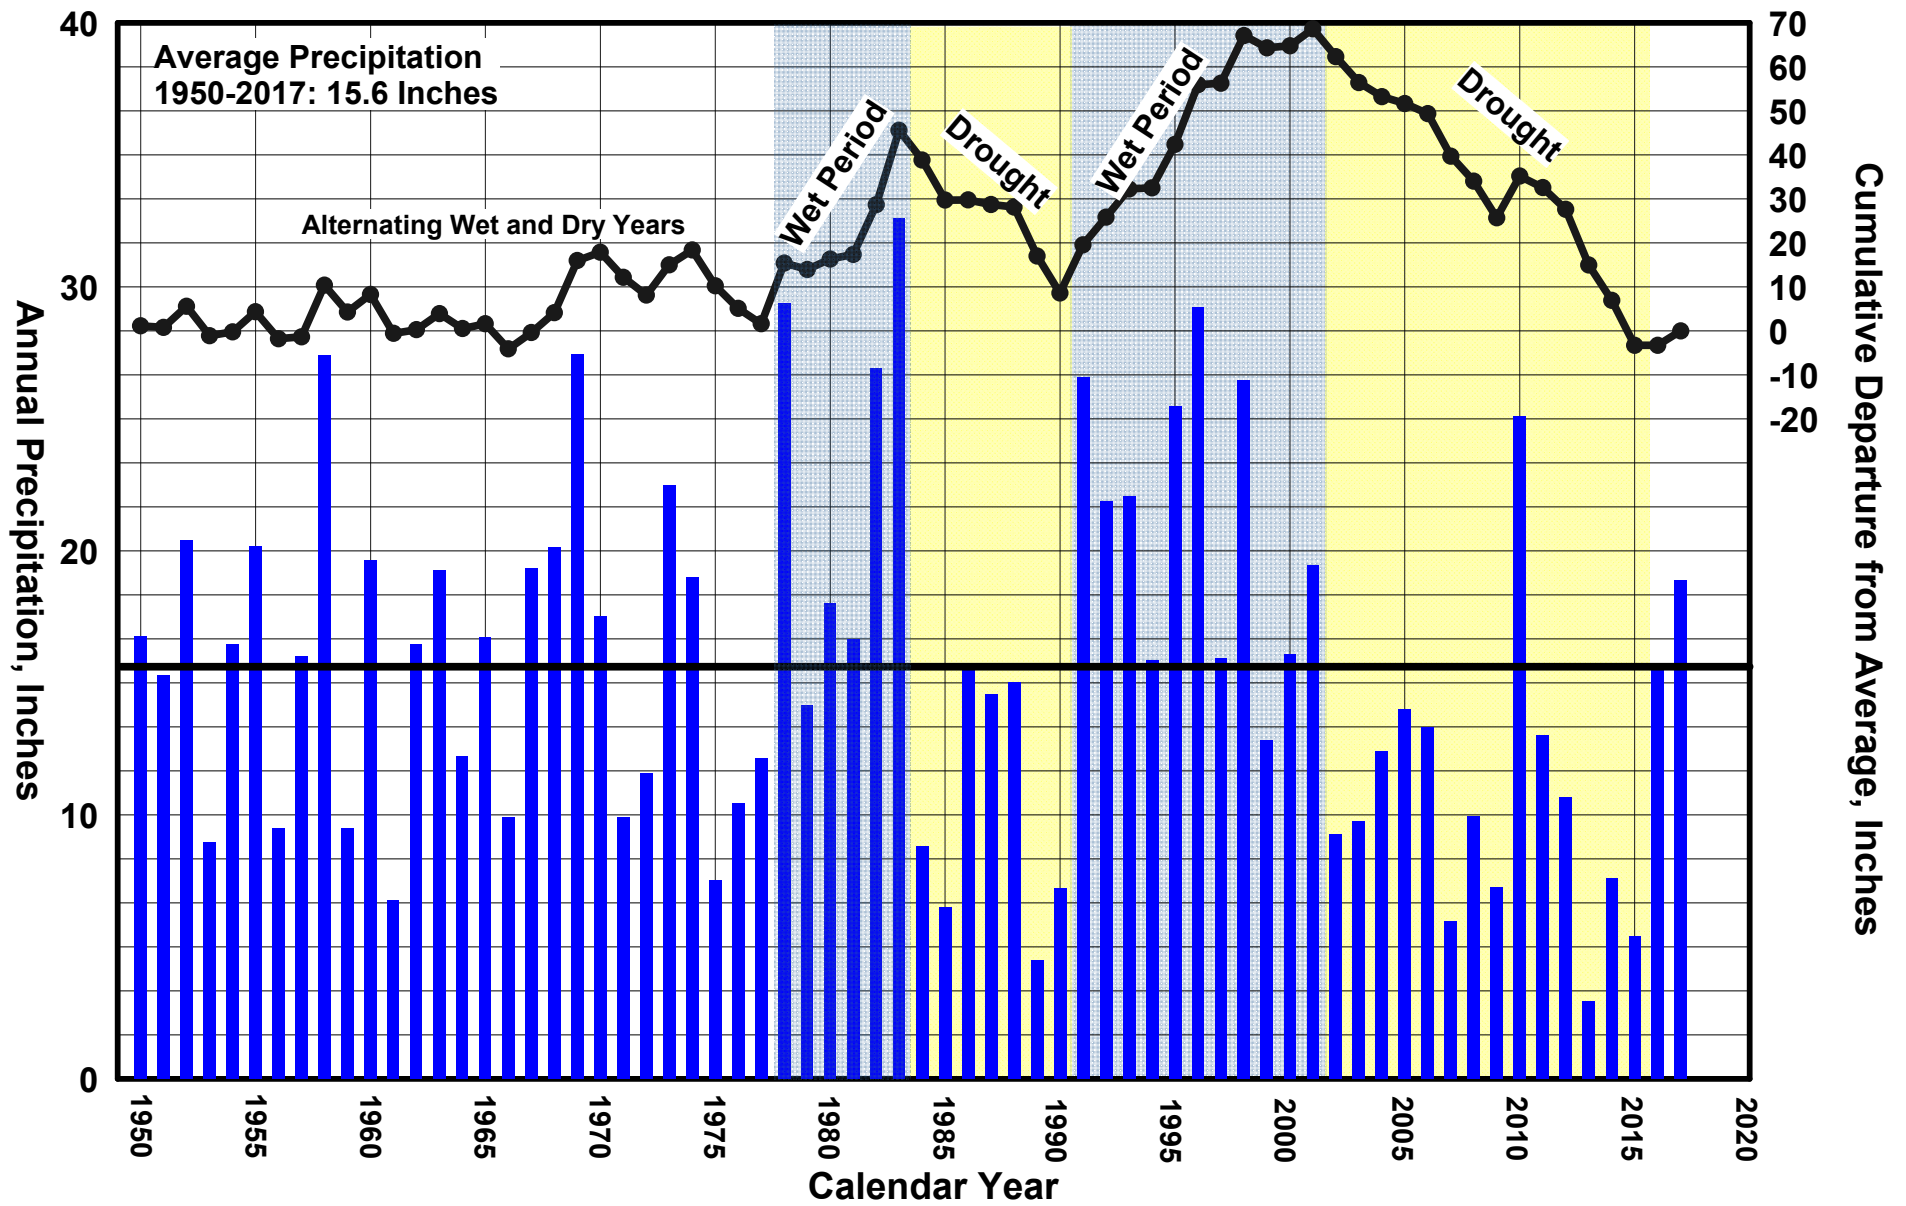


\\PDX\Projects\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 3 NCMA Precip 1950 - 2017 Shaded.grf

FIGURE 3

ANNUAL PRECIPITATION 1950 TO 2017
 Northern Cities Management Area
 San Luis Obispo County, California



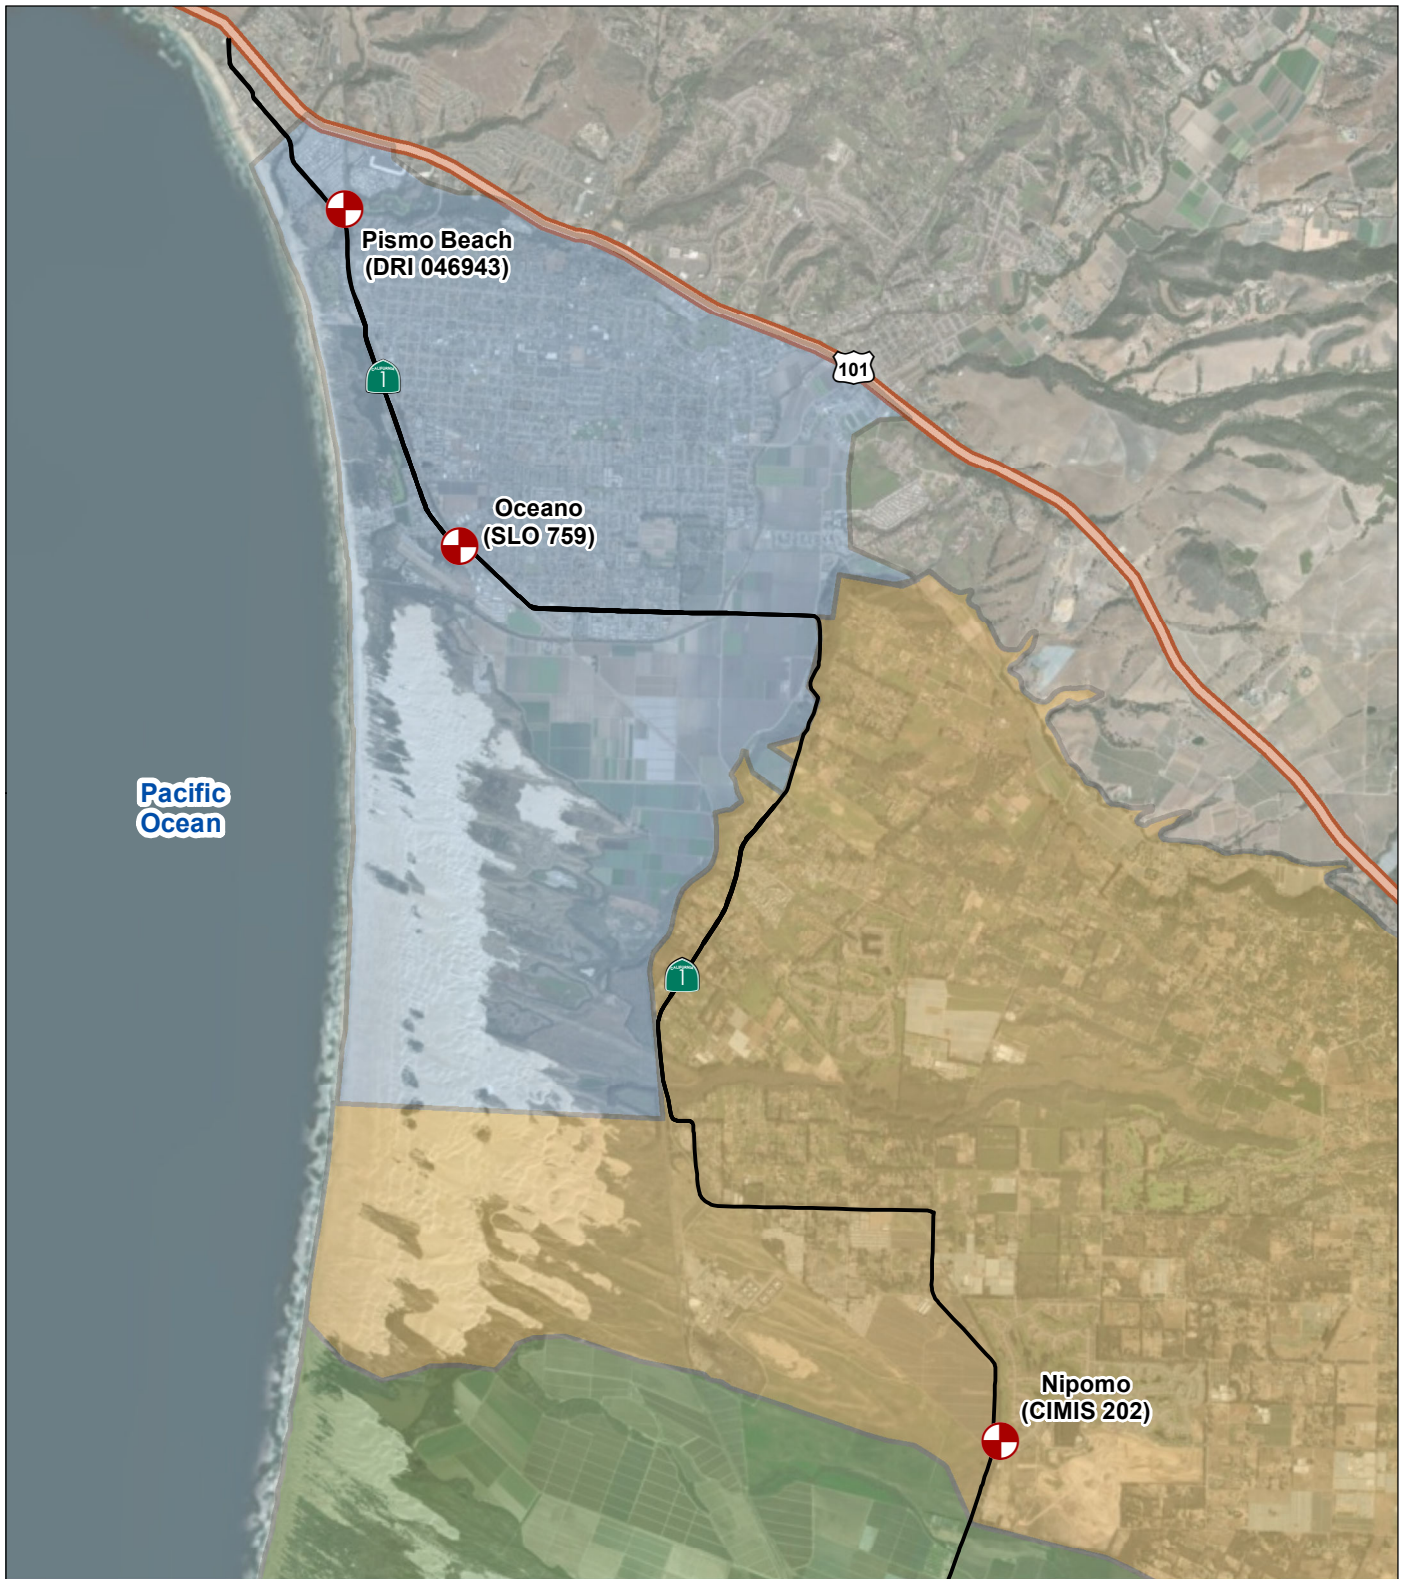

LEGEND






-  Weather Station
-  Nipomo Mesa Management Area
-  Northern Cities Management Area
-  Santa Maria Valley Management Area



FIGURE 4

Location of Precipitation Stations
 Northern Cities Management Area
 San Luis Obispo County, California



Date: January 22, 2018



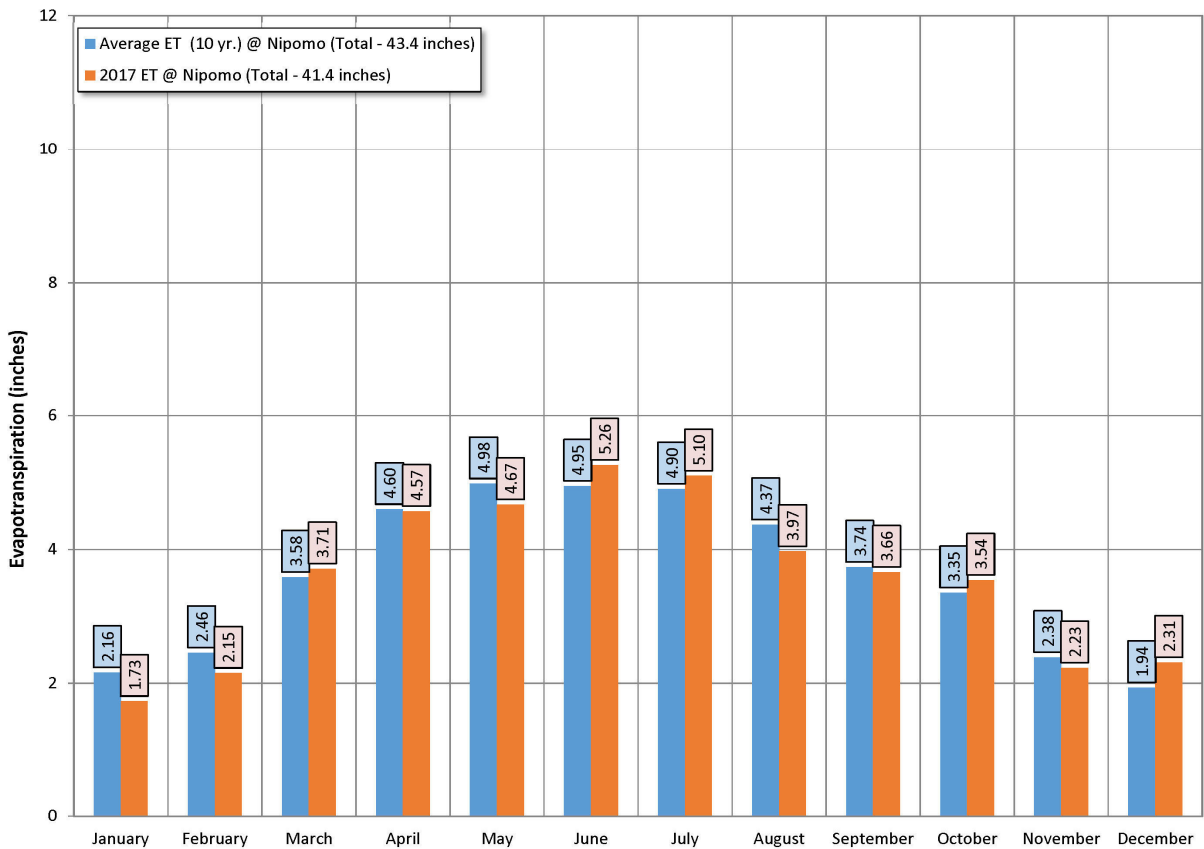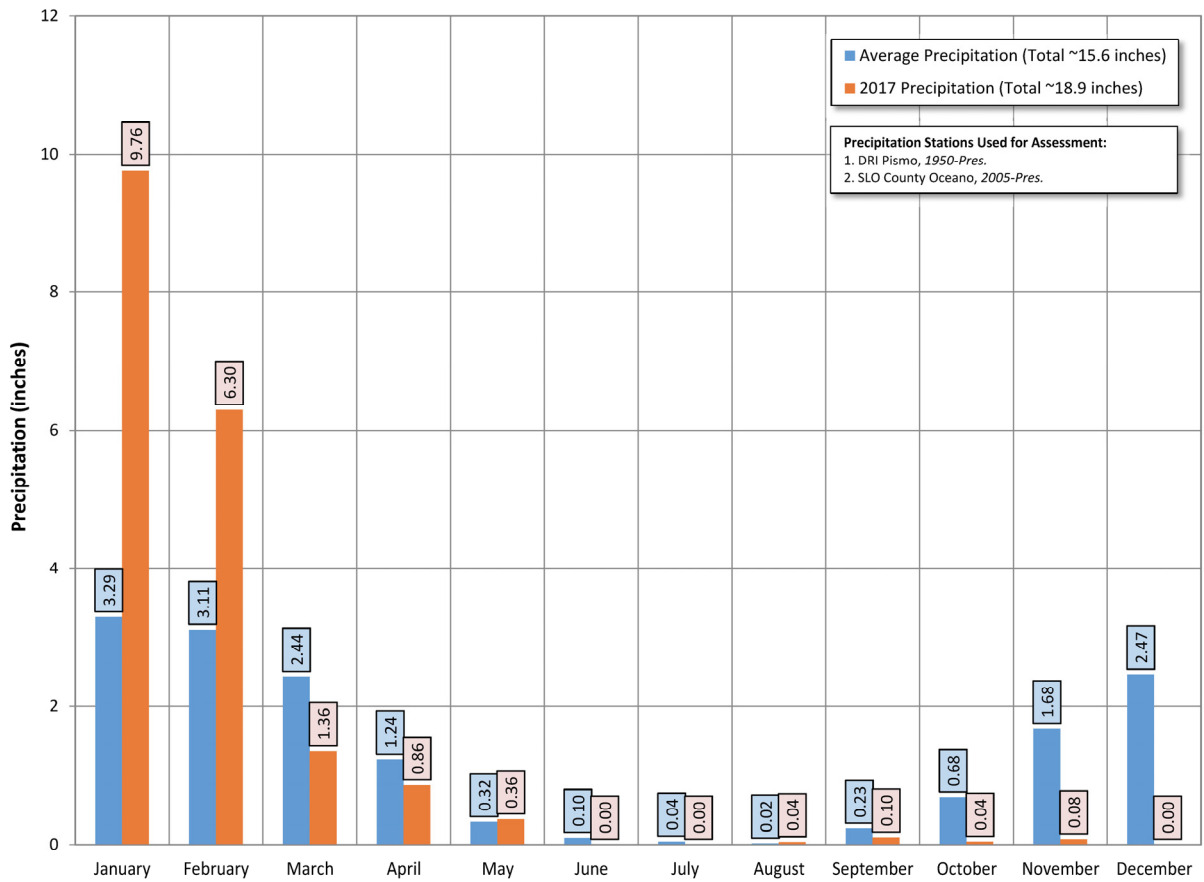


P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 5 NCMA Monthly 2016 Precip and Evap_r1.grf *



MONTHLY 2017 AND AVERAGE PRECIPITATION AND EVAPOTRANSPIRATION
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 5

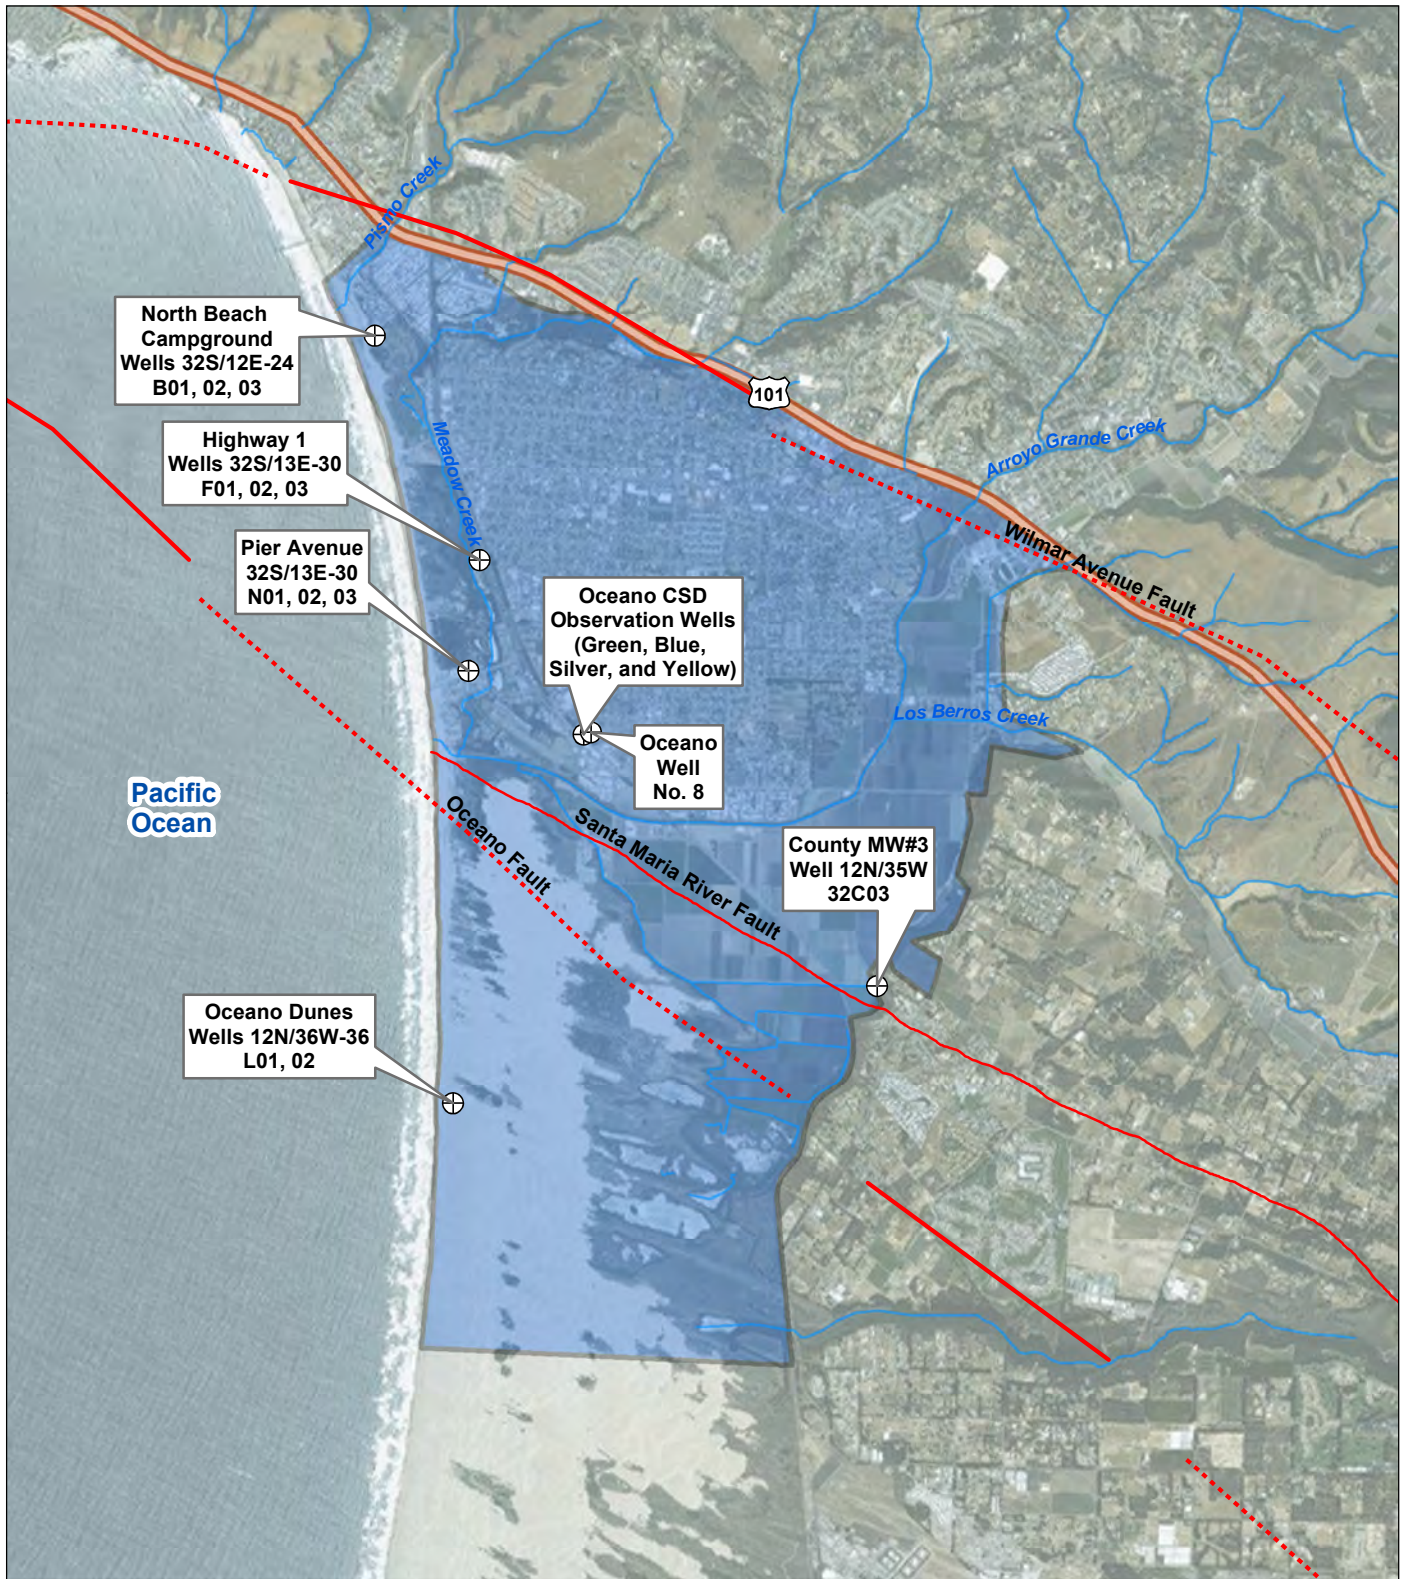


LEGEND


- ⊕ NCMA Monitoring Wells
- Northern Cities Management Area
- Faults
- Streams

FIGURE 6

Locations of Monitoring Wells
Northern Cities Management Area
San Luis Obispo County, California



Date: December 23, 2016
Data Sources:

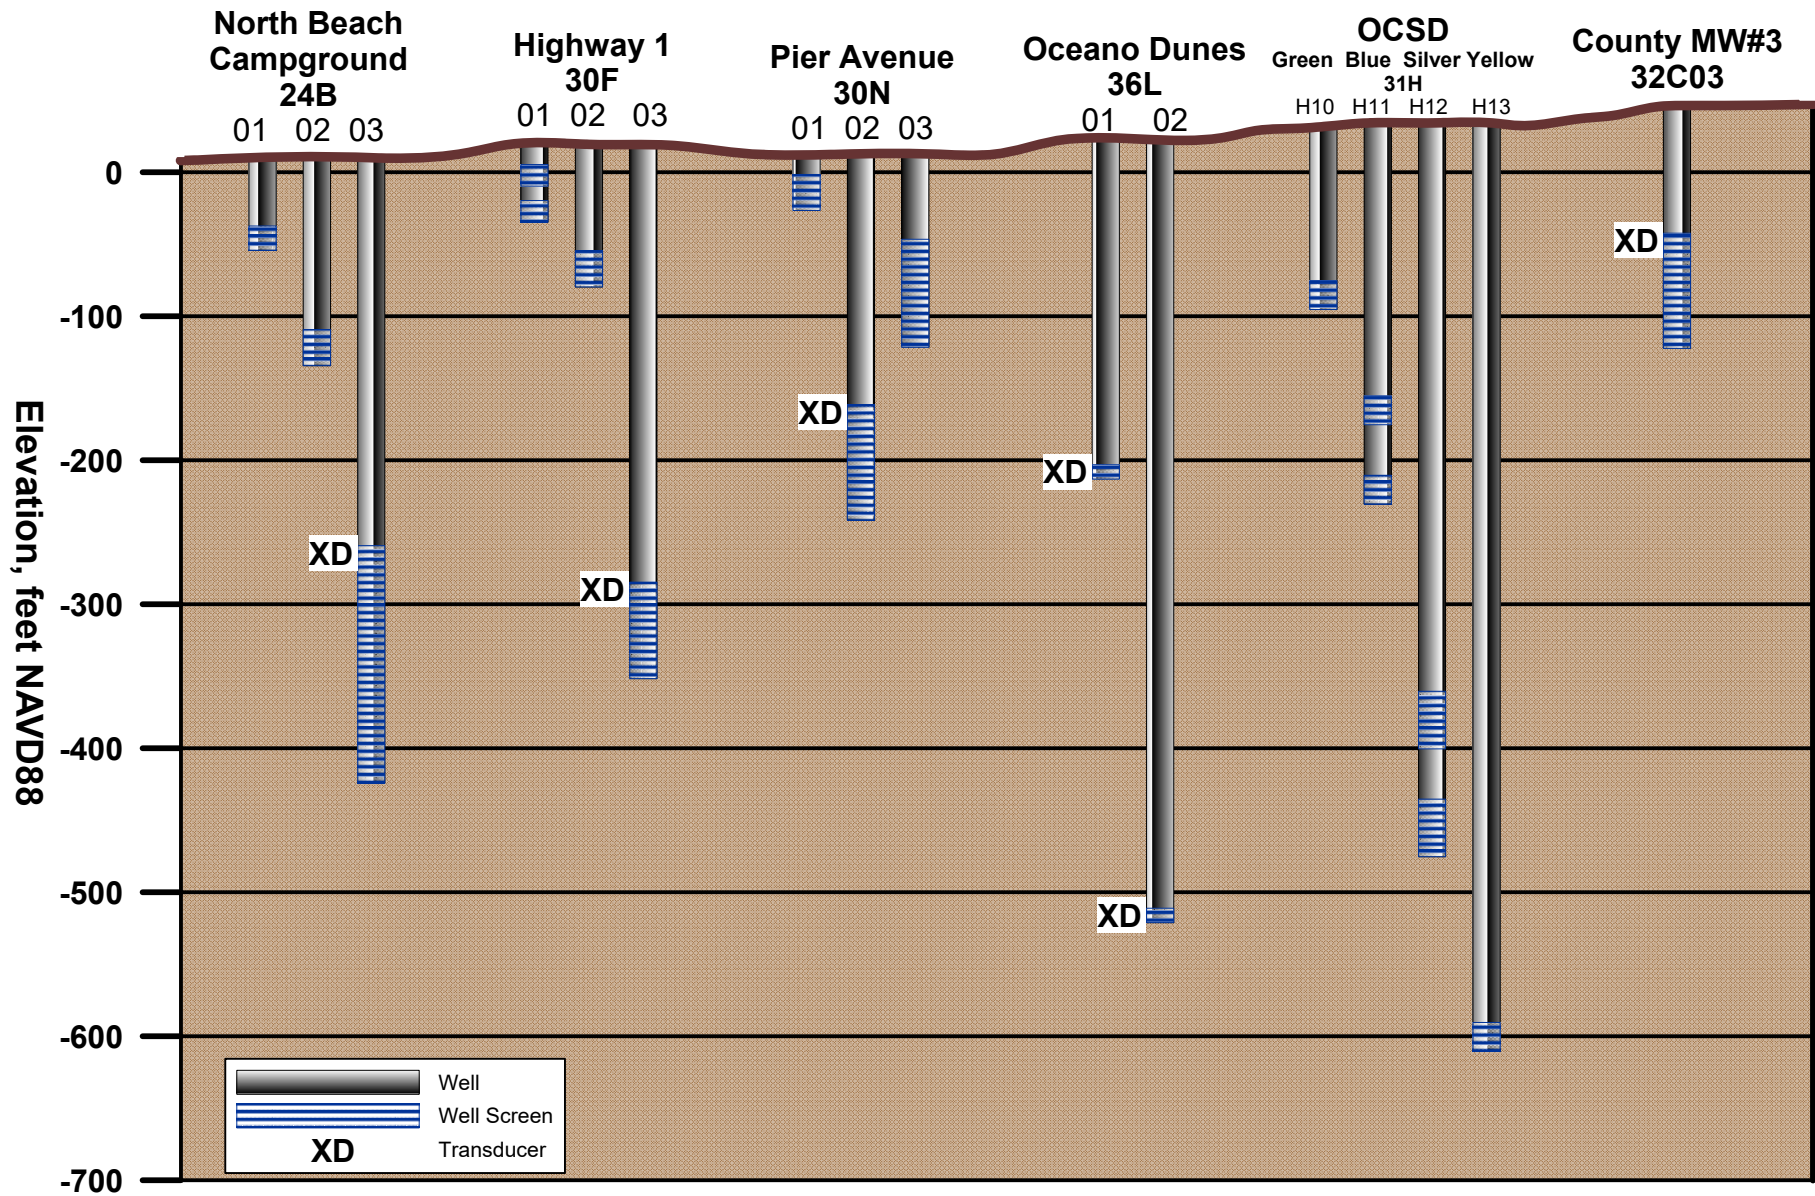


\\SBA\Projects\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 7 NCMA Depths of Monitoring Wells.grf *

FIGURE 7

DEPTHS OF MONITORING WELLS
 Northern Cities Management Area
 San Luis Obispo County, California




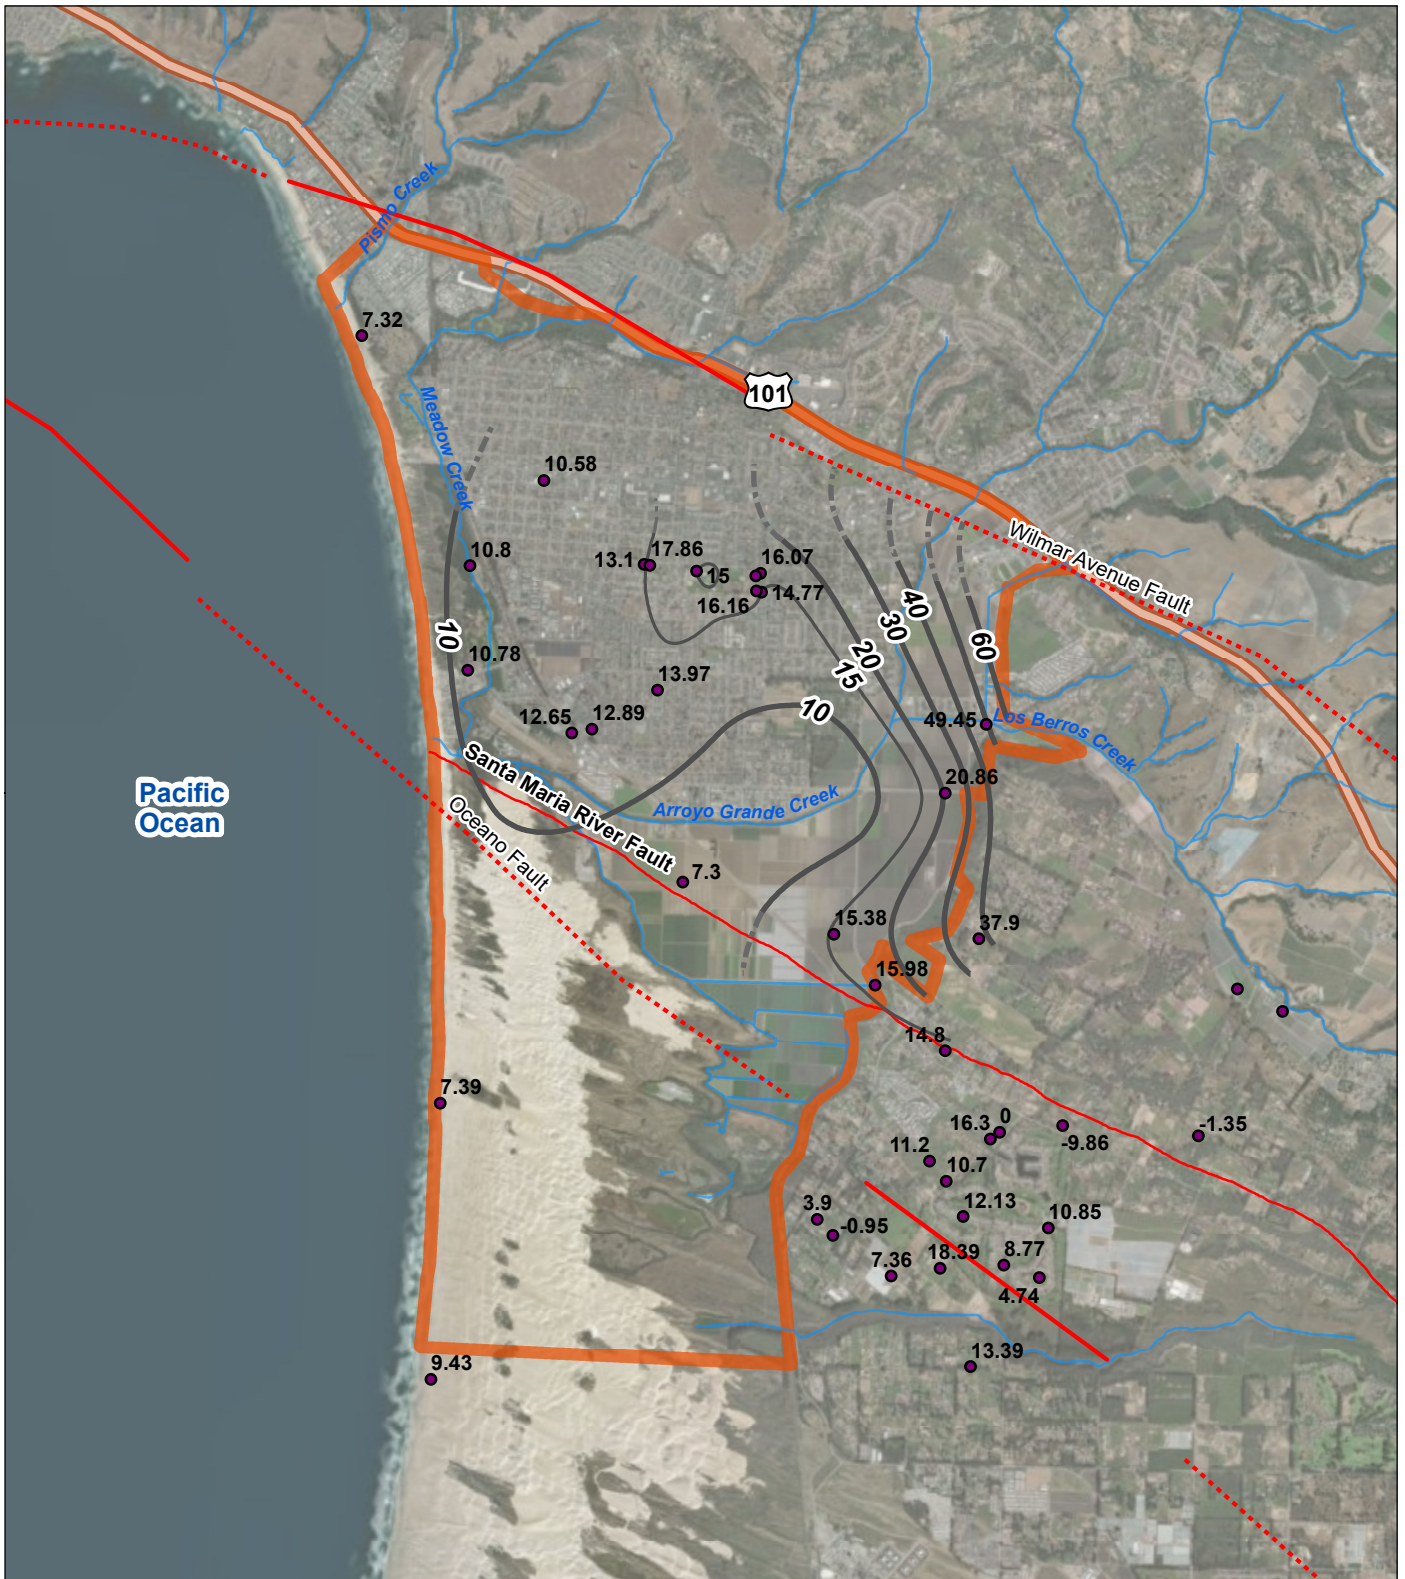

LEGEND


- Wells Used in Groundwater Contouring
- Groundwater Contour (feet, NAVD88)
- Minor Groundwater Contour
- ▭ Northern Cities Management Area
- Streams
- Faults

FIGURE 8
Groundwater Level Contours Spring 2017
 Northern Cities Management Area
 San Luis Obispo County, California



Date: March 19, 2018
 Data Sources: SLO County, NCMA and NMMA Agencies


Document Path: P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\Project_GIS\Project_mxd\Annual_Report\Figure_8_NCMA_Water_Level_Contours_April_2017.mxd

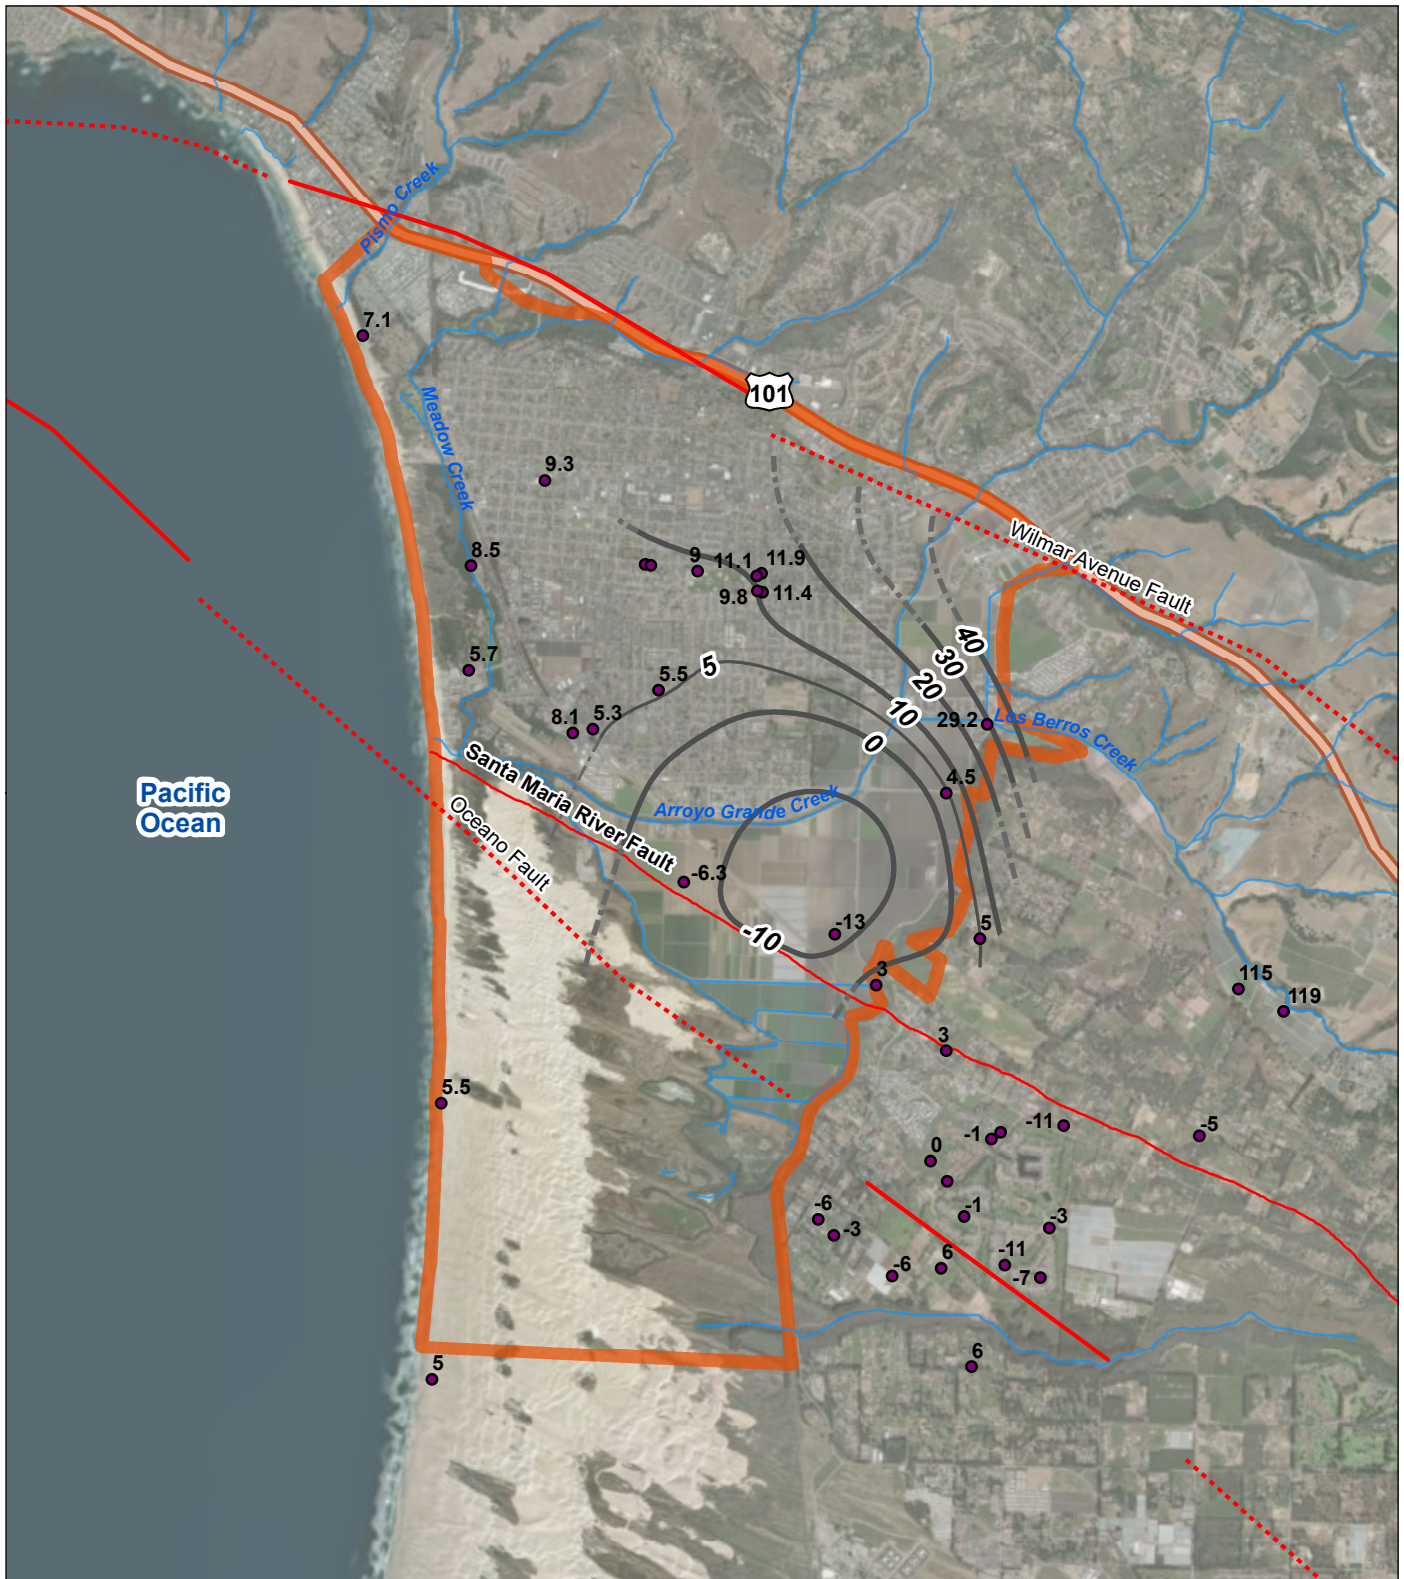

LEGEND


- Wells Used in Groundwater Contouring
- Groundwater Contour (feet, NAVD88)
- Minor Groundwater Contour
- ▭ Northern Cities Management Area
- Streams
- Faults

FIGURE 9
Groundwater Level Contours Fall 2017
 Northern Cities Management Area
 San Luis Obispo County, California



Date: March 19, 2018
 Data Sources: SLO County, NCMA and NMMA Agencies

Water Elevation, feet NAVD88

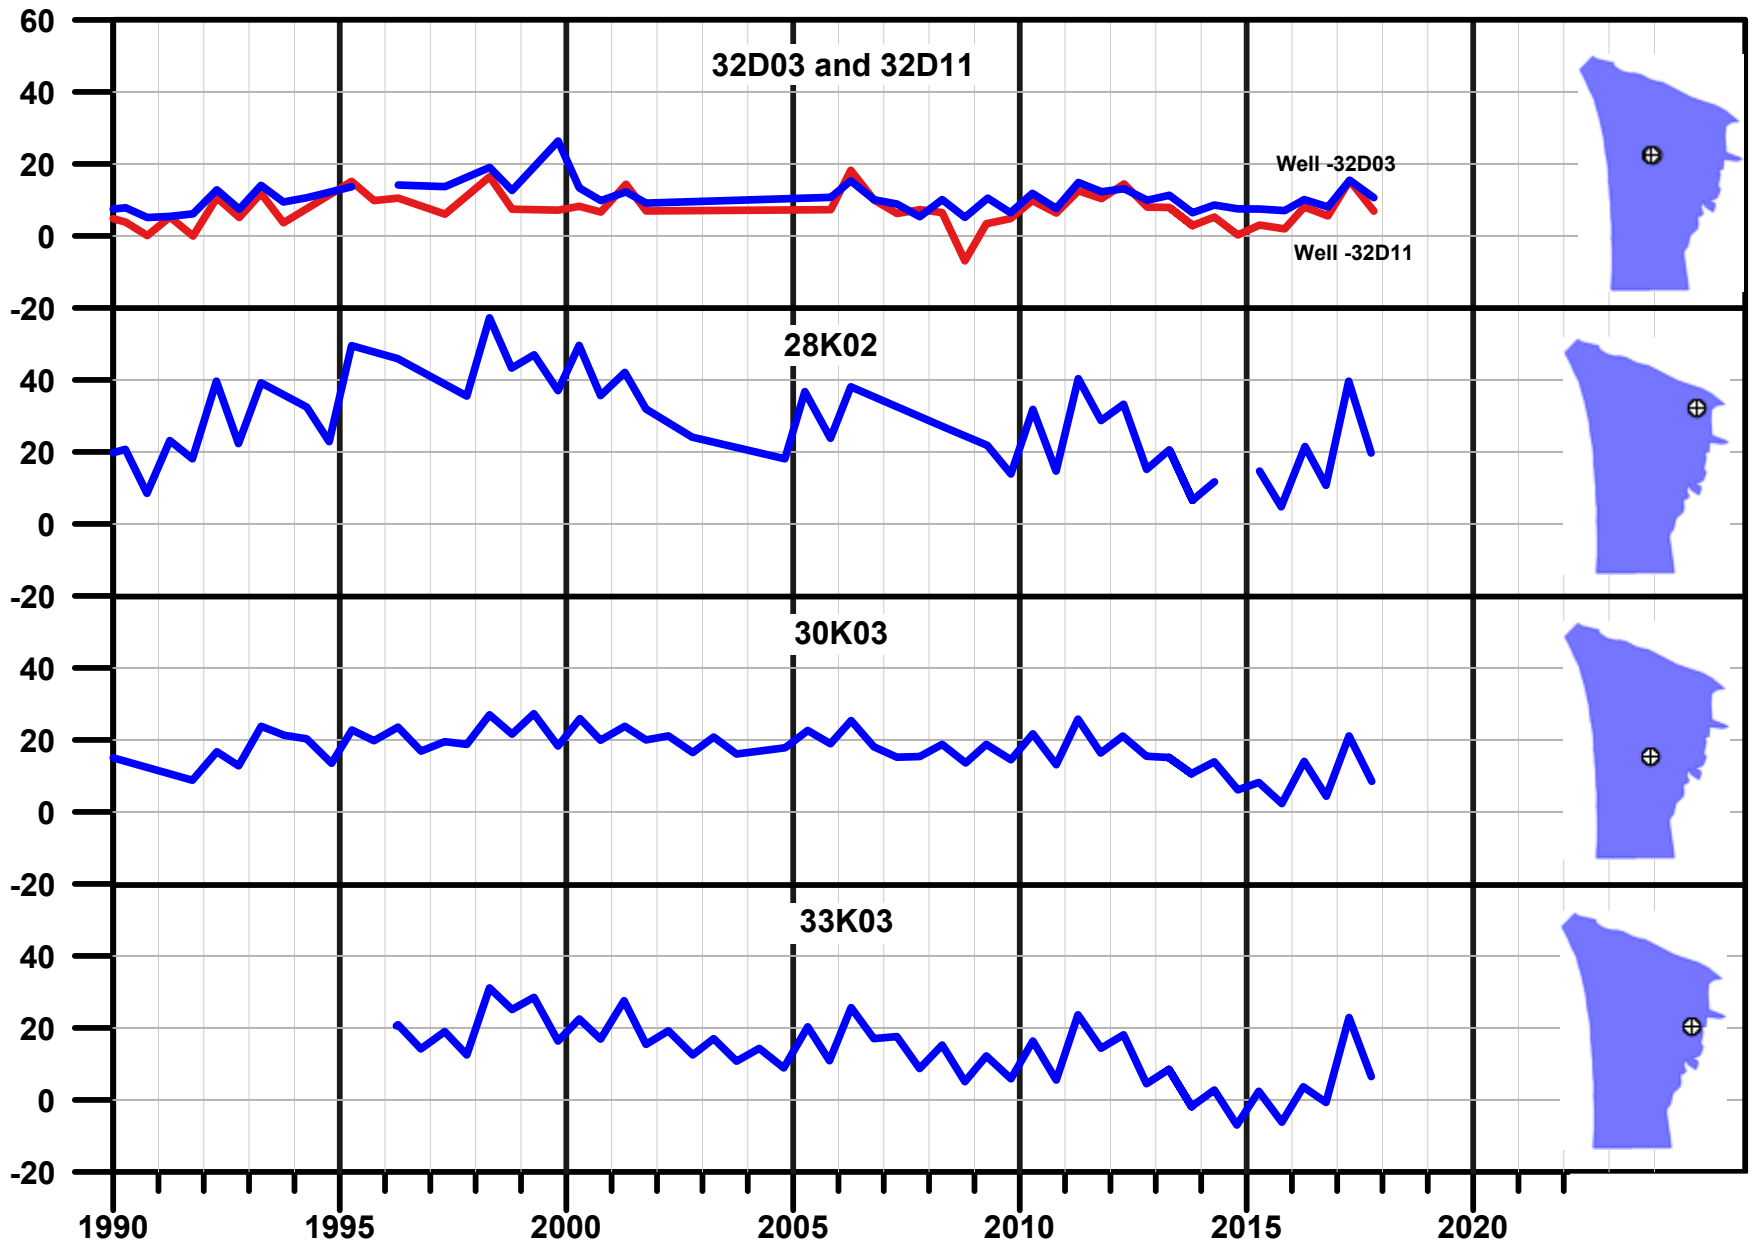


P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 10 NCMA Selected Hydrographs.grf

SELECTED HYDROGRAPHS
Northern Cities Management Area
San Luis Obispo County, California

FIGURE 10



Water Elevation, feet NAVD88

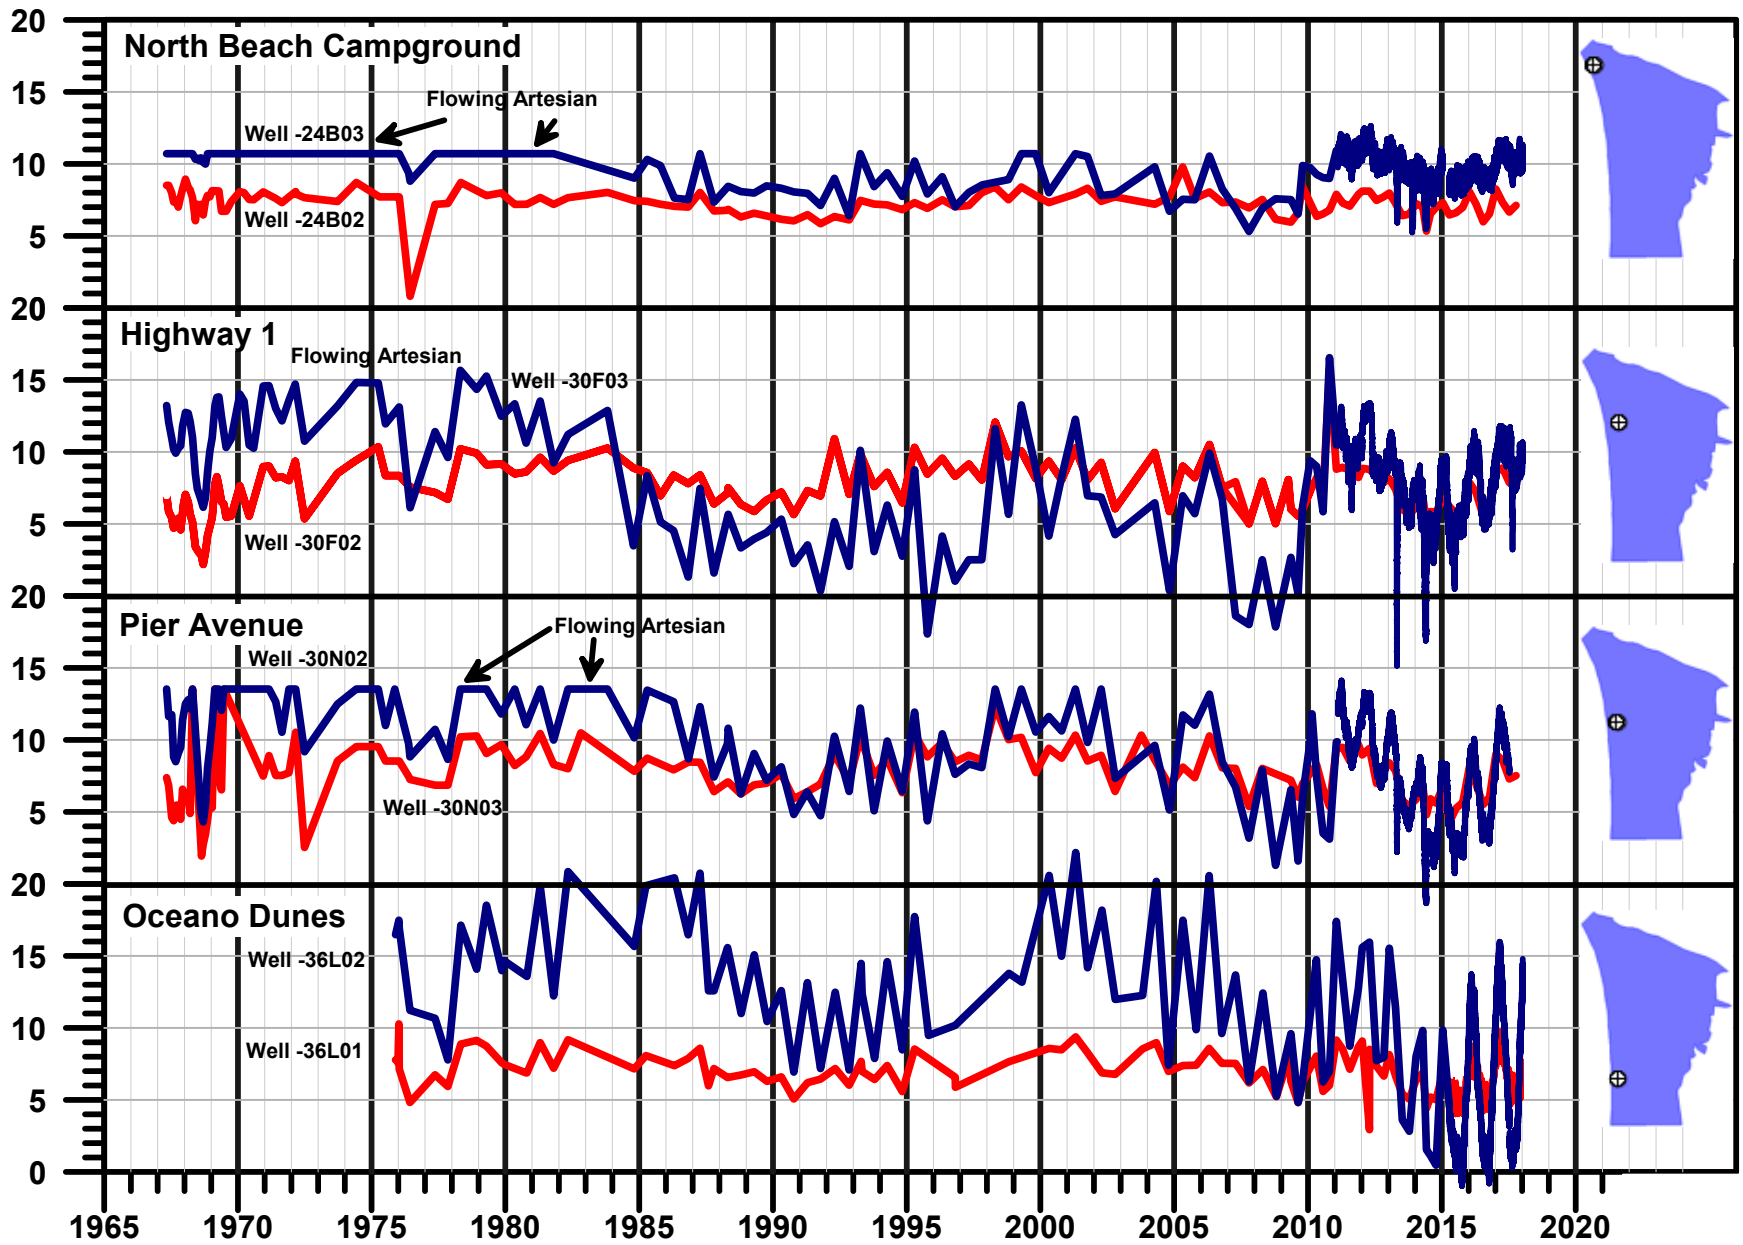

P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 11 NCMA Sentry Well Hydrographs.grf

SENTRY WELL HYDROGRAPHS
Northern Cities Management Area
San Luis Obispo County, California

FIGURE 11



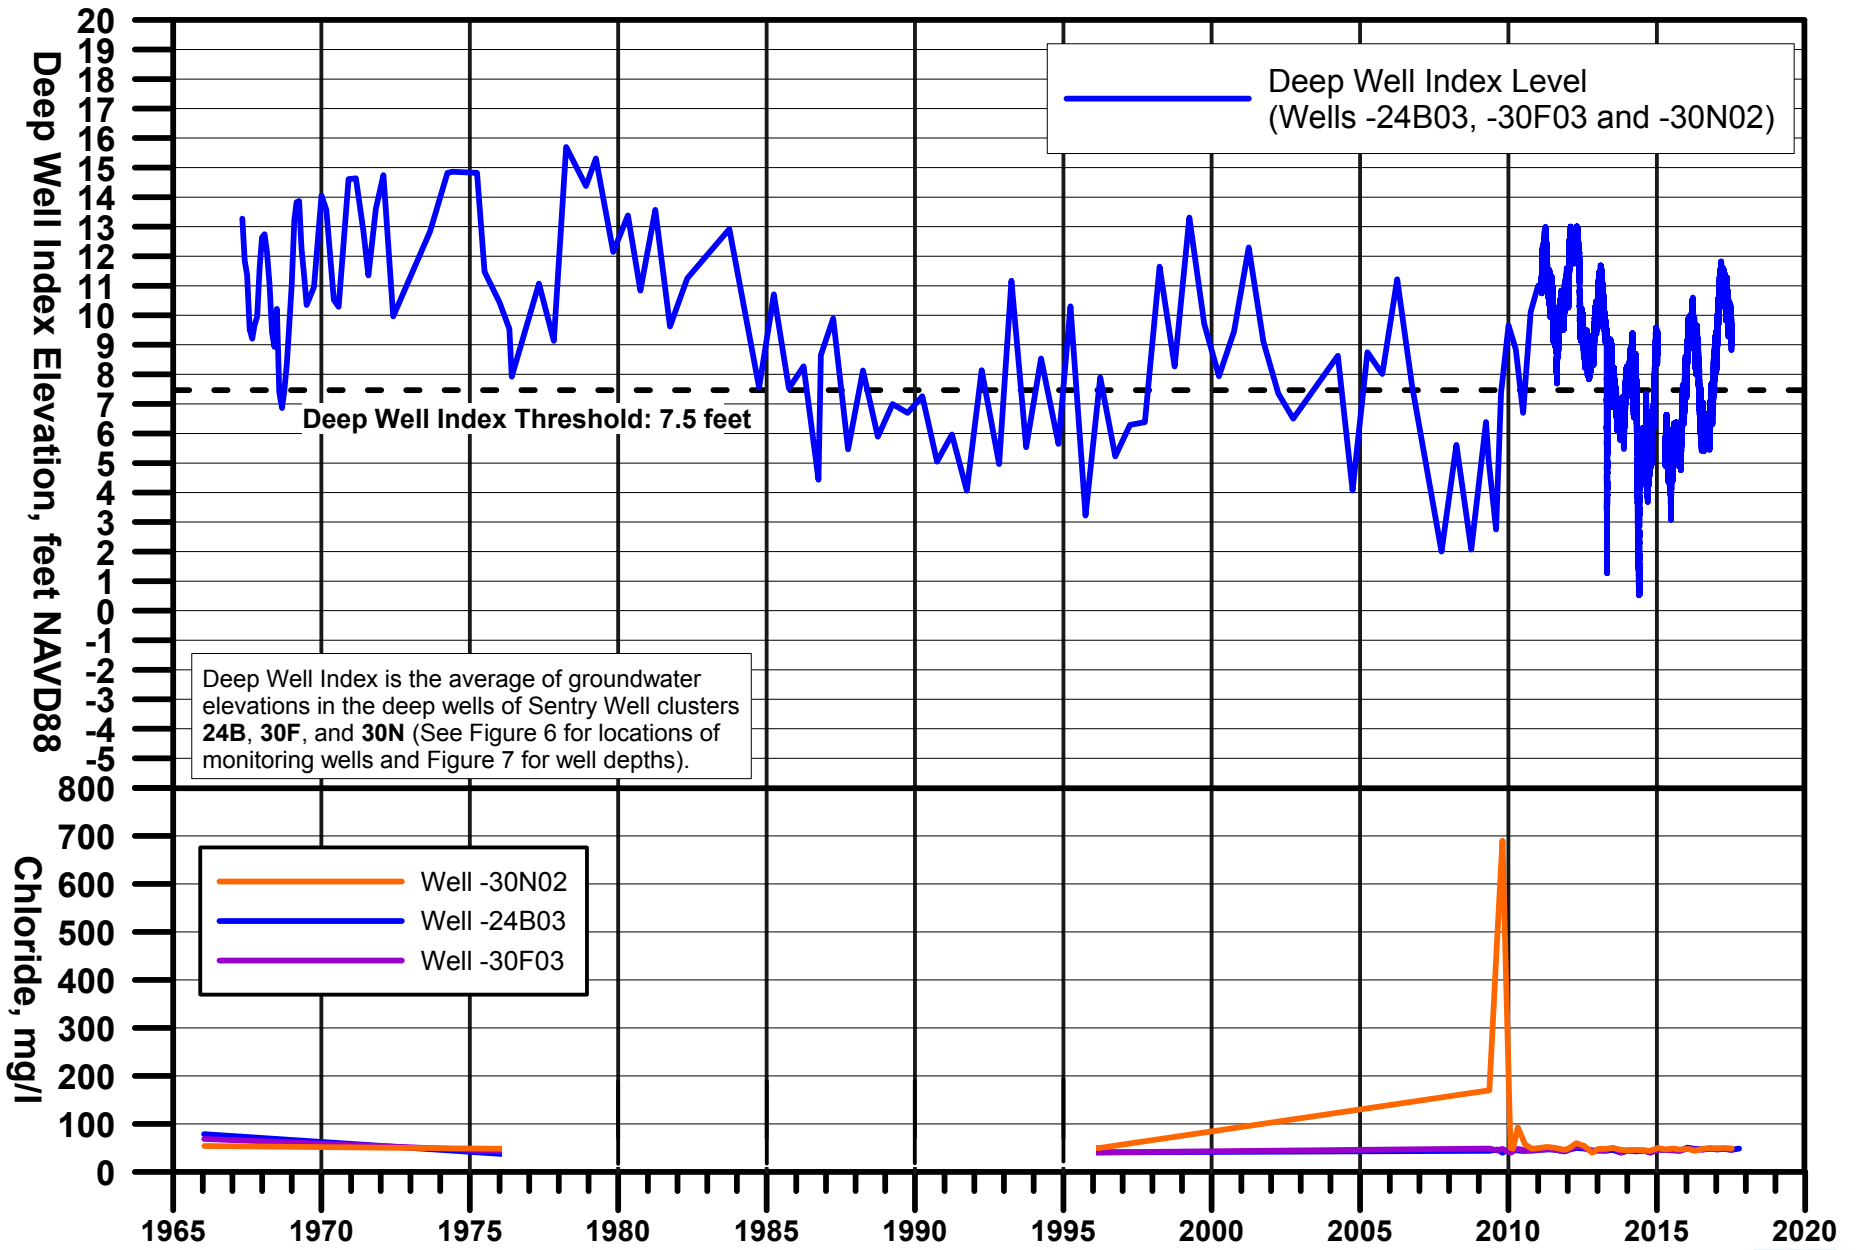


FIGURE 12

HYDROGRAPH OF DEEP WELL INDEX LEVEL
 Northern Cities Management Area
 San Luis Obispo County, California


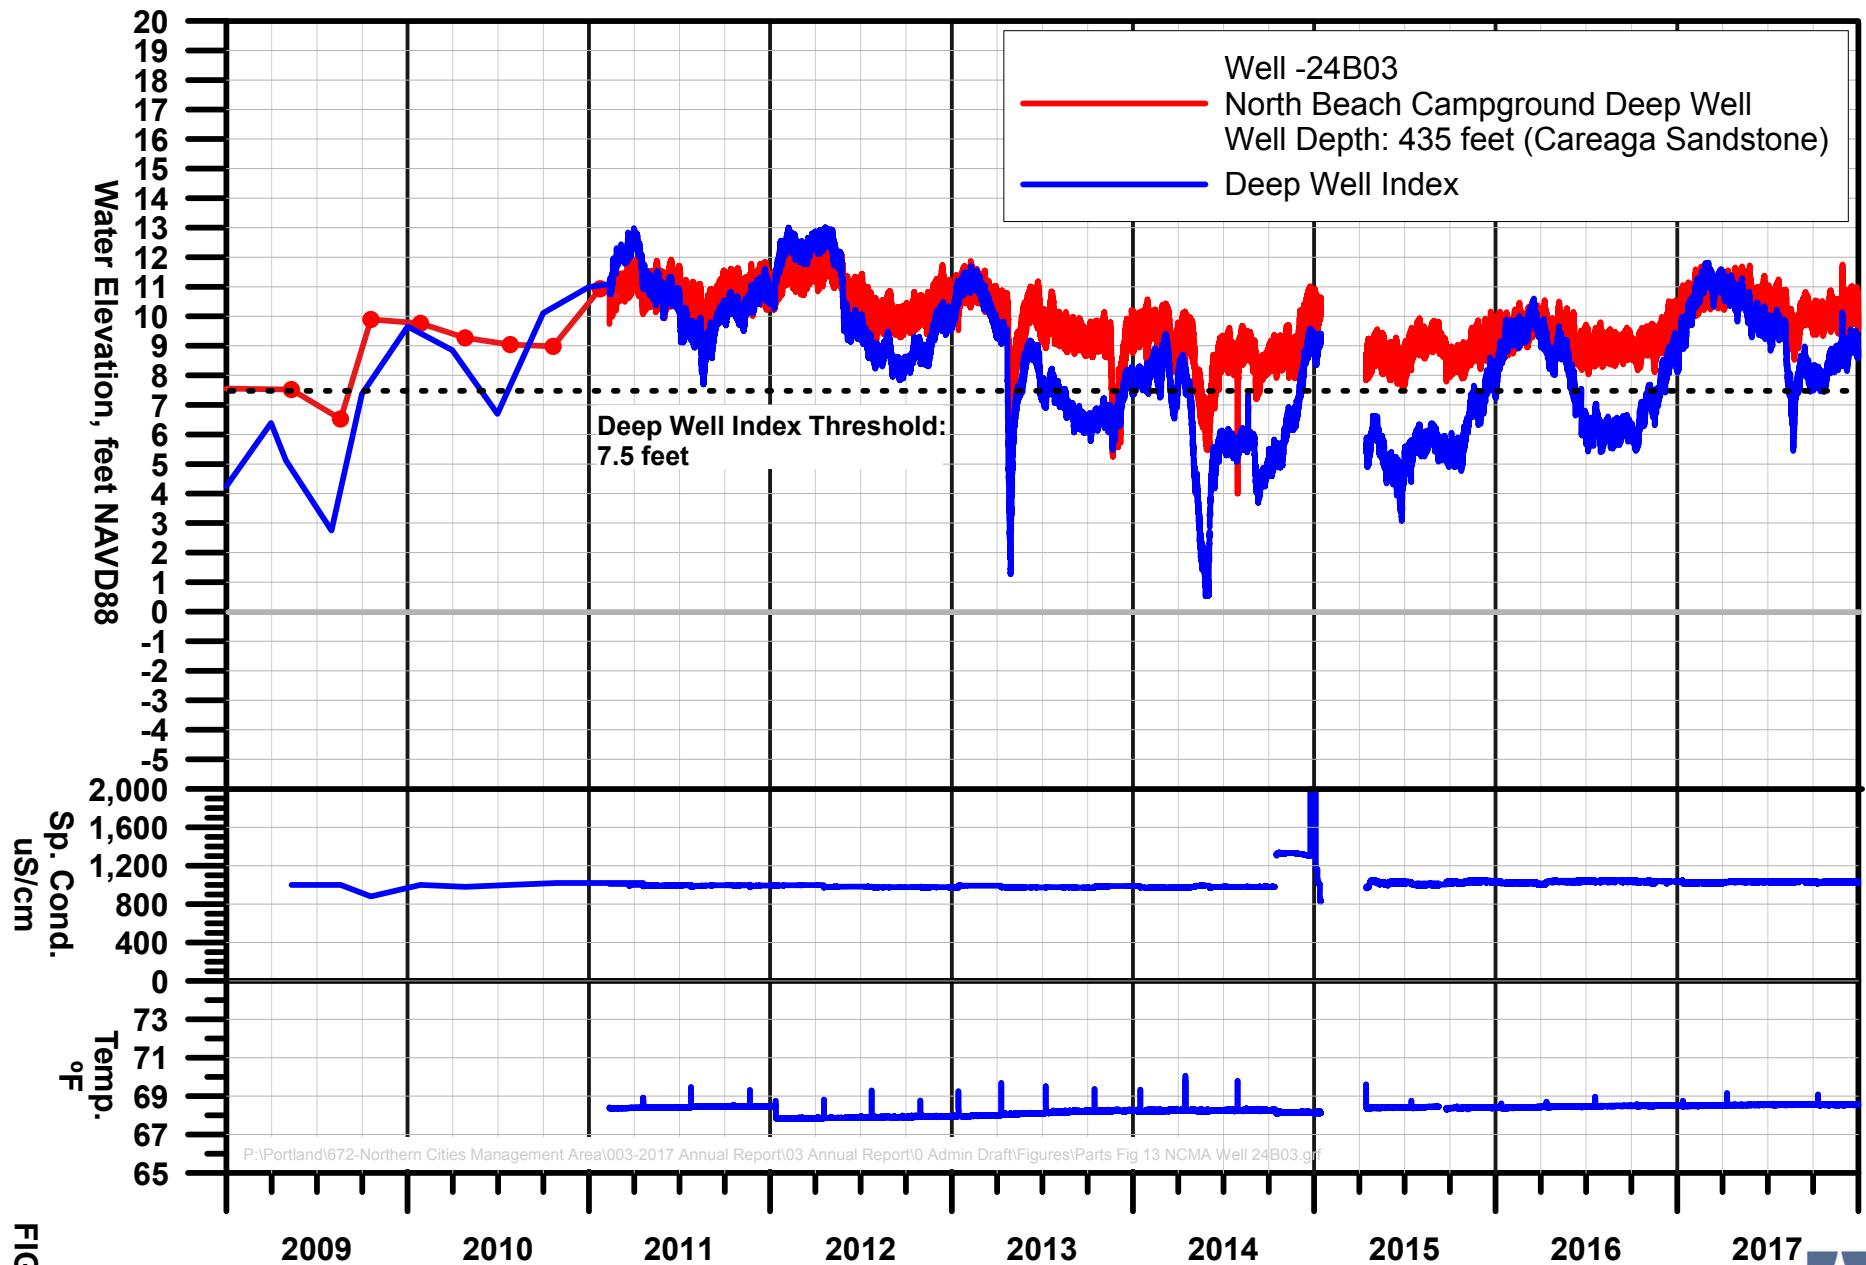



FIGURE 13

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 24B03
 Northern Cities Management Area
 San Luis Obispo County, California

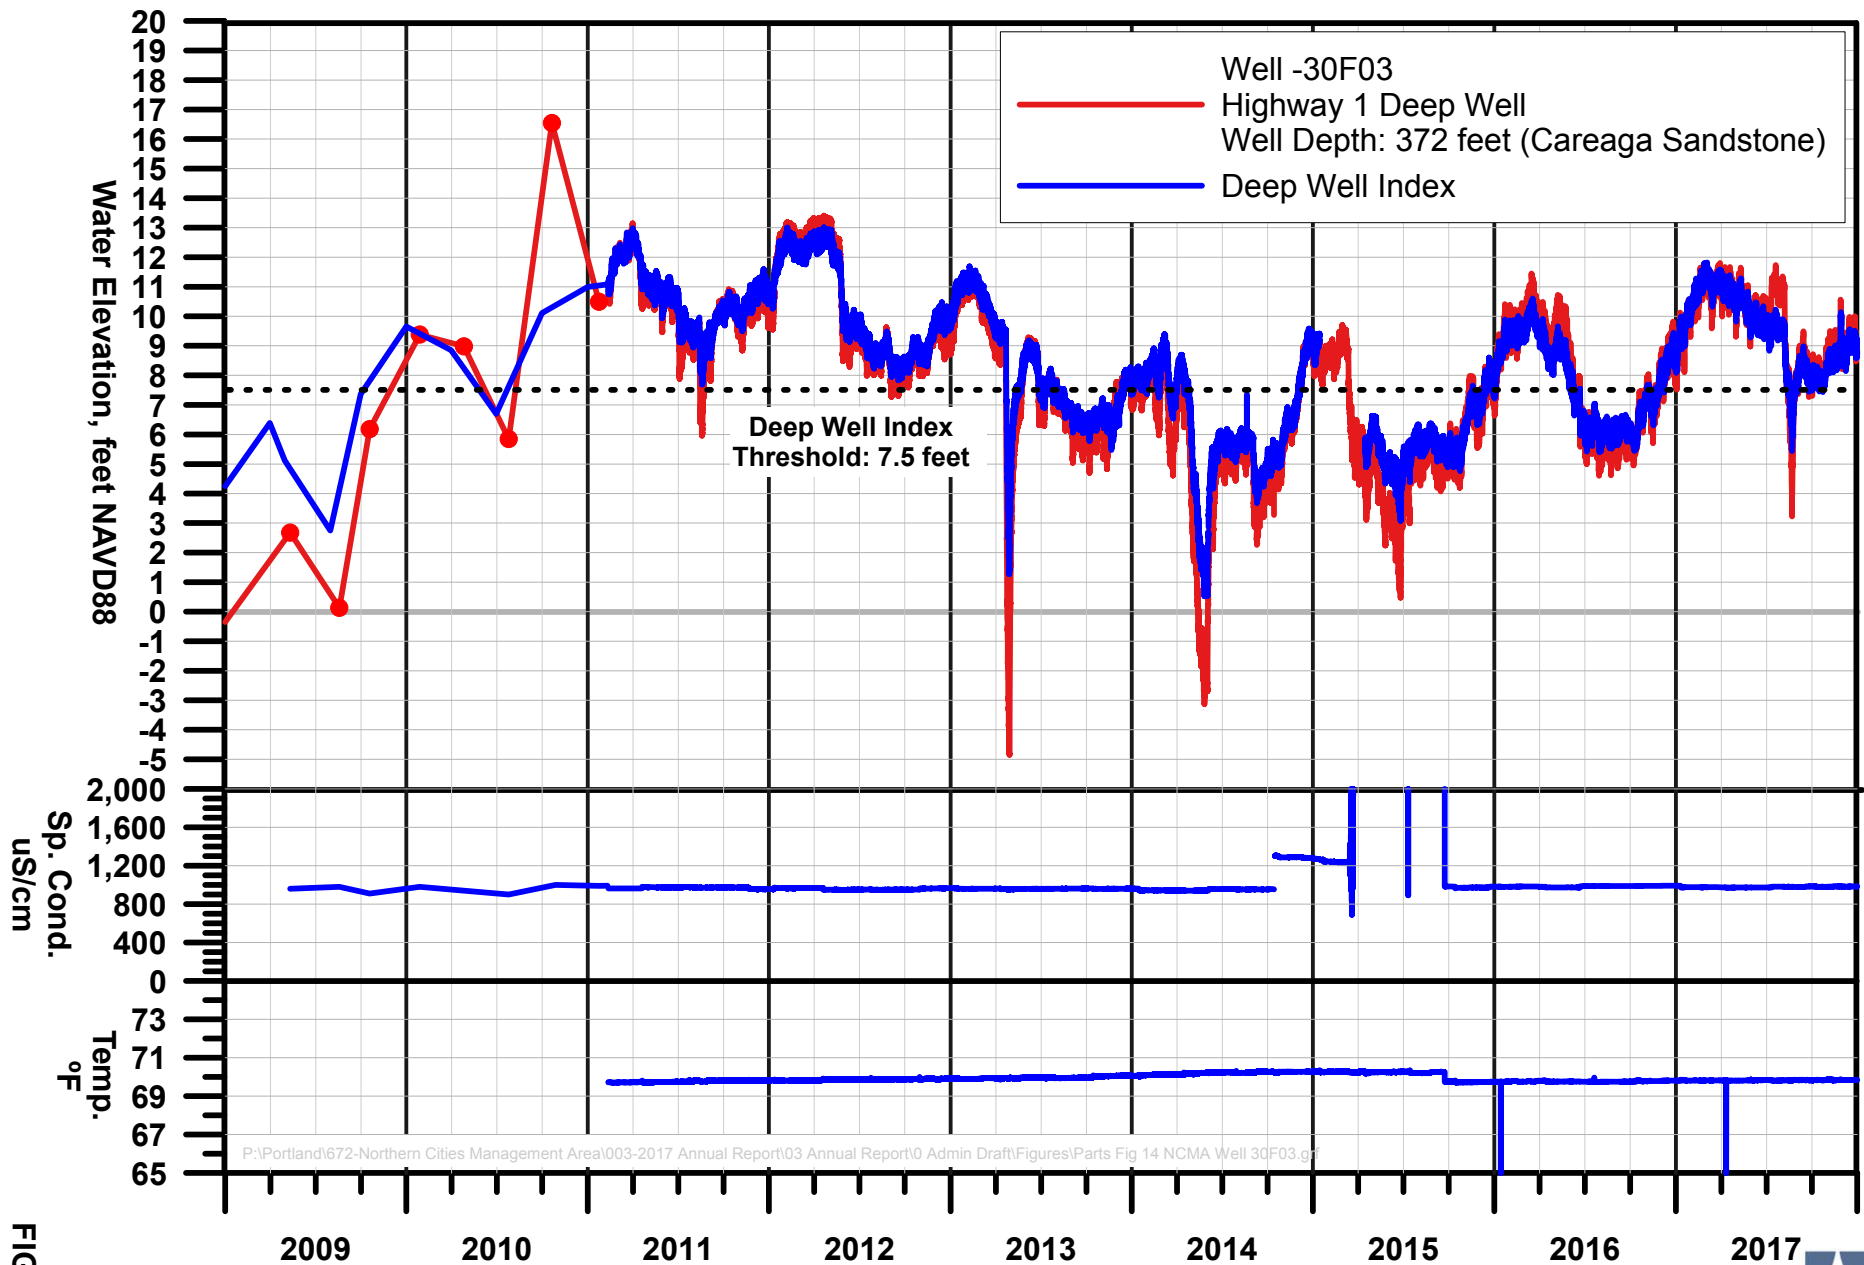

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 30F03
 Northern Cities Management Area
 San Luis Obispo County, California


FIGURE 14

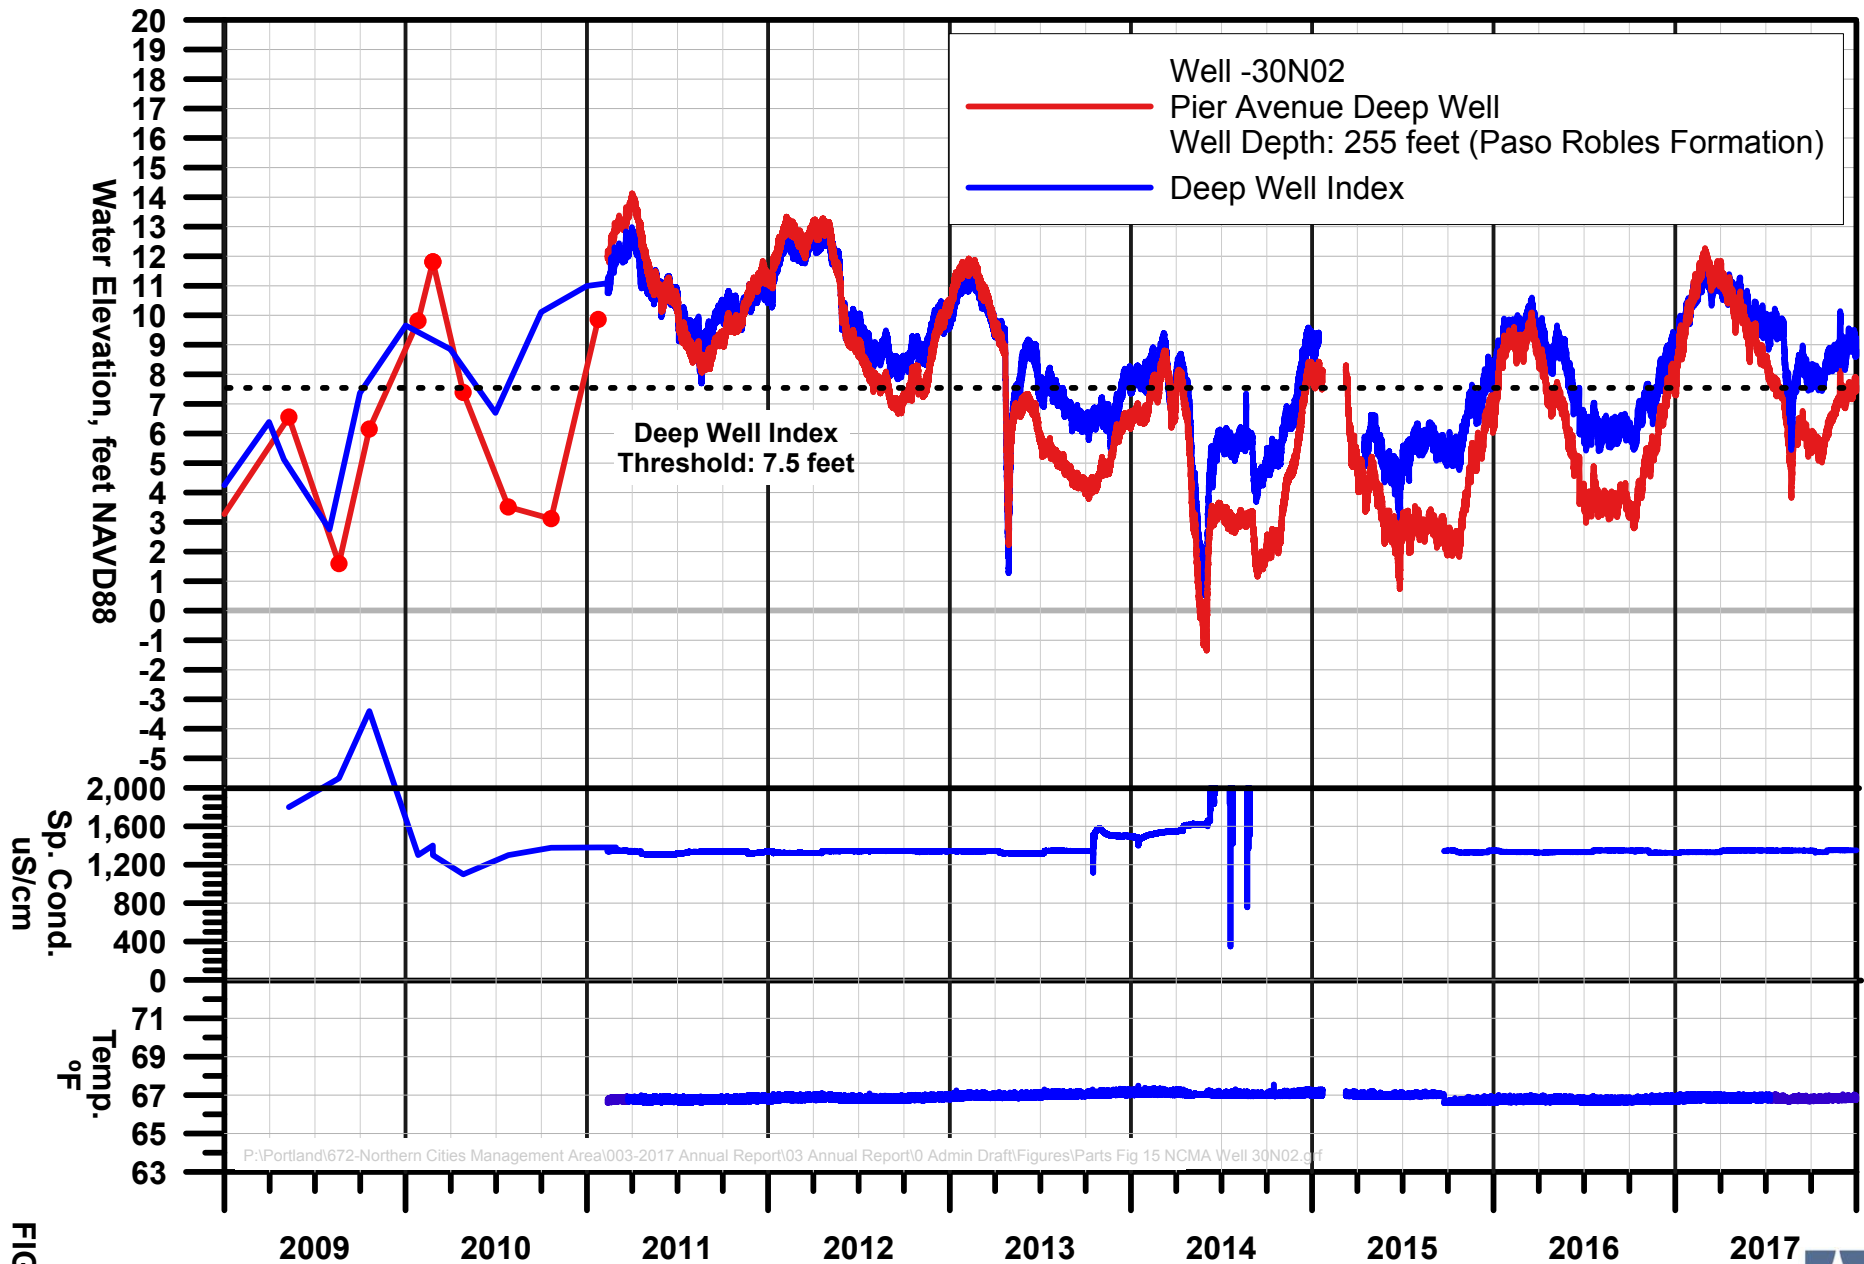

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 30N02
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 15



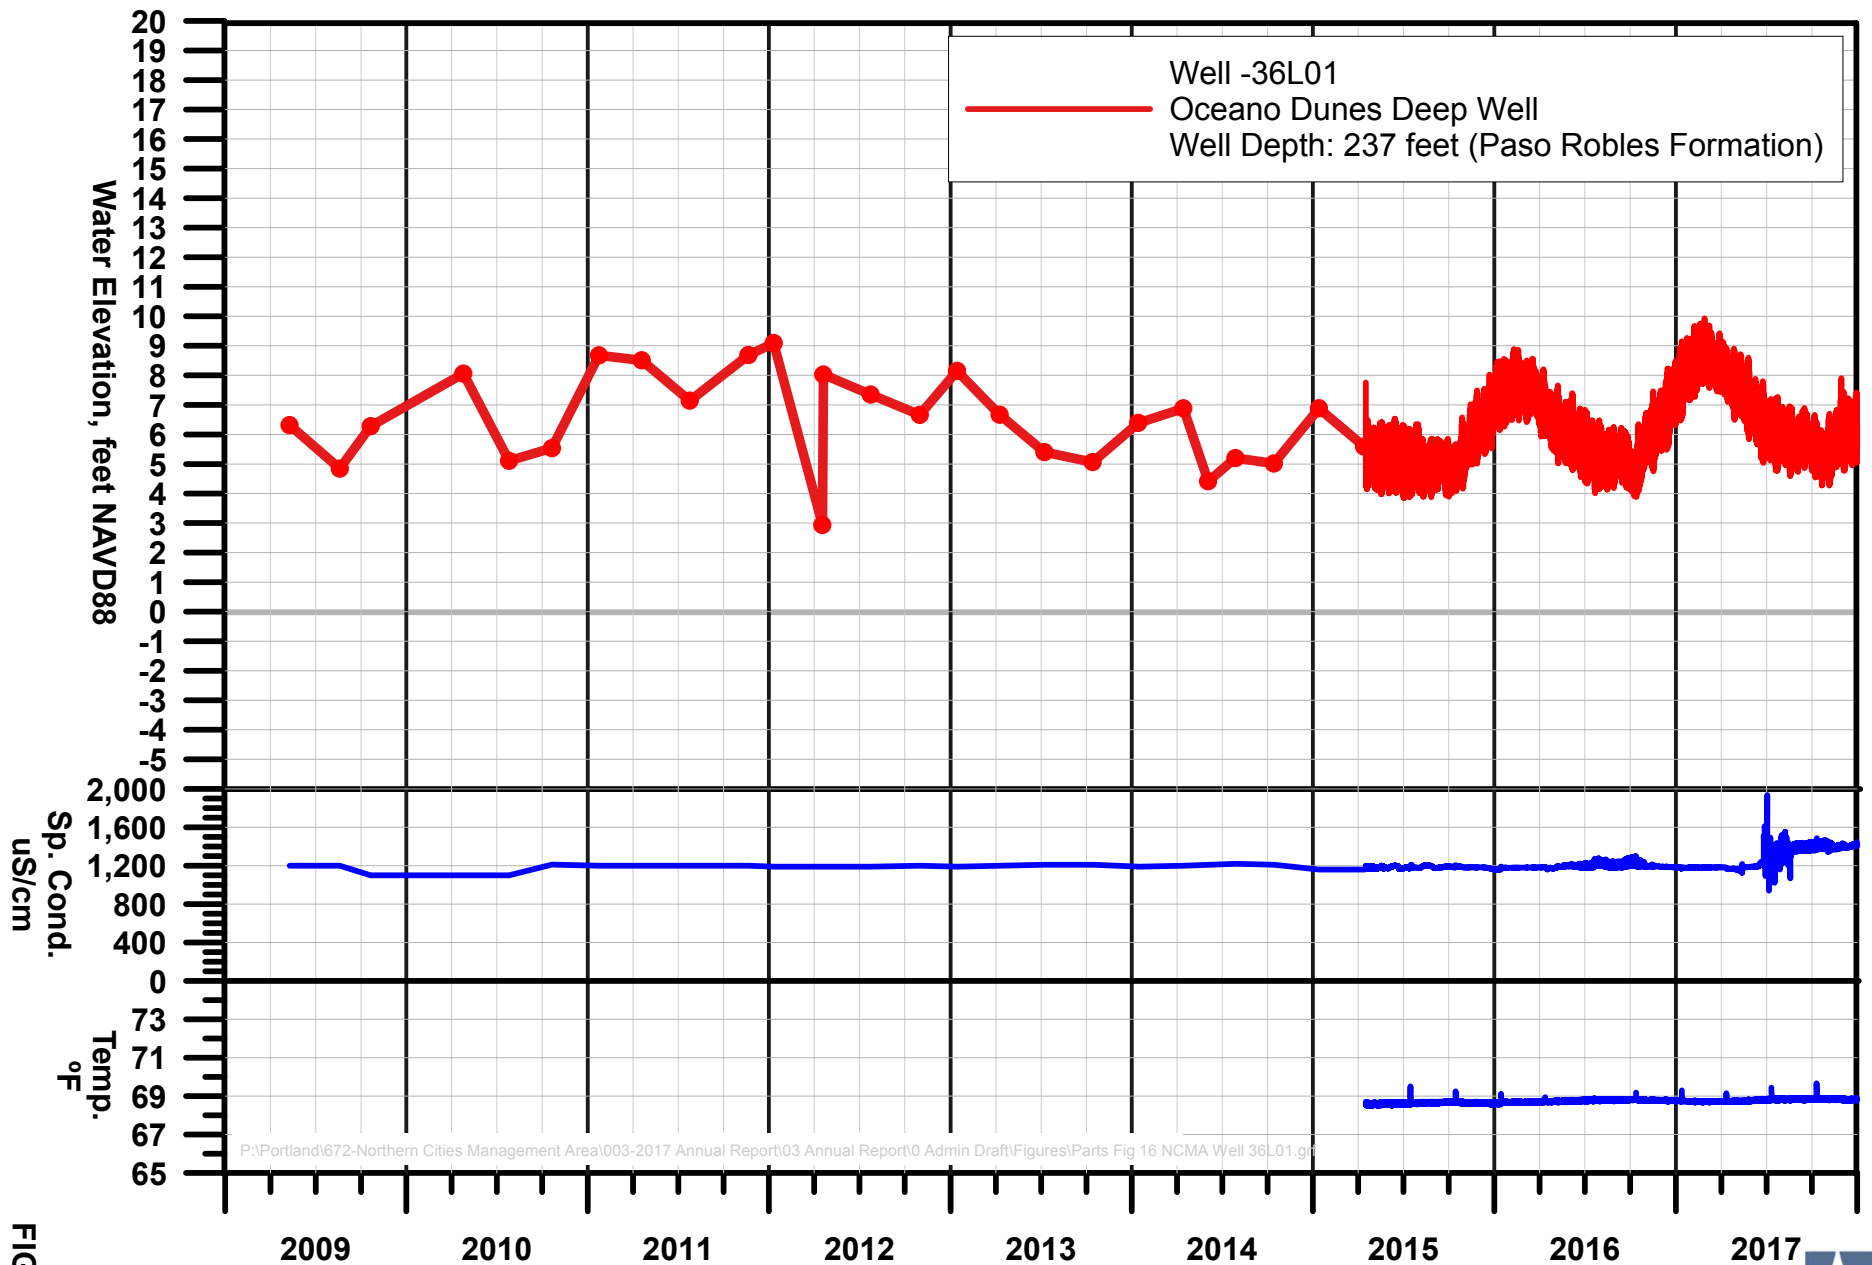


P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 16 NCMA Well 36L01.g

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 36L01
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 16



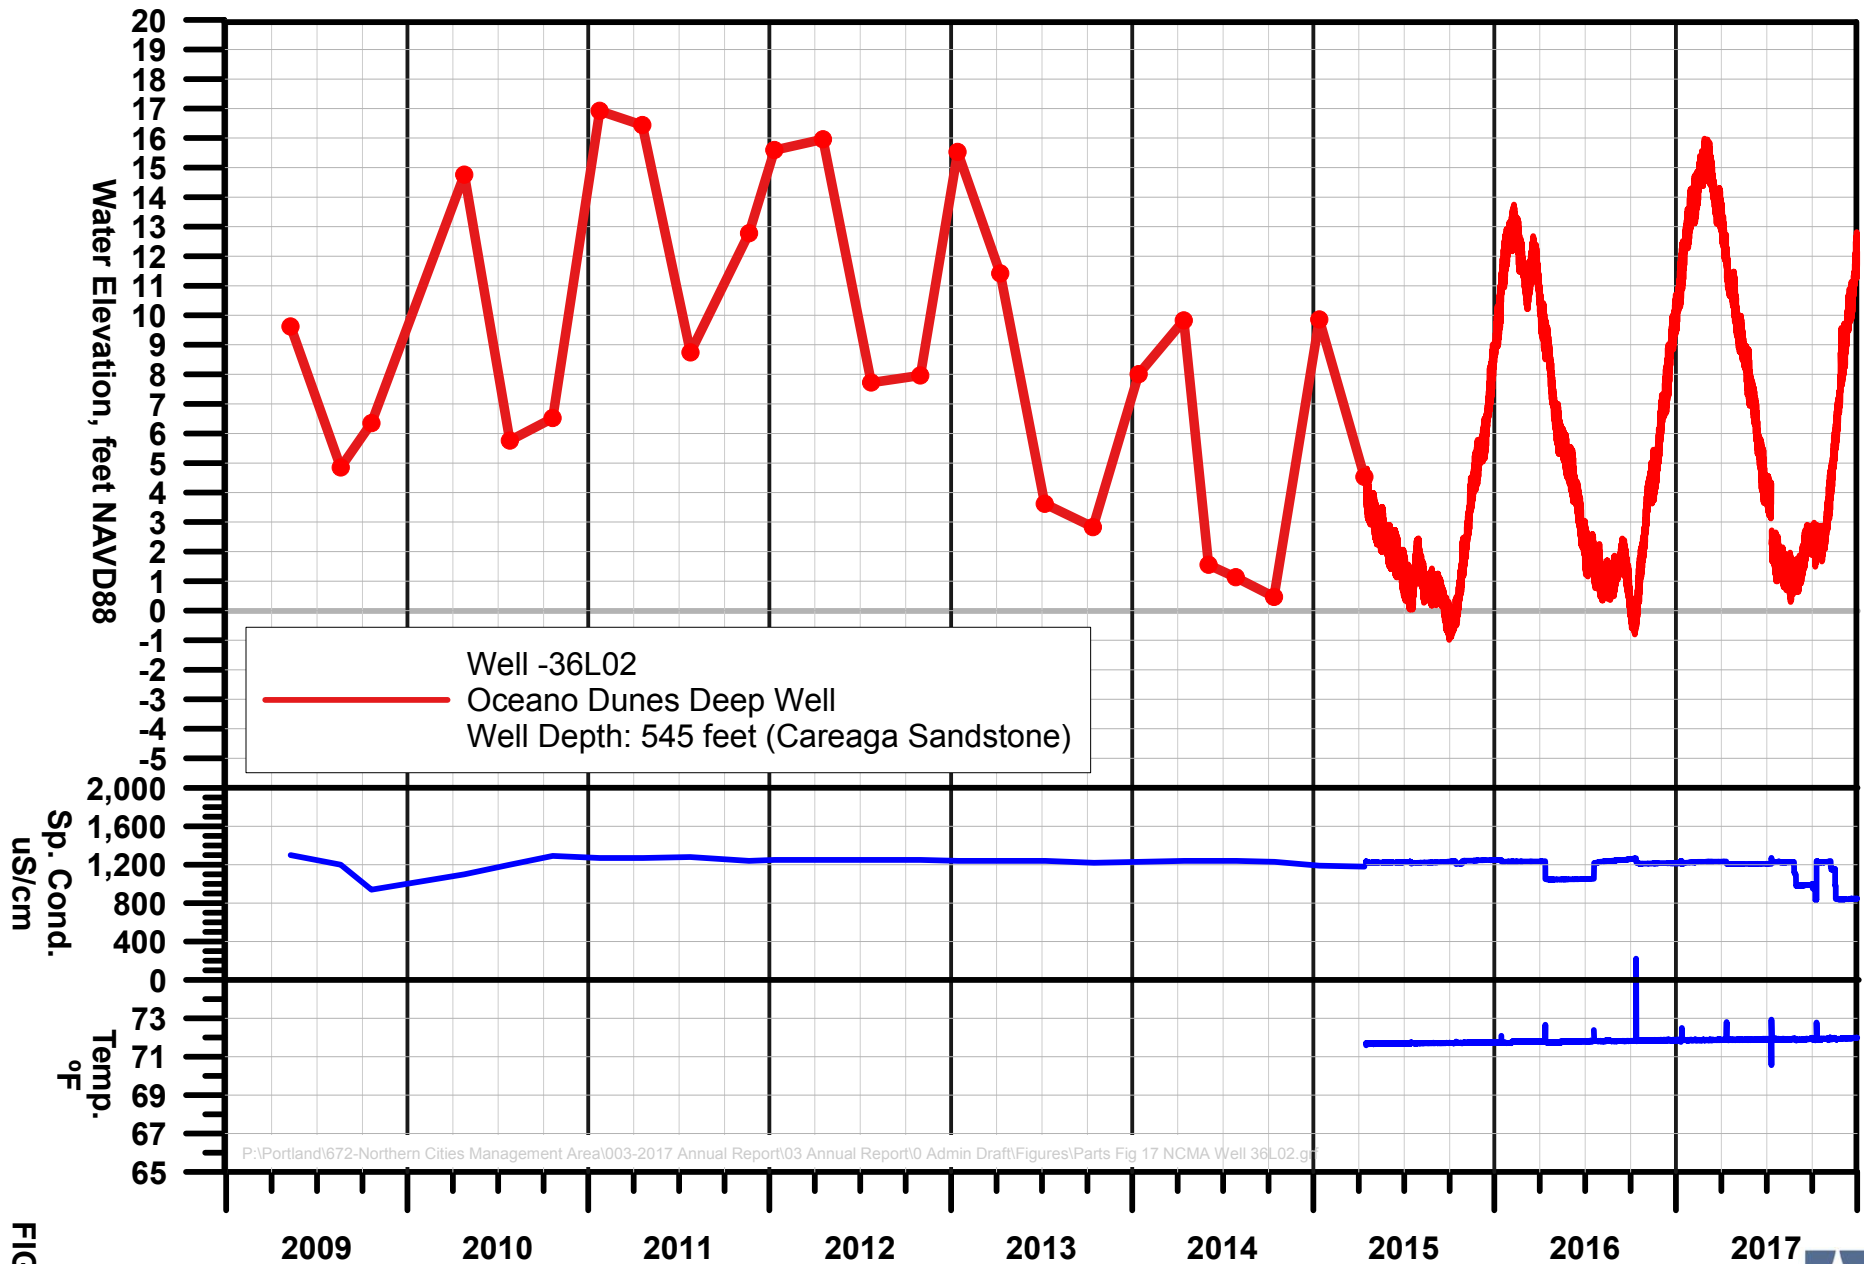

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 36L02
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 17


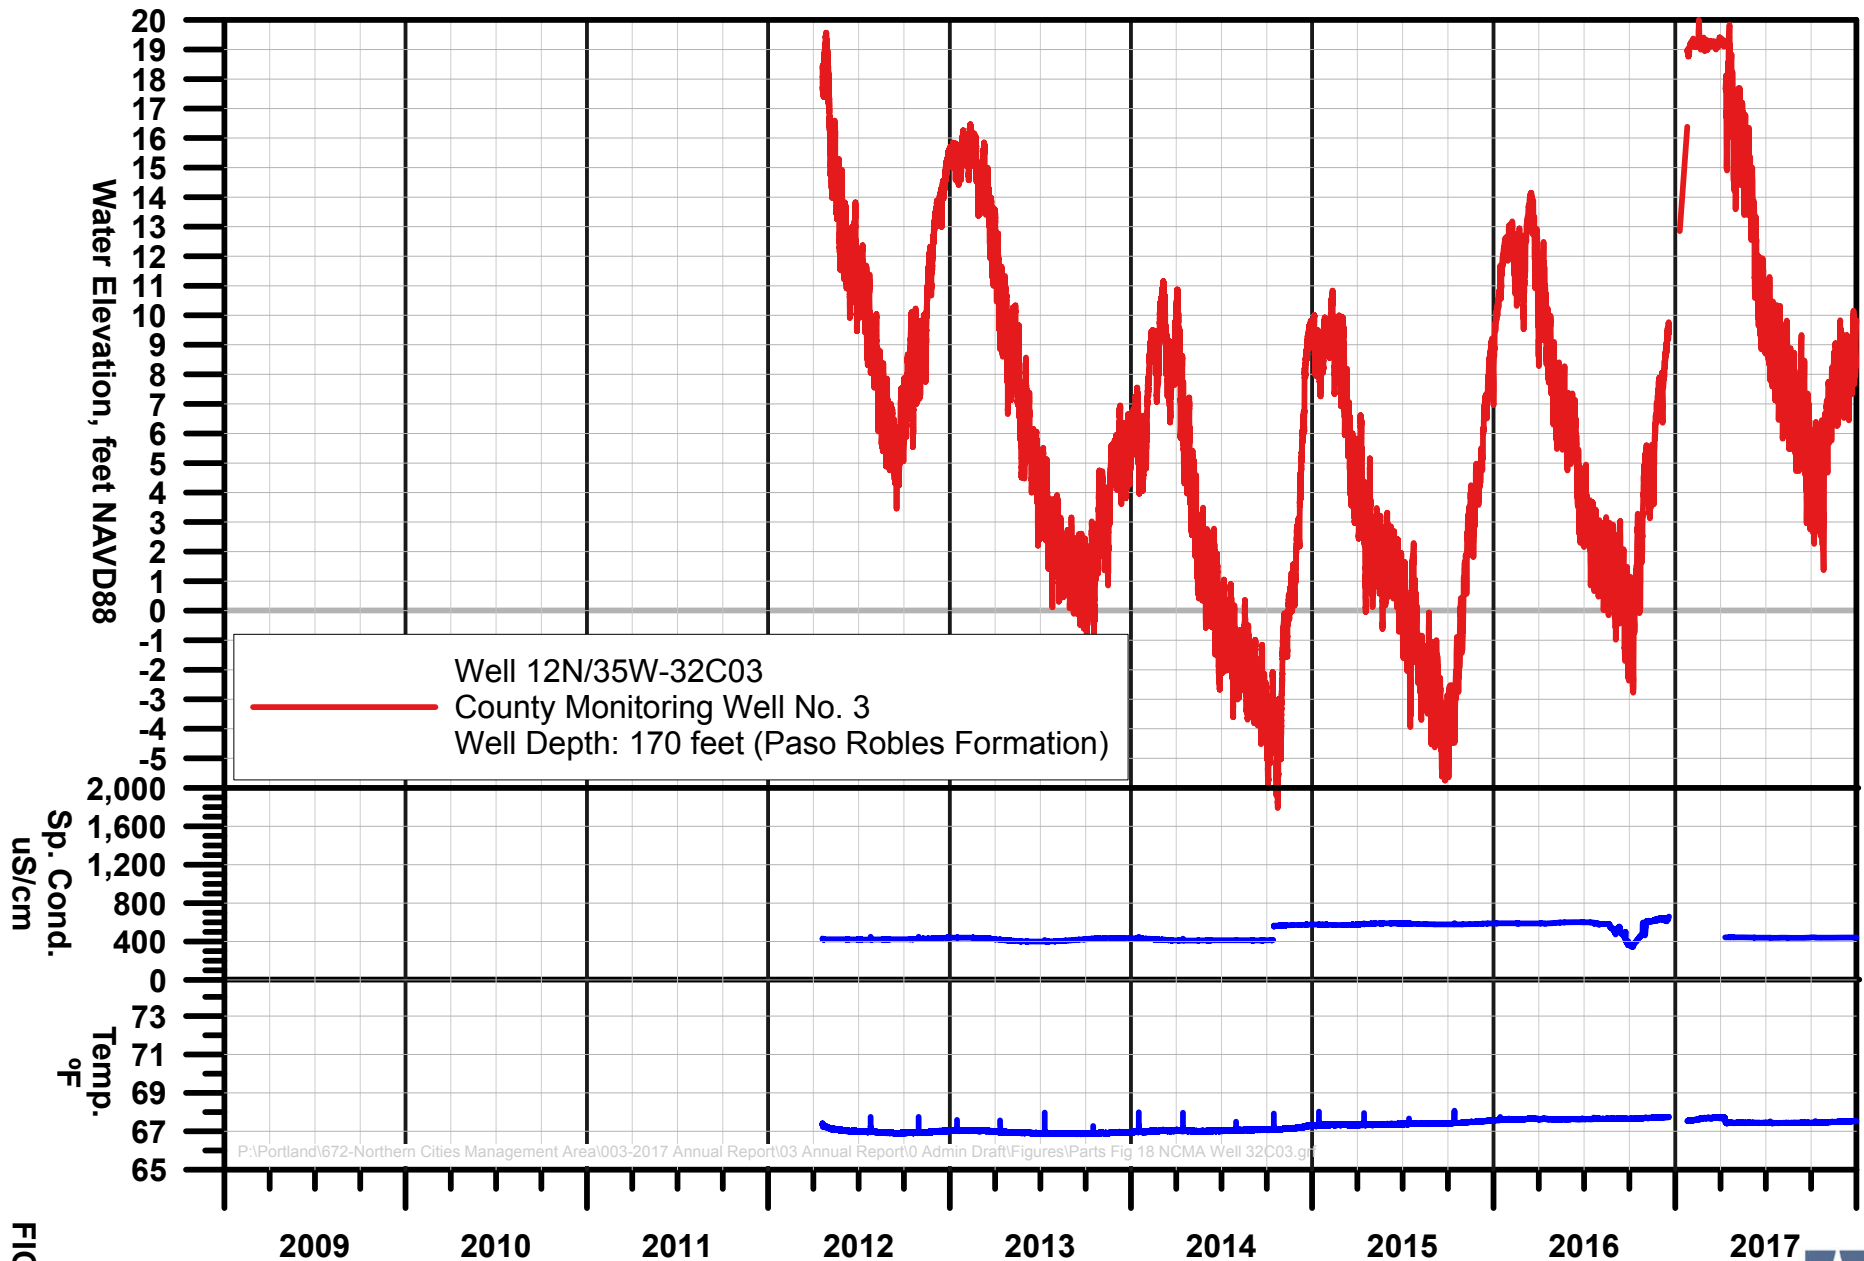


FIGURE 18

WATER ELEVATION, CONDUCTIVITY, AND TEMPERATURE, WELL 32C03
 Northern Cities Management Area
 San Luis Obispo County, California



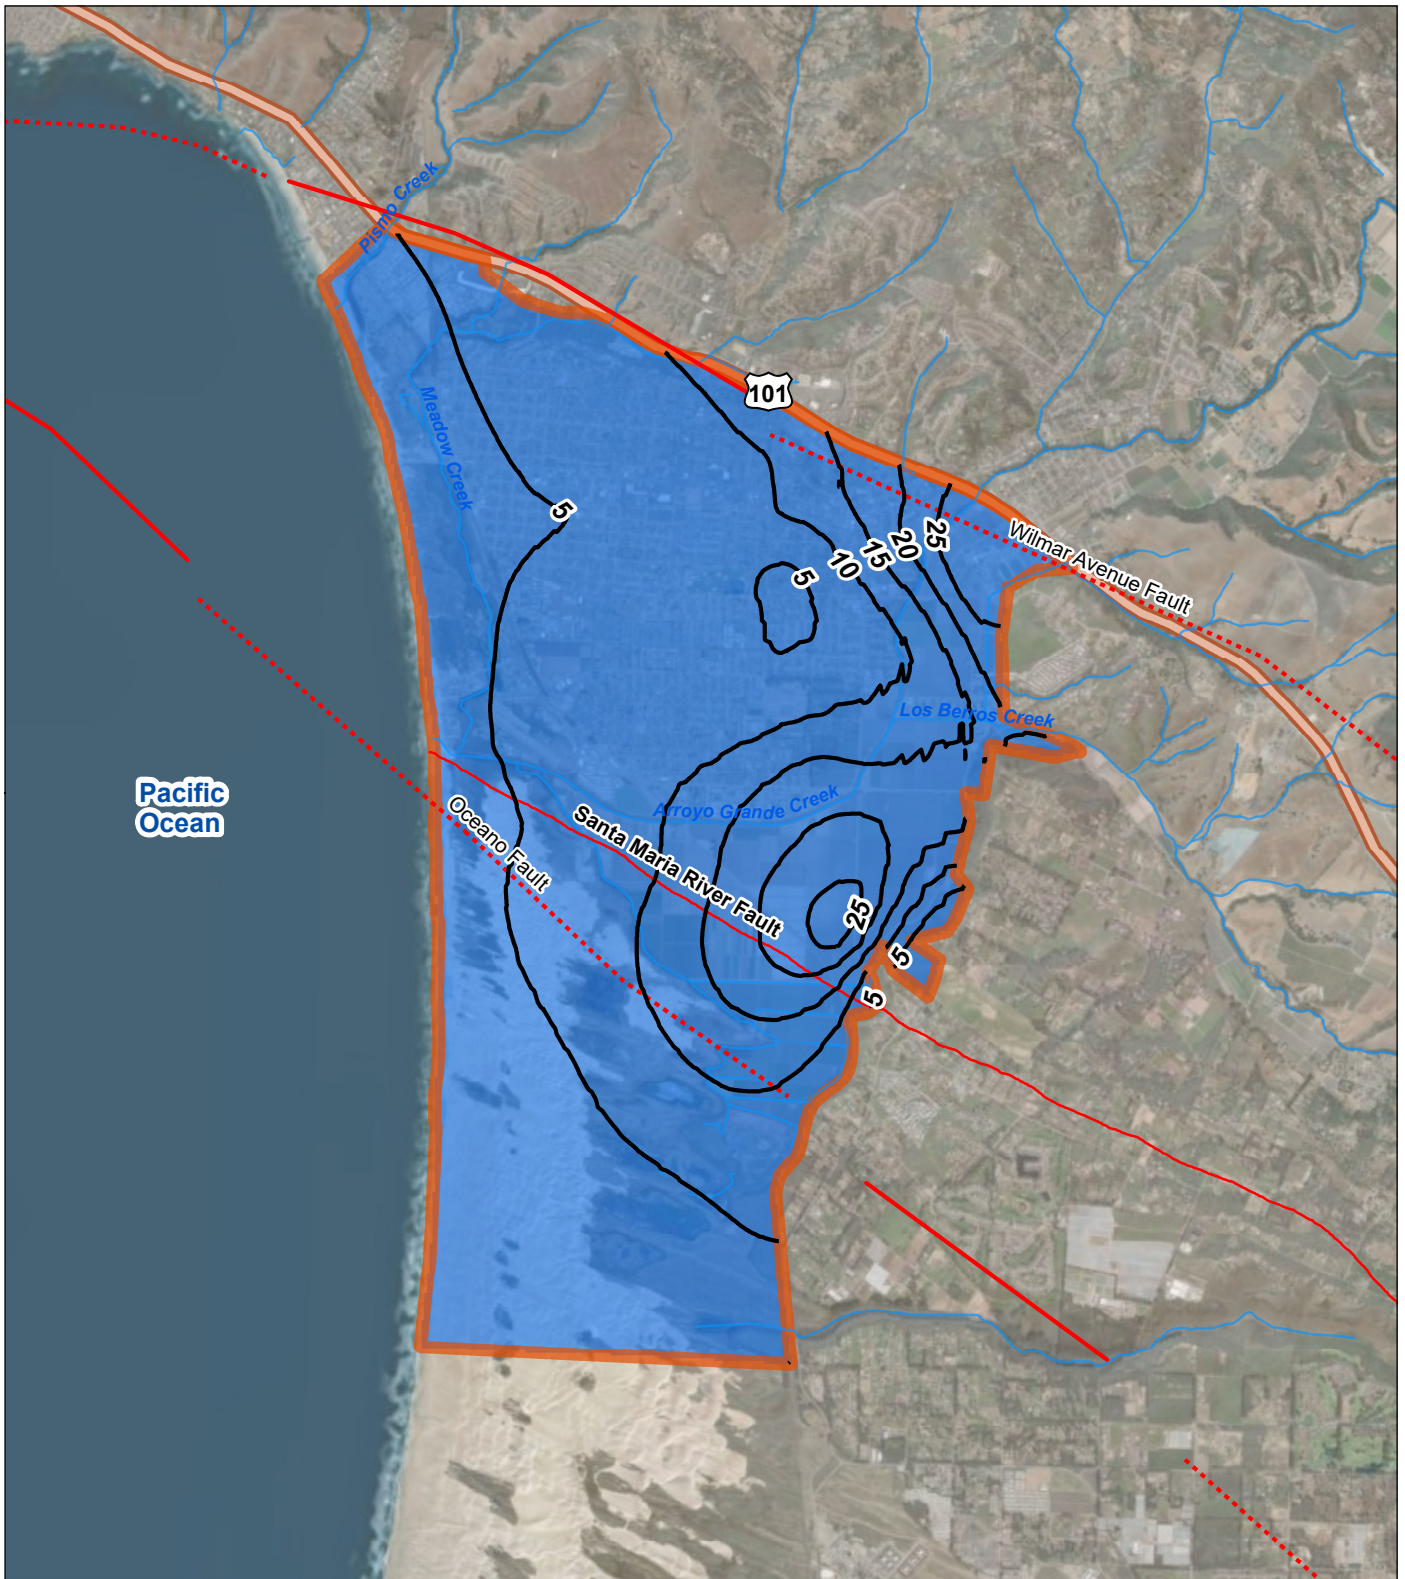

LEGEND









-  Contours of Equal Difference in Water Level, feet
-  Area of Net Rise
-  Area of Net Decline
-  Northern Cities Management Area
-  Streams
-  Faults

FIGURE 19
Change in Groundwater Levels, April 2016 to April 2017
 Northern Cities Management Area
 San Luis Obispo County, California



Chloride Concentration, mg/l

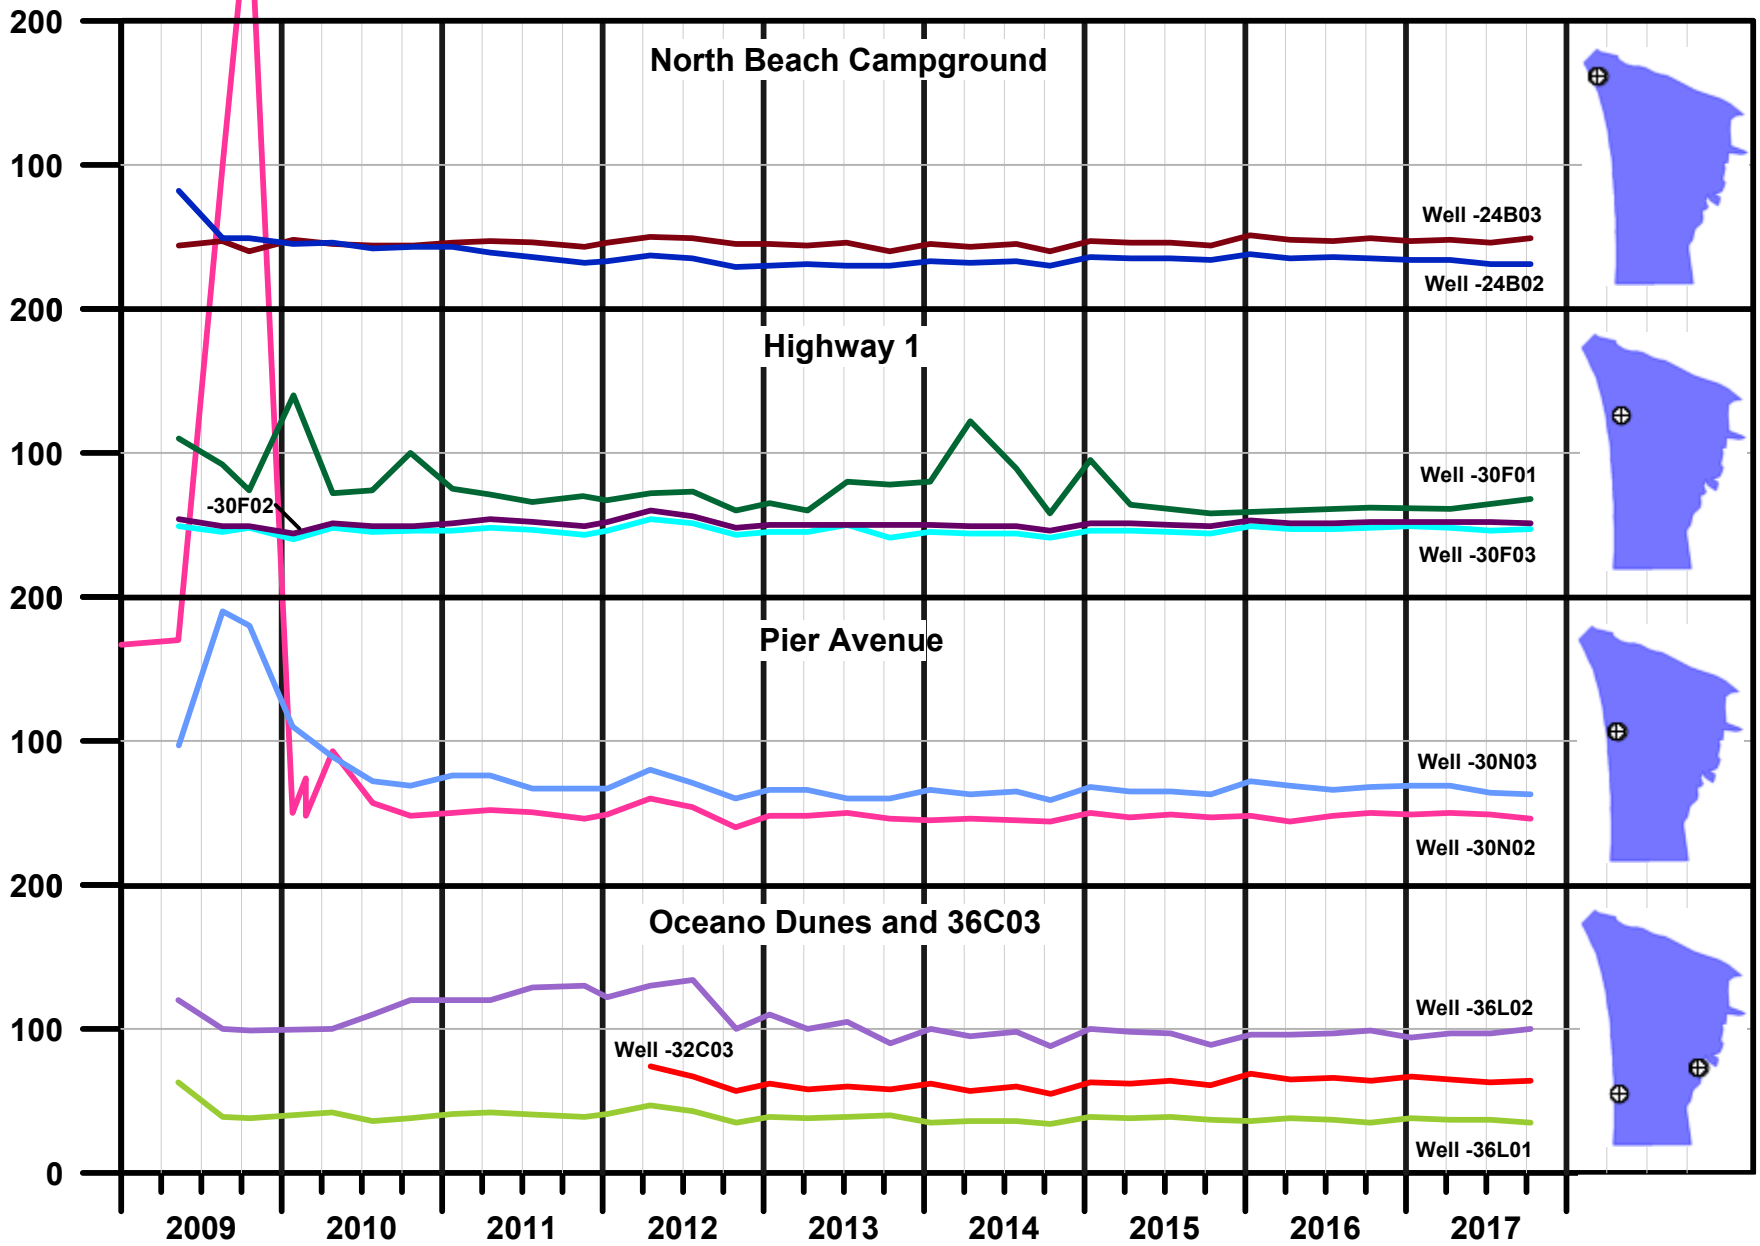


P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 20 NCMA Chloride Grouped.grf

CHLORIDE CONCENTRATIONS IN MONITORING WELLS
Northern Cities Management Area
San Luis Obispo County, California

FIGURE 20



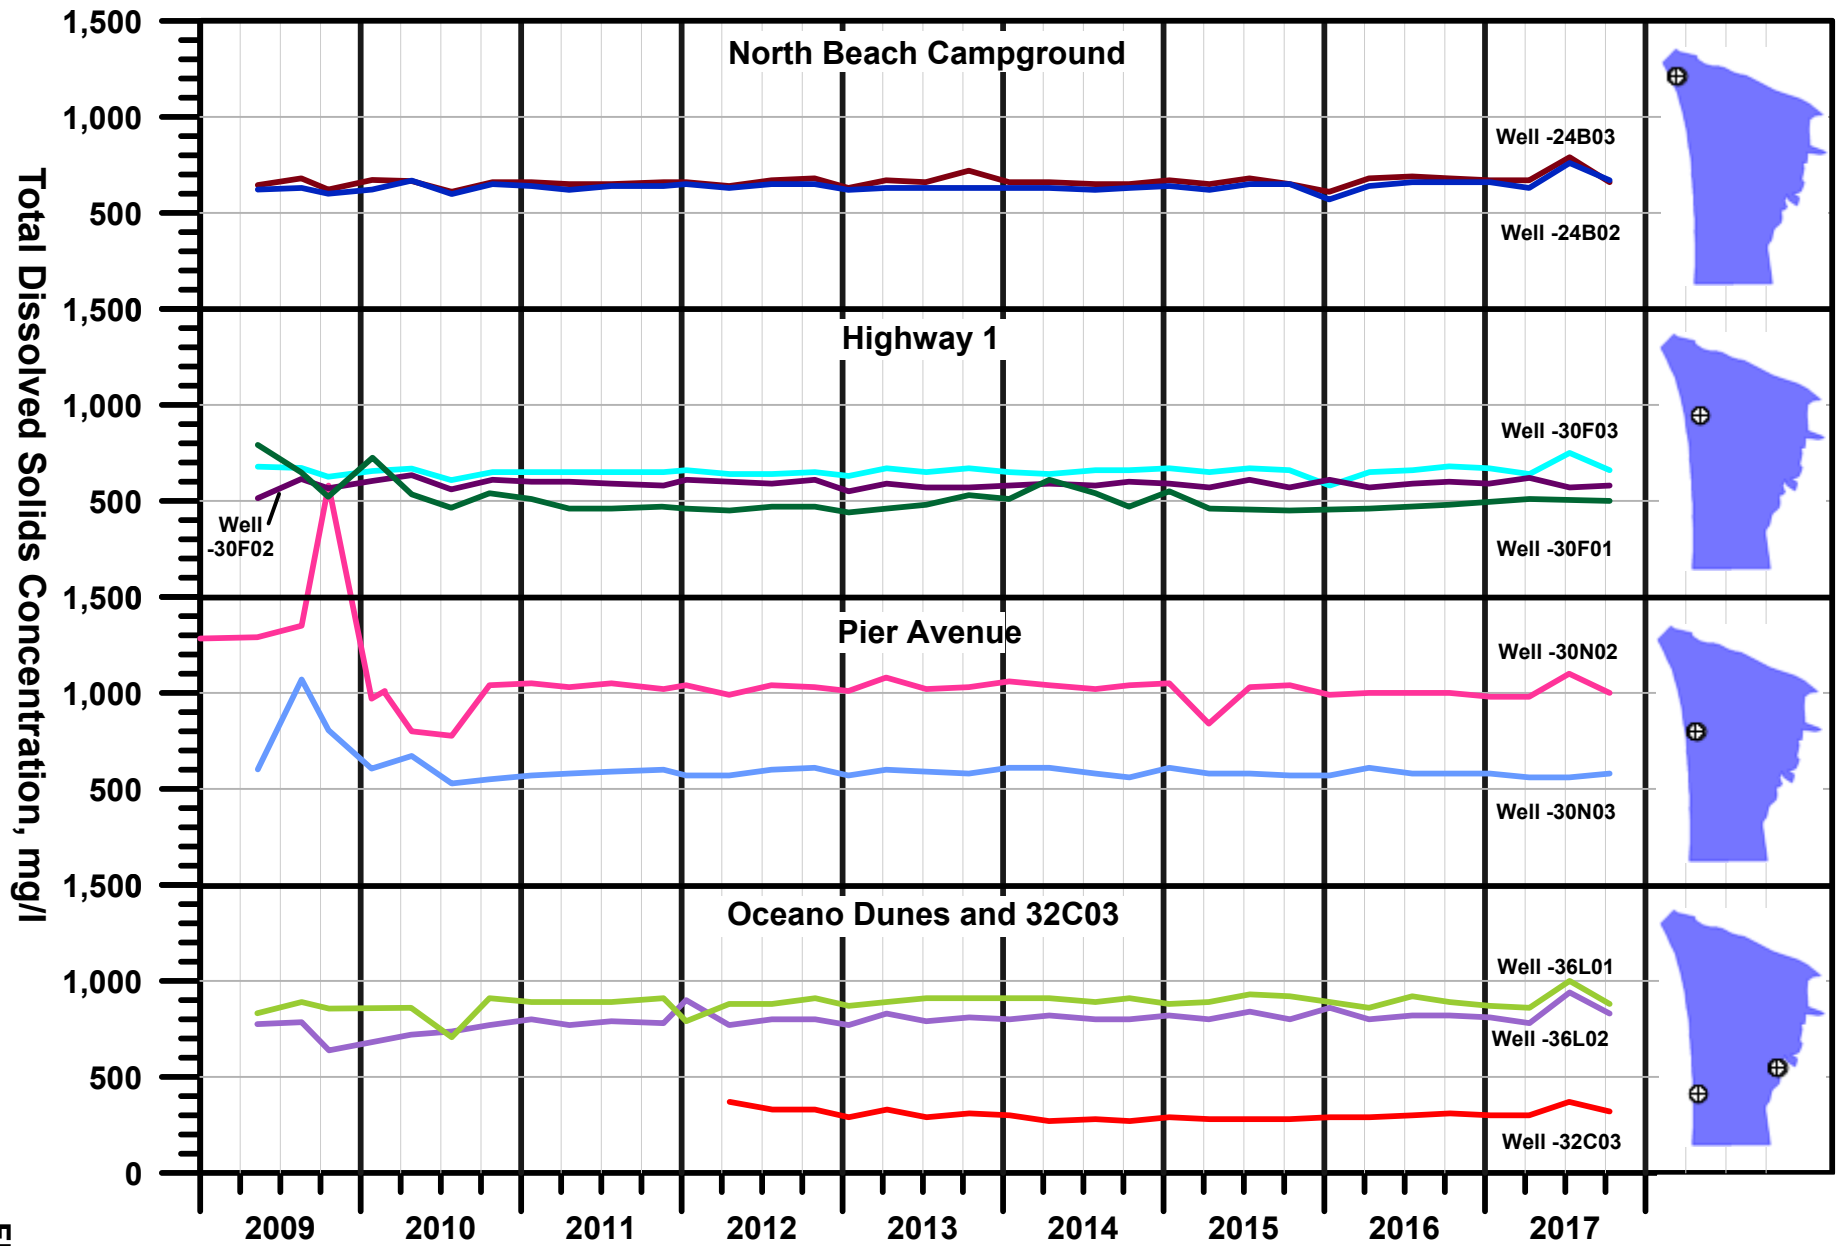


P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 21 NCMA TDS Grouped.grf

TOTAL DISSOLVED SOLIDS CONCENTRATIONS IN MONITORING WELLS
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 21



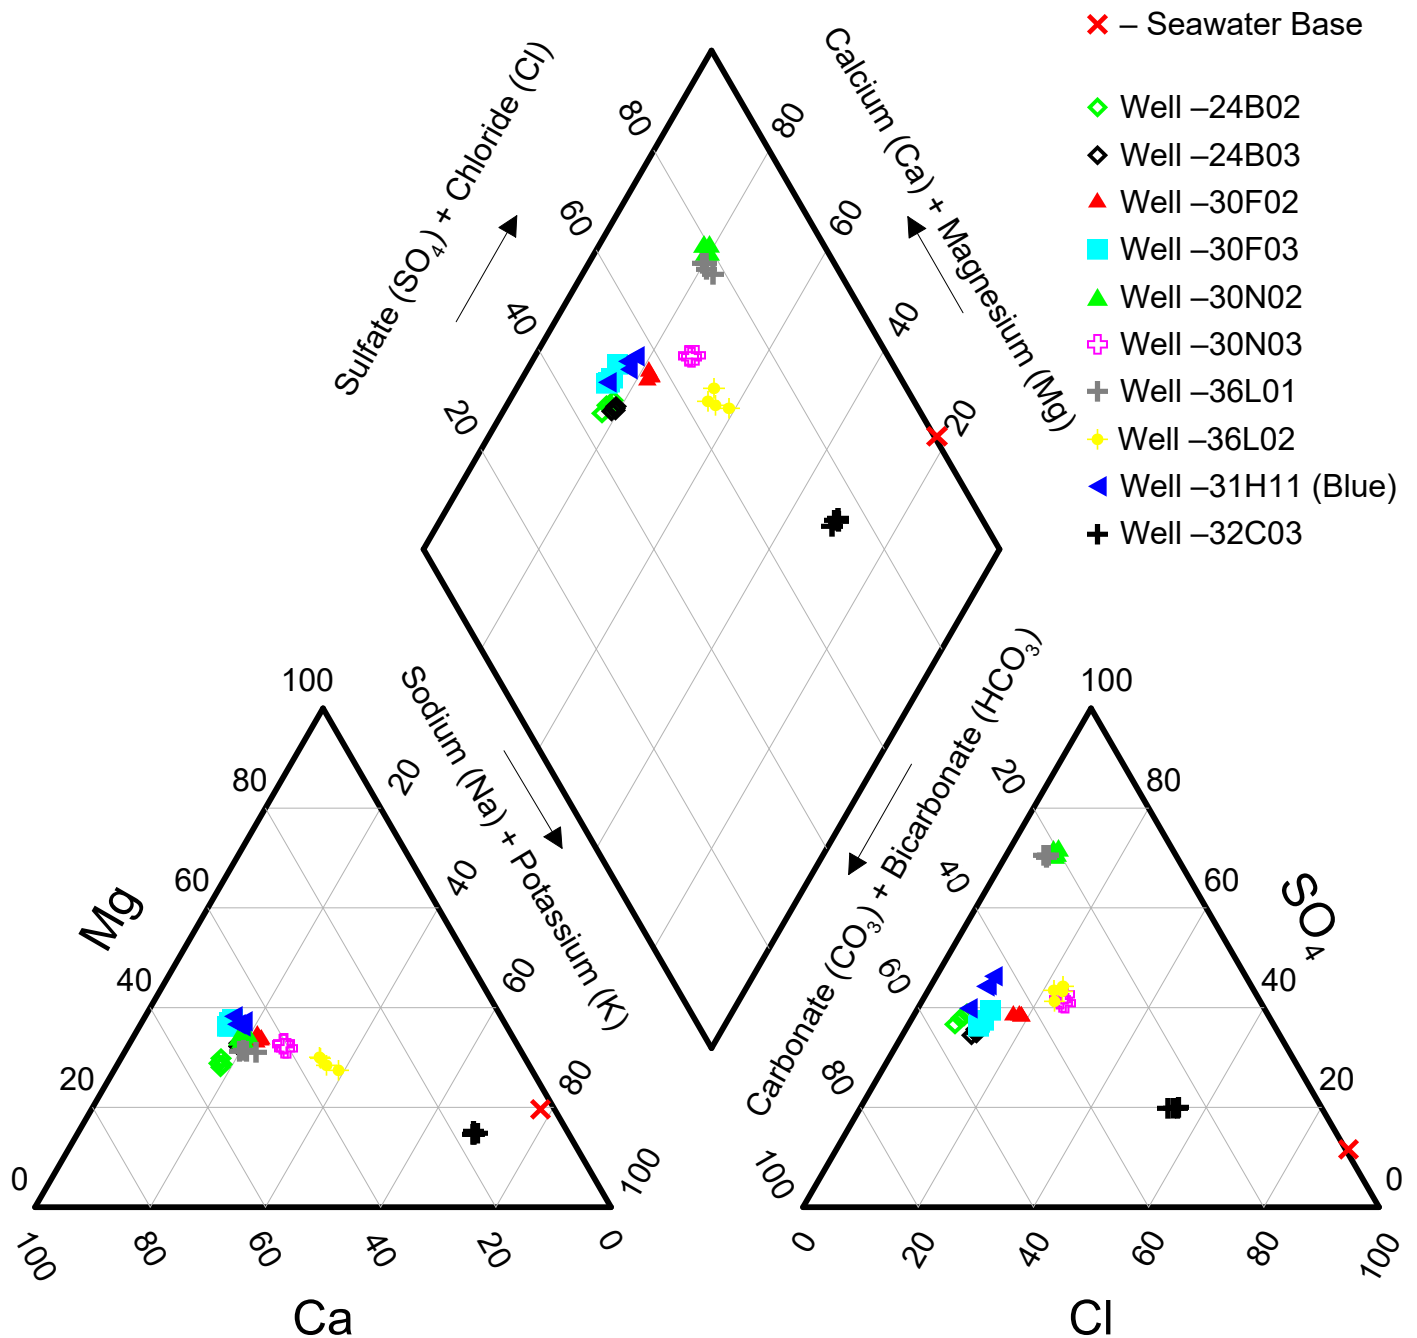

P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 22 NCMA Piper Diagram.grf

Note: Data include "middle" and "deep" wells from 2017 quarterly sampling events.



PIPER DIAGRAM OF WATER QUALITY IN SELECT MONITORING WELLS
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 22


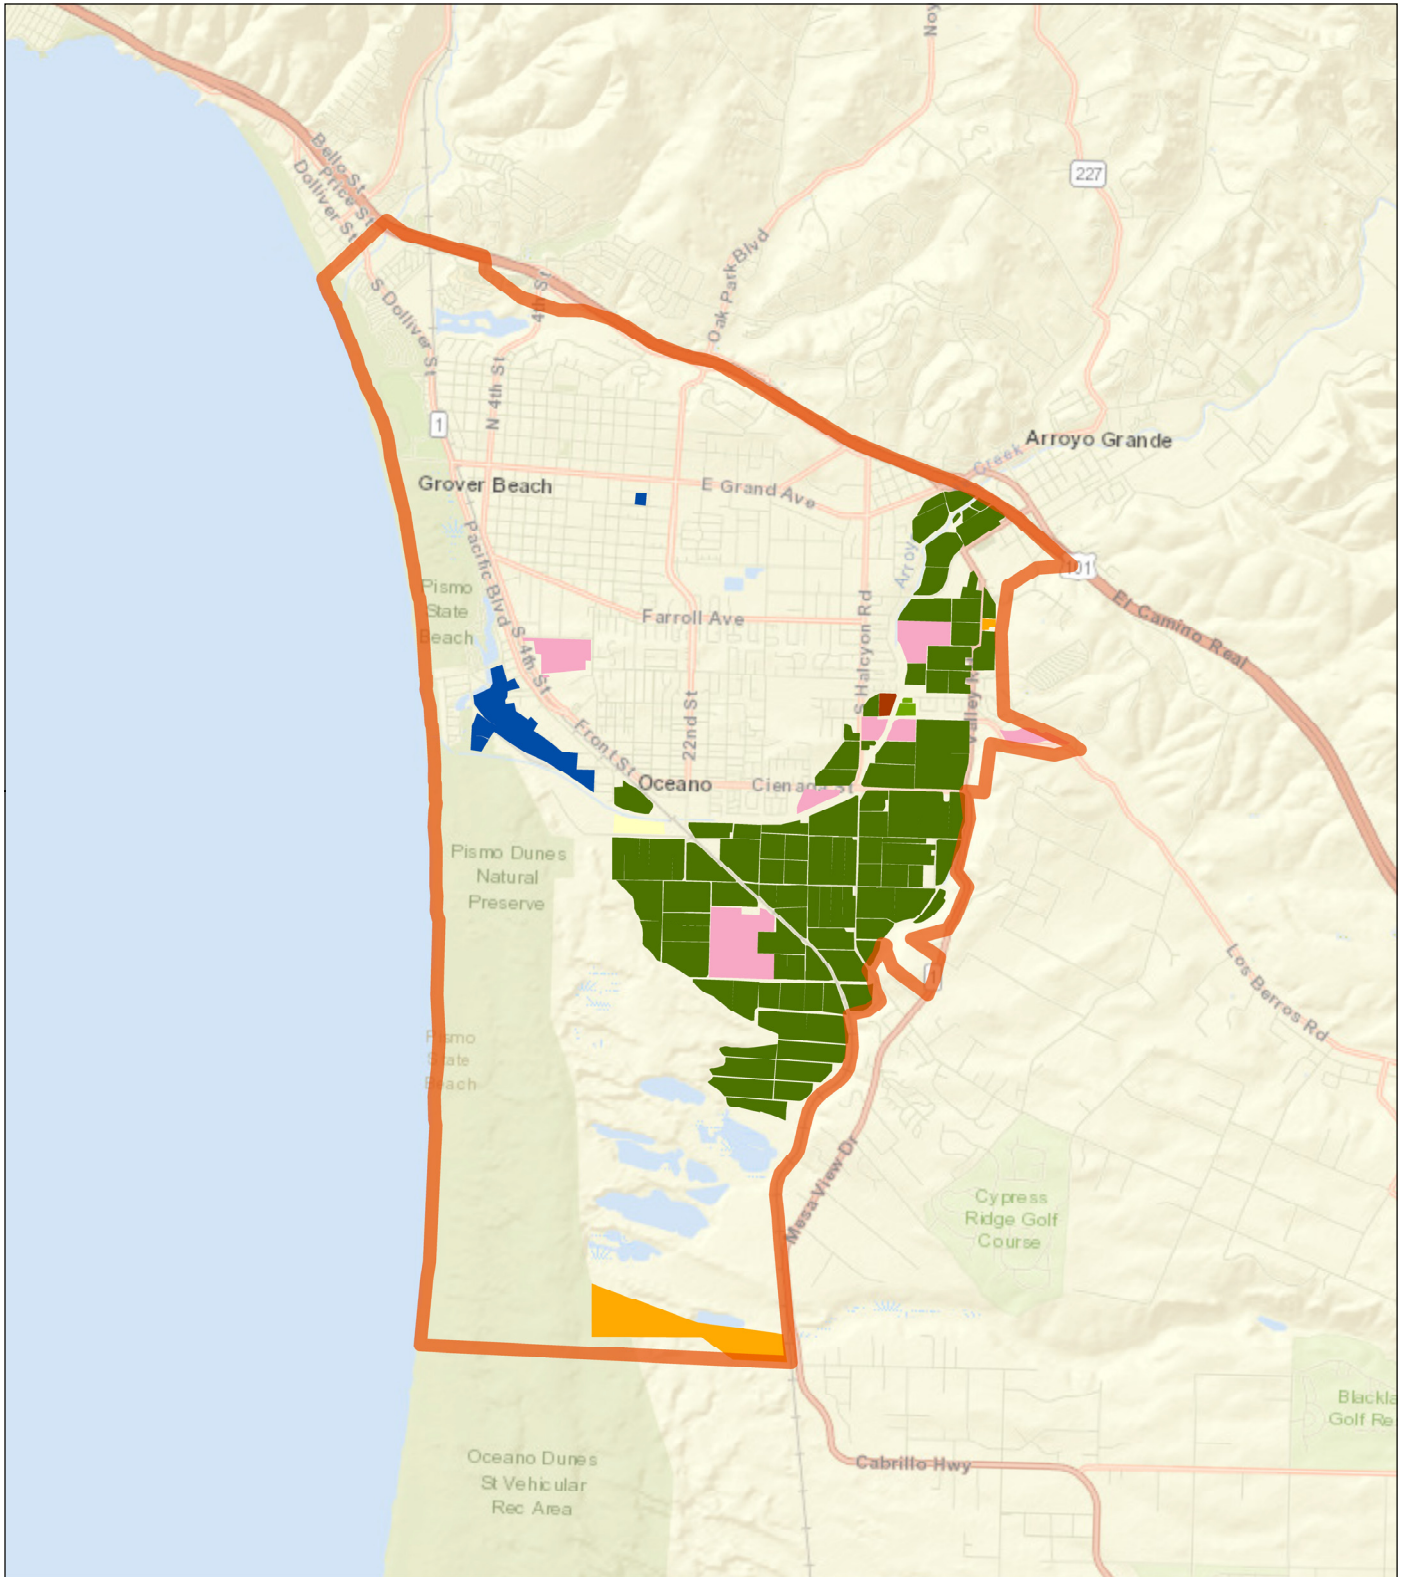


FIGURE 23

NCMA Agricultural Land 2017
Northern Cities Management Area
San Luis Obispo County, California


LEGEND

- Northern Cities Management Area
- Landscape Main
- Garden Transplant Plants
- Outdoor Transplant Plants
- Potatoes
- Rotational Crops
- Strawberry
- Uncultivated Land



Date: January 26, 2018
Data Sources:

2017 Crop Total Applied Water and Precipitation




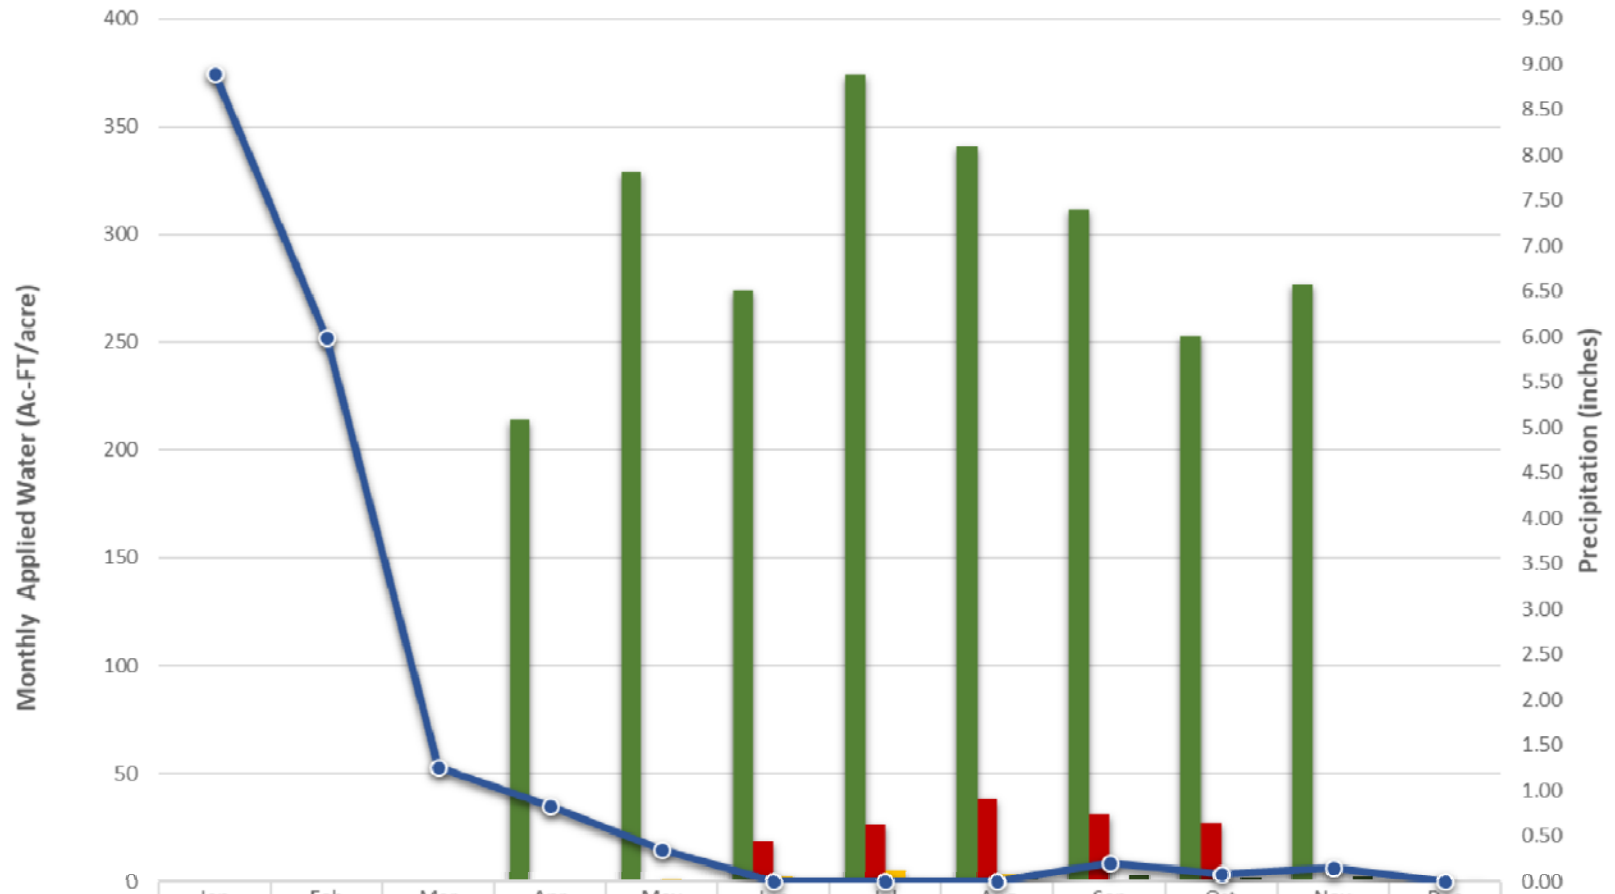


| | Jan | Feb | Mar | Apr | May | Jun | Jul | Aug | Sep | Oct | Nov | Dec |
|--------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| Rotational Crops | 0 | 0 | 0 | 214 | 329 | 274 | 374 | 341 | 312 | 253 | 277 | 0 |
| Strawberries | 0 | 0 | 0 | 0 | 0 | 19 | 26 | 38 | 31 | 27 | 0 | 0 |
| Potatoes | 0 | 0 | 0 | 0 | 1 | 3 | 5 | 3 | 0 | 0 | 0 | 0 |
| Nursery Plants | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 3 | 3 | 2 | 2 | 0 |
| Precipitation (in) | 8.90 | 5.99 | 1.26 | 0.83 | 0.35 | 0.00 | 0.00 | 0.00 | 0.20 | 0.08 | 0.15 | 0.00 |

FIGURE 24

2017 ESTIMATED AGRICULTURAL WATER DEMAND AND MONTHLY PRECIPITATION AT THE CIMIS NIPOMO STATION
Northern Cities Management Area
San Luis Obispo County, California



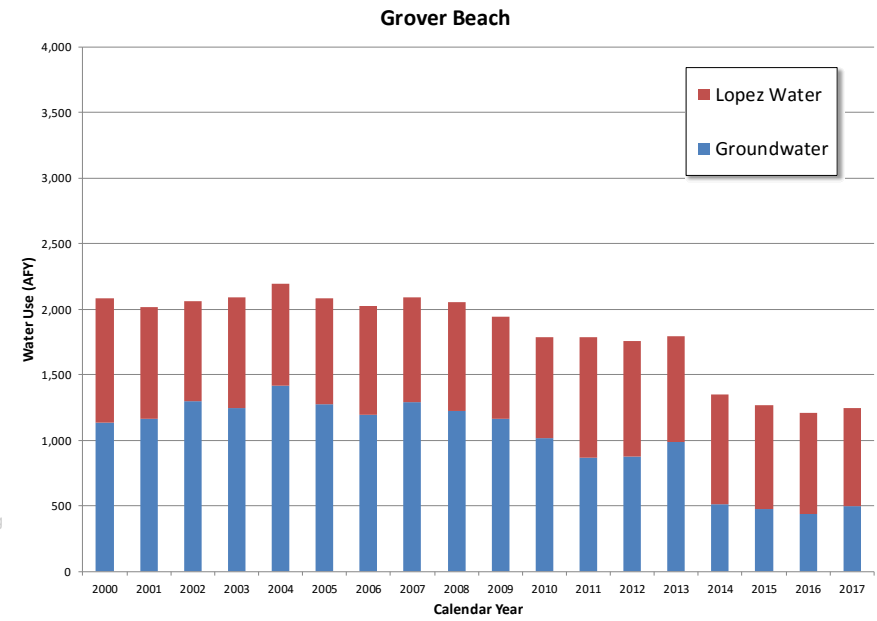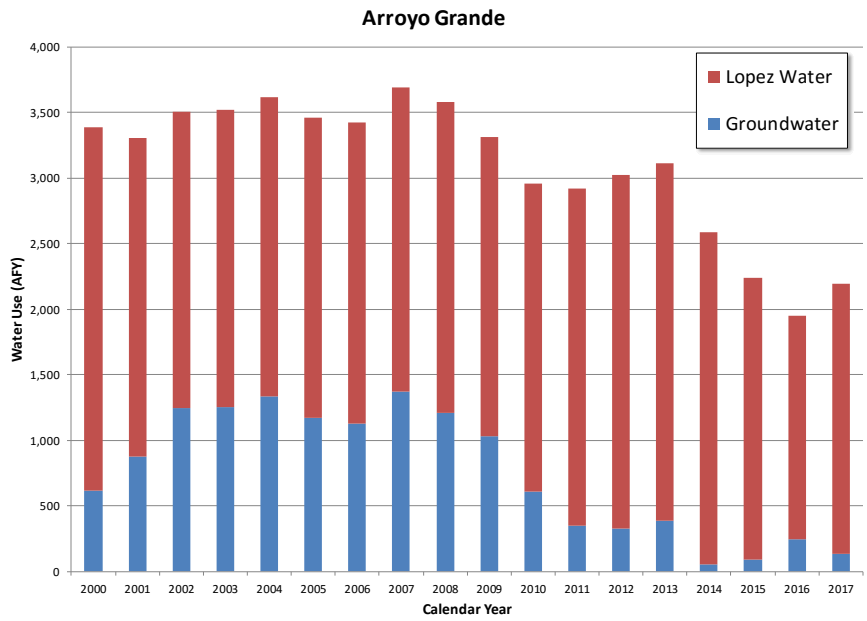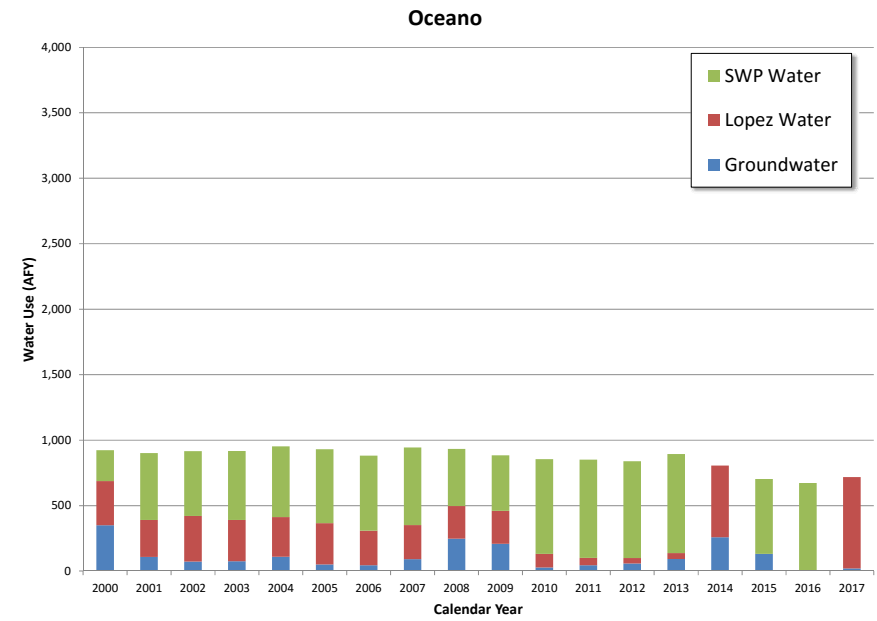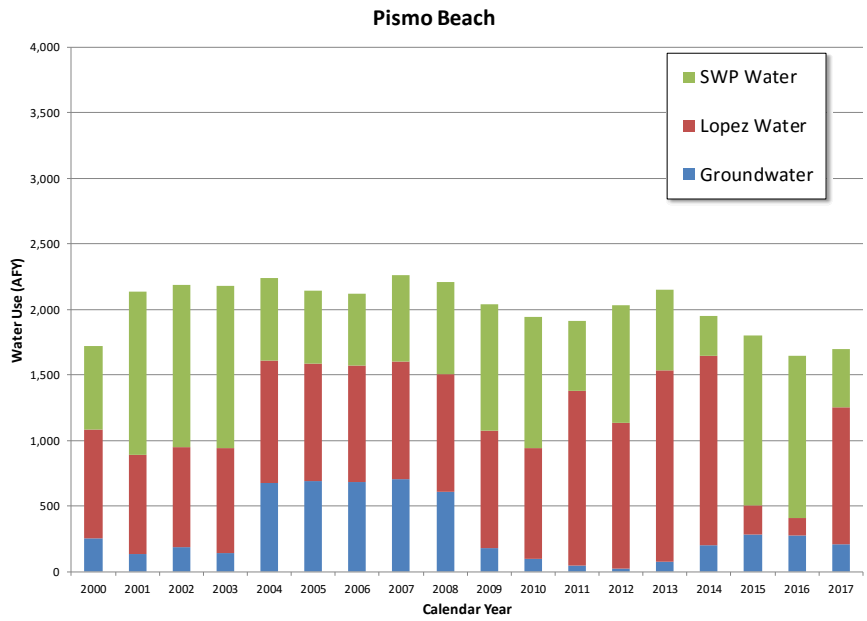


Final Draft\Fig

FIGURE 25

MUNICIPAL WATER USE BY SOURCE
 Northern Cities Management Area
 San Luis Obispo County, California



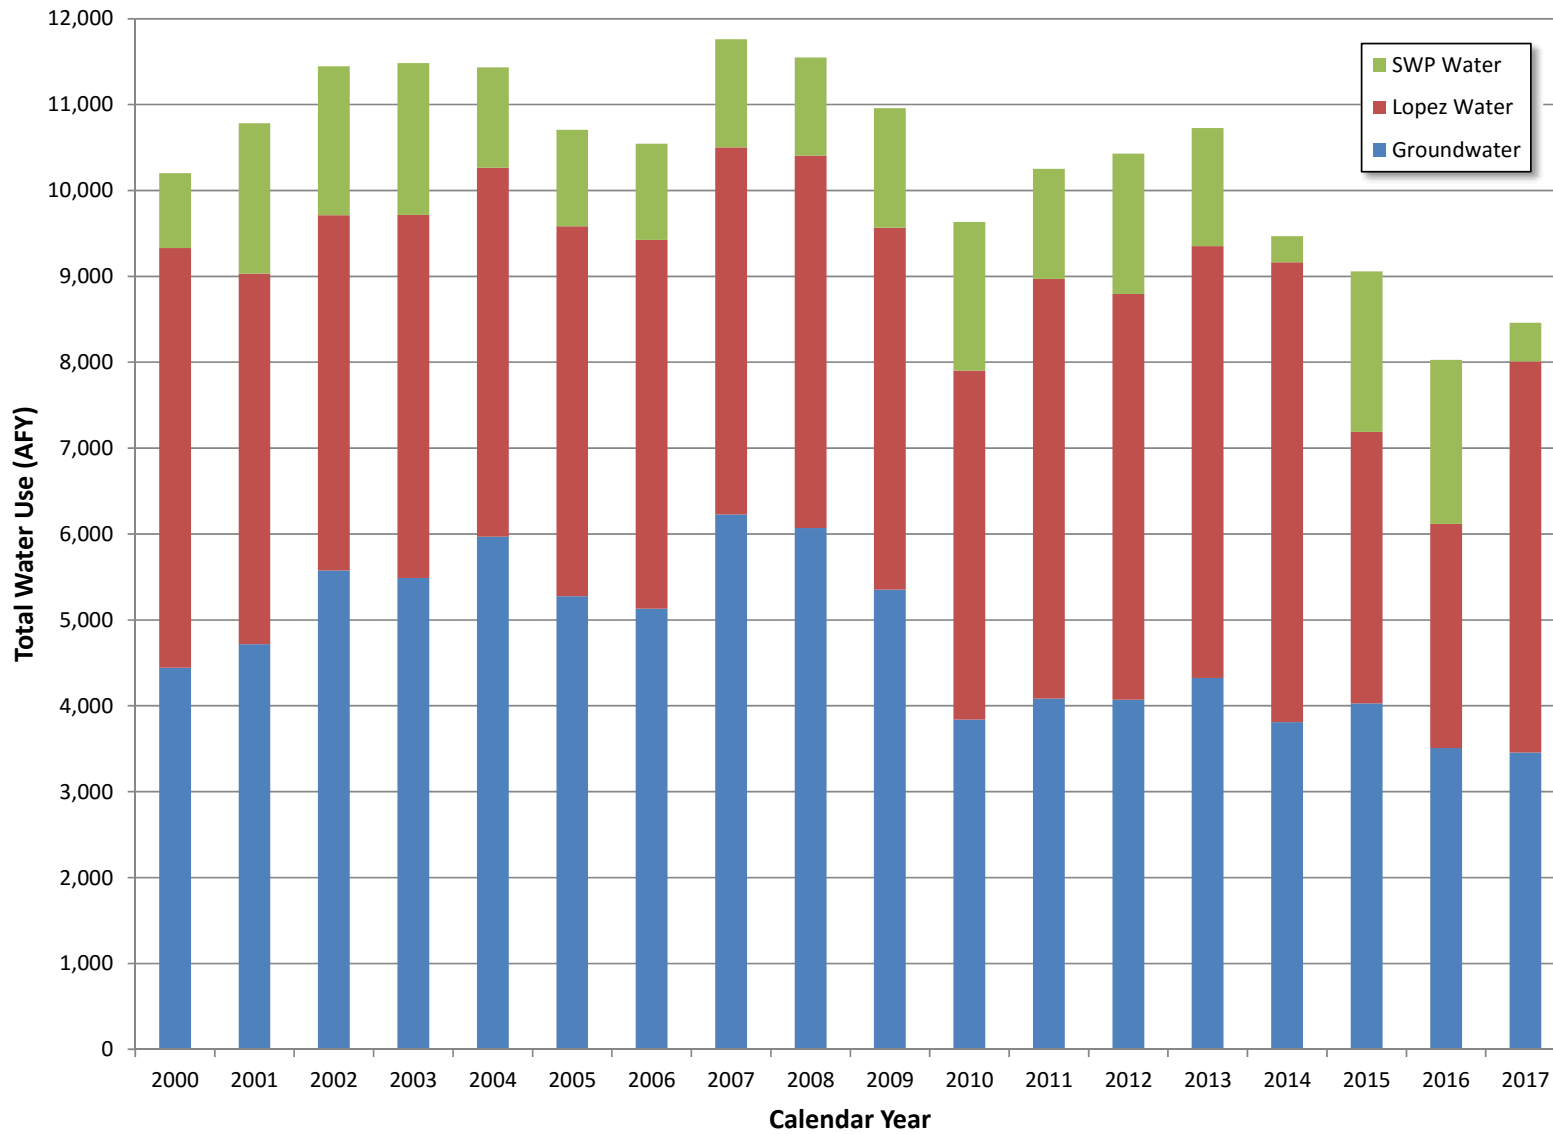


\\SLO\Projects\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 26 NCMA Total Water Use by Source.grf

FIGURE 26

TOTAL WATER USE (URBAN, RURAL, AG) BY SOURCE
 Northern Cities Management Area
 San Luis Obispo County, California



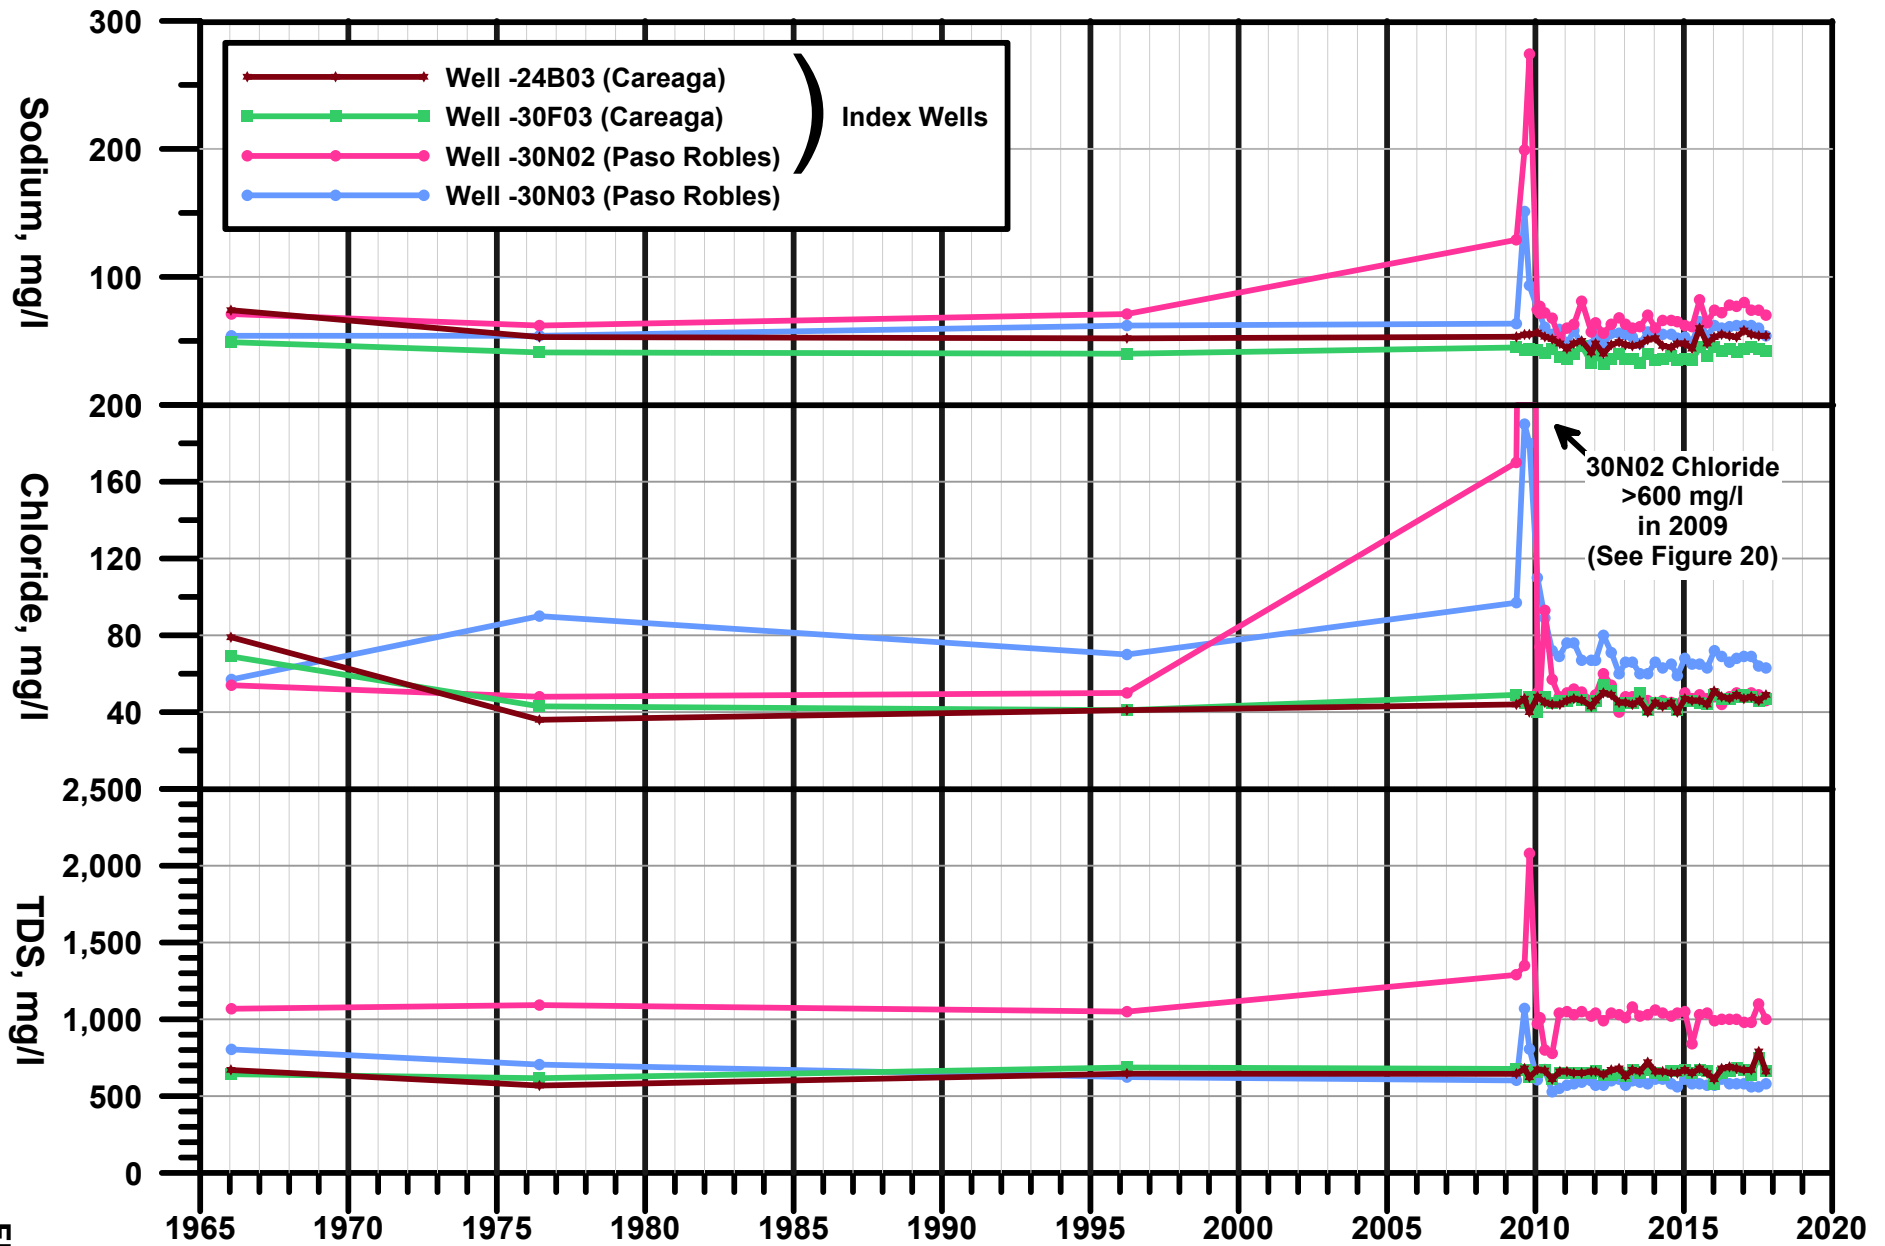


\\PDX\Projects\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 27 NCMA TDS, Cl and Sodium Index Wells and 30N03.grf

HISTORICAL TDS, CHLORIDE AND SODIUM, INDEX WELLS AND 30N03
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 27



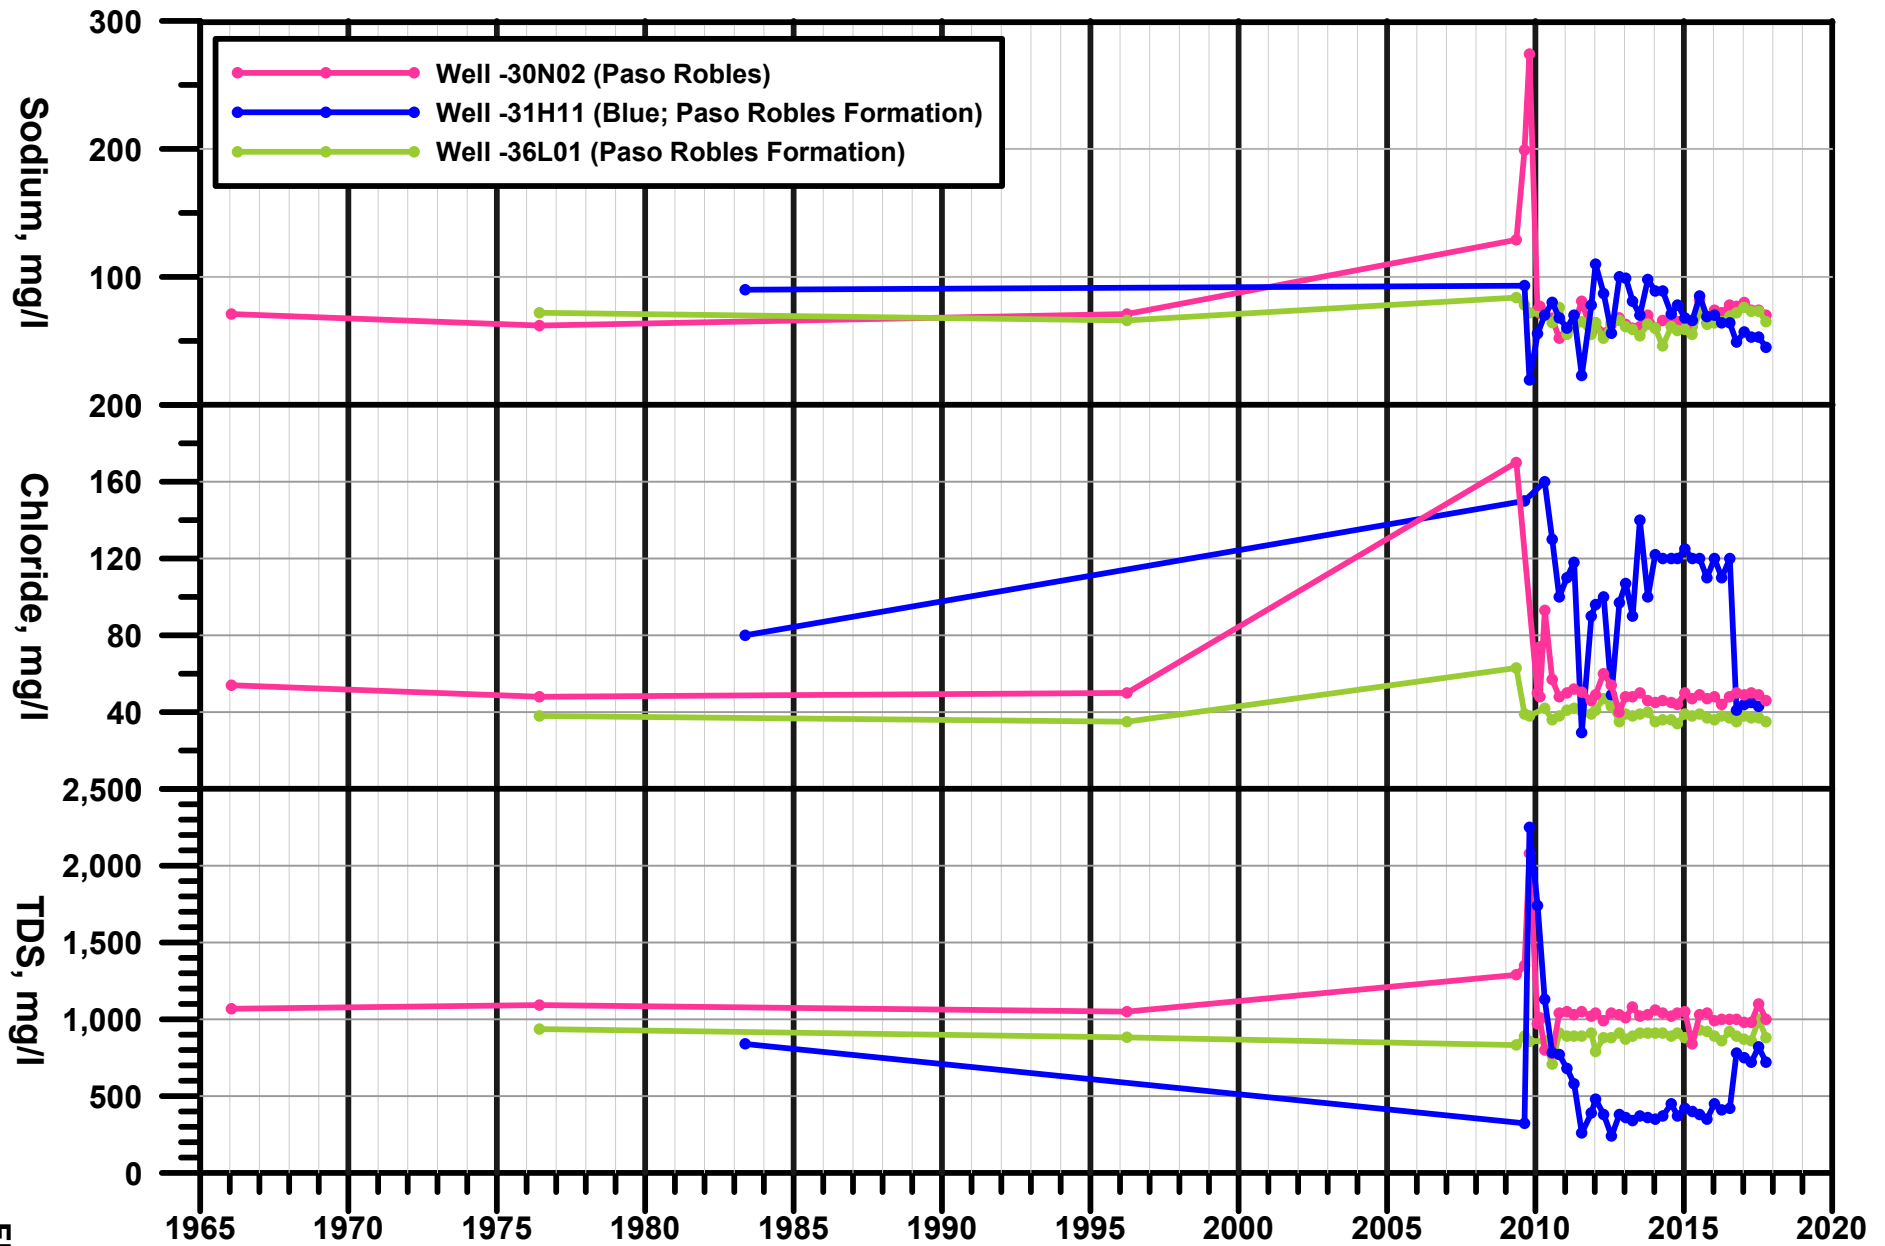

P:\Portland\672-Northern Cities Management Area\003-2017 Annual Report\03 Annual Report\0 Admin Draft\Figures\Parts Fig 28 NCMA TDS, Cl and Sodium Wells 30N02 MW-Blue and 36L01.grf

HISTORICAL TDS, CHLORIDE AND SODIUM, WELLS 30N02, MW-BLUE AND 36L01
 Northern Cities Management Area
 San Luis Obispo County, California

FIGURE 28



APPENDIX A

NCMA Monitoring Well Water Level and Water Quality Data

This page left blank intentionally.

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|---------------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/10/2017 | 6.12 | Stove Pipe | Top of Steel | 13.58 | 7.46 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/11/2017 | 6.74 | Stove Pipe | Top of Steel | 13.58 | 6.84 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/11/2017 | 6.30 | Stove Pipe | Top of Steel | 13.58 | 7.28 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/10/2017 | 5.54 | Stove Pipe | Top of Steel | 13.58 | 8.04 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/12/2016 | 6.54 | Stove Pipe | Top of Steel | 13.58 | 7.04 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/19/2016 | 6.78 | Stove Pipe | Top of Steel | 13.58 | 6.80 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/12/2016 | 6.35 | Stove Pipe | Top of Steel | 13.58 | 7.23 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/12/2016 | 5.17 | Stove Pipe | Top of Steel | 13.58 | 8.41 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/13/2015 | 5.73 | Stove Pipe | Top of Steel | 13.58 | 7.85 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/14/2015 | 6.06 | Stove Pipe | Top of Steel | 13.58 | 7.52 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/14/2015 | 6.22 | Stove Pipe | Top of Steel | 13.58 | 7.36 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/13/2015 | 5.83 | Stove Pipe | Top of Steel | 13.58 | 7.75 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/14/2014 | 5.76 | Stove Pipe | Top of Steel | 13.58 | 7.82 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/29/2014 | 5.99 | Stove Pipe | Top of Steel | 13.58 | 7.59 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 6/4/2014 | 6.52 | Stove Pipe | Top of Steel | 13.58 | 7.06 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/15/2014 | 5.95 | Stove Pipe | Top of Steel | 13.58 | 7.63 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/14/2014 | 5.75 | Stove Pipe | Top of Steel | 13.58 | 7.83 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/14/2013 | 6.07 | Stove Pipe | Top of Steel | 13.58 | 7.51 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/9/2013 | 6.09 | Stove Pipe | Top of Steel | 13.58 | 7.49 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/10/2013 | 7.00 | Stove Pipe | Top of Steel | 13.58 | 6.58 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/14/2013 | 5.72 | Stove Pipe | Top of Steel | 13.58 | 7.86 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/29/2012 | 5.92 | Stove Pipe | Top of Steel | 13.58 | 7.66 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/23/2012 | 5.79 | Stove Pipe | Top of Steel | 13.58 | 7.79 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/18/2012 | 5.58 | Stove Pipe | Top of Steel | 13.58 | 8.00 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/11/2012 | 5.72 | Stove Pipe | Top of Steel | 13.58 | 7.86 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 11/21/2011 | 5.80 | Stove Pipe | Top of Steel | 13.58 | 7.78 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/26/2011 | 6.38 | Stove Pipe | Top of Steel | 13.58 | 7.20 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/20/2011 | 6.40 | Stove Pipe | Top of Steel | 13.58 | 7.18 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/24/2011 | 5.78 | Stove Pipe | Top of Steel | 13.58 | 7.80 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/21/2010 | 6.37 | Stove Pipe | Top of Steel | 13.58 | 7.21 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 7/27/2010 | 6.48 | Stove Pipe | Top of Steel | 13.58 | 7.1 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/27/2010 | 3.84 | Flush | Top Flush Mount | 10.70 | 6.86 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 1/27/2010 | 3.13 | Flush | Top Flush Mount | 10.70 | 7.57 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/19/2009 | 2.28 | Flush | Top Flush Mount | 10.70 | 8.42 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 8/20/2009 | 3.25 | Flush | Top Flush Mount | 10.70 | 7.45 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 5/12/2009 | 3.58 | Flush | Top Flush Mount | 10.70 | 7.12 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/7/2009 | 1.61 | Flush | Top Flush Mount | 11.70 | 10.09 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 10/15/2008 | 4.72 | Flush | Top Flush Mount | 12.70 | 7.98 |
| 32S/12E-24B01 | North Beach Shallow | Alluvium | 4/15/2008 | 2.65 | Flush | Top Flush Mount | 13.70 | 11.05 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/10/2017 | 6.46 | Stove Pipe | Top of Steel | 13.58 | 7.12 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/11/2017 | 6.93 | Stove Pipe | Top of Steel | 13.58 | 6.65 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|--------------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/11/2017 | 6.26 | Stove Pipe | Top of Steel | 13.58 | 7.32 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/10/2017 | 5.33 | Stove Pipe | Top of Steel | 13.58 | 8.25 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/12/2016 | 7.05 | Stove Pipe | Top of Steel | 13.58 | 6.53 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/19/2016 | 7.61 | Stove Pipe | Top of Steel | 13.58 | 5.97 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/12/2016 | 6.37 | Stove Pipe | Top of Steel | 13.58 | 7.21 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/12/2016 | 5.51 | Stove Pipe | Top of Steel | 13.58 | 8.07 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/13/2015 | 6.61 | Stove Pipe | Top of Steel | 13.58 | 6.97 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/14/2015 | 6.97 | Stove Pipe | Top of Steel | 13.58 | 6.61 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/14/2015 | 7.13 | Stove Pipe | Top of Steel | 13.58 | 6.45 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/13/2015 | 6.28 | Stove Pipe | Top of Steel | 13.58 | 7.30 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/14/2014 | 6.61 | Stove Pipe | Top of Steel | 13.58 | 6.97 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/29/2014 | 7.05 | Stove Pipe | Top of Steel | 13.58 | 6.53 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 6/4/2014 | 8.25 | Stove Pipe | Top of Steel | 13.58 | 5.33 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/15/2014 | 6.55 | Stove Pipe | Top of Steel | 13.58 | 7.03 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/14/2014 | 6.34 | Stove Pipe | Top of Steel | 13.58 | 7.24 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/14/2013 | 7.08 | Stove Pipe | Top of Steel | 13.58 | 6.50 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/9/2013 | 7.17 | Stove Pipe | Top of Steel | 13.58 | 6.41 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/10/2013 | 6.33 | Stove Pipe | Top of Steel | 13.58 | 7.25 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/14/2013 | 5.61 | Stove Pipe | Top of Steel | 13.58 | 7.97 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/29/2012 | 5.88 | Stove Pipe | Top of Steel | 13.58 | 7.7 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/23/2012 | 6.12 | Stove Pipe | Top of Steel | 13.58 | 7.46 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/18/2012 | 5.48 | Stove Pipe | Top of Steel | 13.58 | 8.1 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/11/2012 | 5.47 | Stove Pipe | Top of Steel | 13.58 | 8.11 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 11/21/2011 | 5.69 | Stove Pipe | Top of Steel | 13.58 | 7.89 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/26/2011 | 6.51 | Stove Pipe | Top of Steel | 13.58 | 7.07 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/20/2011 | 6.30 | Stove Pipe | Top of Steel | 13.58 | 7.28 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/24/2011 | 5.69 | Stove Pipe | Top of Steel | 13.58 | 7.89 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/21/2010 | 6.79 | Stove Pipe | Top of Steel | 13.58 | 6.79 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 7/27/2010 | 7.05 | Stove Pipe | Top of Steel | 13.58 | 6.53 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/27/2010 | 4.34 | Flush | Top Flush Mount | 10.70 | 6.36 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 1/27/2010 | 3.38 | Flush | Top Flush Mount | 10.70 | 7.32 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/19/2009 | 2.26 | Flush | Top Flush Mount | 10.70 | 8.44 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 8/20/2009 | 4.09 | Flush | Top Flush Mount | 10.70 | 6.61 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 5/12/2009 | 4.74 | Flush | Top Flush Mount | 10.70 | 5.96 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 10/15/2008 | 4.54 | Flush | Top Flush Mount | 10.70 | 6.16 |
| 32S/12E-24B02 | North Beach Middle | Paso Robles | 4/15/2008 | 3.17 | Flush | Top Flush Mount | 10.70 | 7.53 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-------------------|------------------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/10/2017 | 3.60 | Stove Pipe | Top of Steel | 13.58 | 9.98 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/11/2017 | 3.75 | Stove Pipe | Top of Steel | 13.58 | 9.83 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/11/2017 | 2.90 | Stove Pipe | Top of Steel | 13.58 | 10.68 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/10/2017 | 2.59 | Stove Pipe | Top of Steel | 13.58 | 10.99 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/12/2016 | 4.70 | Stove Pipe | Top of Steel | 13.58 | 8.88 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/19/2016 | 5.10 | Stove Pipe | Top of Steel | 13.58 | 8.48 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/12/2016 | 3.81 | Stove Pipe | Top of Steel | 13.58 | 9.77 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/12/2016 | 3.01 | Stove Pipe | Top of Steel | 13.58 | 10.57 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/13/2015 | 4.62 | Stove Pipe | Top of Steel | 13.58 | 8.96 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/14/2015 | 4.76 | Stove Pipe | Top of Steel | 13.58 | 8.82 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/14/2015 | 4.86 | Stove Pipe | Top of Steel | 13.58 | 8.72 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/13/2015 | 3.59 | Stove Pipe | Top of Steel | 13.58 | 9.99 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/14/2014 | 4.60 | Stove Pipe | Top of Steel | 13.58 | 8.98 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/29/2014 | 4.78 | Stove Pipe | Top of Steel | 13.58 | 8.80 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 6/4/2014 | 7.33 | Stove Pipe | Top of Steel | 13.58 | 6.25 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 5/5/2014 | 5.36 | Stove Pipe | Top of Steel | 13.58 | 8.22 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/15/2014 | 3.94 | Stove Pipe | Top of Steel | 13.58 | 9.64 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/14/2014 | 3.81 | Stove Pipe | Top of Steel | 13.58 | 9.77 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/14/2013 | 4.50 | Stove Pipe | Top of Steel | 13.58 | 9.08 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/9/2013 | 4.48 | Stove Pipe | Top of Steel | 13.58 | 9.1 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/10/2013 | 3.41 | Stove Pipe | Top of Steel | 13.58 | 10.17 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/14/2013 | 2.48 | Stove Pipe | Top of Steel | 13.58 | 11.1 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/29/2012 | 3.01 | Stove Pipe | Top of Steel | 13.58 | 10.57 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/23/2012 | 2.98 | Stove Pipe | Top of Steel | 13.58 | 10.6 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/18/2012 | 1.93 | Stove Pipe | Top of Steel | 13.58 | 11.65 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/12/2012 | 2.15 | Stove Pipe | Top of Steel | 13.58 | 11.43 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 11/21/2011 | 2.93 | Stove Pipe | Top of Steel | 13.58 | 10.65 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/26/2011 | 3.17 | Stove Pipe | Top of Steel | 13.58 | 10.41 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/20/2011 | 3.25 | Stove Pipe | Top of Steel | 13.58 | 10.33 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/24/2011 | 2.65 | Stove Pipe | Top of Steel | 13.58 | 10.93 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/21/2010 | 4.60 | Stove Pipe | Top of Steel | 13.58 | 8.98 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 7/27/2010 | 4.54 | Stove Pipe | Top of Steel | 13.58 | 9.04 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/27/2010 | 1.43 | Flush | Top Flush Mount | 10.70 | 9.27 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 1/27/2010 | 0.94 | Flush | Top Flush Mount | 10.70 | 9.76 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/19/2009 | 0.81 | Flush | Top Flush Mount | 10.70 | 9.89 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 8/19/2009 | 4.18 | Flush | Top Flush Mount | 10.70 | 6.52 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 5/12/2009 | 3.18 | Flush | Top Flush Mount | 10.70 | 7.52 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 10/15/2008 | 3.13 | Flush | Top Flush Mount | 10.70 | 7.57 |
| 32S/12E-24B03 | North Beach Deep | Careaga | 4/15/2008 | 3.80 | Flush | Top Flush Mount | 10.70 | 6.90 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/10/2017 | 14.65 | Stove Pipe | Top of Steel | 23.16 | 8.51 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/11/2017 | 13.73 | Stove Pipe | Top of Steel | 23.16 | 9.43 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-------------------|------------------------|------------|-----------------------|--------------------|----------------|----------------------|-----------------------------------|
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/11/2017 | 13.25 | Stove Pipe | Top of Steel | 23.16 | 9.91 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/10/2017 | 13.99 | Stove Pipe | Top of Steel | 23.16 | 9.17 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/12/2016 | 17.08 | Stove Pipe | Top of Steel | 23.16 | 6.08 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/19/2016 | 16.42 | Stove Pipe | Top of Steel | 23.16 | 6.74 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/12/2016 | 14.83 | Stove Pipe | Top of Steel | 23.16 | 8.33 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/12/2016 | 15.00 | Stove Pipe | Top of Steel | 23.16 | 8.16 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/13/2015 | 17.11 | Stove Pipe | Top of Steel | 23.16 | 6.05 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/14/2015 | 16.93 | Stove Pipe | Top of Steel | 23.16 | 6.23 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/14/2015 | 16.01 | Stove Pipe | Top of Steel | 23.16 | 7.15 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/13/2015 | 15.41 | Stove Pipe | Top of Steel | 23.16 | 7.75 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/14/2014 | 17.05 | Stove Pipe | Top of Steel | 23.16 | 6.11 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/29/2014 | 17.11 | Stove Pipe | Top of Steel | 23.16 | 6.05 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 6/4/2014 | 16.82 | Stove Pipe | Top of Steel | 23.16 | 6.34 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/15/2014 | 15.56 | Stove Pipe | Top of Steel | 23.16 | 7.60 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/14/2014 | 16.58 | Stove Pipe | Top of Steel | 23.16 | 6.58 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/14/2013 | 17.07 | Stove Pipe | Top of Steel | 23.16 | 6.09 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/9/2013 | 16.17 | Stove Pipe | Top of Steel | 23.16 | 6.99 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/10/2013 | 14.58 | Stove Pipe | Top of Steel | 23.16 | 8.58 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/14/2013 | 14.36 | Stove Pipe | Top of Steel | 23.16 | 8.8 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/30/2012 | 14.95 | Stove Pipe | Top of Steel | 23.16 | 8.21 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/24/2012 | 14.00 | Stove Pipe | Top of Steel | 23.16 | 9.16 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/18/2012 | 13.42 | Stove Pipe | Top of Steel | 23.16 | 9.74 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/10/2012 | 13.80 | Stove Pipe | Top of Steel | 23.16 | 9.36 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 11/21/2011 | 13.78 | Stove Pipe | Top of Steel | 23.16 | 9.38 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/26/2011 | 13.50 | Stove Pipe | Top of Steel | 23.16 | 9.66 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/20/2011 | 12.82 | Stove Pipe | Top of Steel | 23.16 | 10.34 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/24/2011 | 13.33 | Stove Pipe | Top of Steel | 23.16 | 9.83 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/21/2010 | 16.55 | Stove Pipe | Top of Steel | 23.16 | 6.61 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 7/26/2010 | 15.68 | Stove Pipe | Top of Steel | 23.16 | 7.48 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/27/2010 | 11.02 | Stove Pipe | Top of Steel | 23.16 | 12.14 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 1/28/2010 | 12.73 | Stove Pipe | Top of Steel | 23.16 | 10.43 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/19/2009 | 14.33 | Stove Pipe | Top of Steel | 23.16 | 8.83 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 8/19/2009 | 14.34 | Stove Pipe | Top of Steel | 23.16 | 8.82 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 5/12/2009 | 12.38 | Stove Pipe | Top of Steel | 23.16 | 10.78 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 4/7/2009 | 11.67 | Stove Pipe | Top of Steel | 24.16 | 12.49 |
| 32S/13E-30F01 | Highway 1 Shallow | Alluvium / Paso Robles | 10/15/2008 | 15.53 | Stove Pipe | Top of Steel | 25.16 | 9.63 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|------------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/10/2017 | 15.45 | Stove Pipe | Top of Steel | 23.16 | 7.71 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/11/2017 | 15.30 | Stove Pipe | Top of Steel | 23.16 | 7.86 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/11/2017 | 14.27 | Stove Pipe | Top of Steel | 23.16 | 8.89 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/10/2017 | 14.53 | Stove Pipe | Top of Steel | 23.16 | 8.63 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/12/2016 | 17.35 | Stove Pipe | Top of Steel | 23.16 | 5.81 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/19/2016 | 17.63 | Stove Pipe | Top of Steel | 23.16 | 5.53 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/12/2016 | 15.98 | Stove Pipe | Top of Steel | 23.16 | 7.18 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/12/2016 | 15.29 | Stove Pipe | Top of Steel | 23.16 | 7.87 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/13/2015 | 17.29 | Stove Pipe | Top of Steel | 23.16 | 5.87 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/14/2015 | 17.44 | Stove Pipe | Top of Steel | 23.16 | 5.72 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/14/2015 | 16.94 | Stove Pipe | Top of Steel | 23.16 | 6.22 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/13/2015 | 16.41 | Stove Pipe | Top of Steel | 23.16 | 6.75 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/14/2014 | 17.33 | Stove Pipe | Top of Steel | 23.16 | 5.83 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/29/2014 | 17.31 | Stove Pipe | Top of Steel | 23.16 | 5.85 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 6/4/2014 | 18.00 | Stove Pipe | Top of Steel | 23.16 | 5.16 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/15/2014 | 16.27 | Stove Pipe | Top of Steel | 23.16 | 6.89 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/14/2014 | 17.01 | Stove Pipe | Top of Steel | 23.16 | 6.15 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/14/2013 | 17.52 | Stove Pipe | Top of Steel | 23.16 | 5.64 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/9/2013 | 17.15 | Stove Pipe | Top of Steel | 23.16 | 6.01 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/10/2013 | 15.76 | Stove Pipe | Top of Steel | 23.16 | 7.4 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/14/2013 | 15.01 | Stove Pipe | Top of Steel | 23.16 | 8.15 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/30/2012 | 15.27 | Stove Pipe | Top of Steel | 23.16 | 7.89 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/24/2012 | 14.82 | Stove Pipe | Top of Steel | 23.16 | 8.34 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/18/2012 | 14.38 | Stove Pipe | Top of Steel | 23.16 | 8.78 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/12/2012 | 14.31 | Stove Pipe | Top of Steel | 23.16 | 8.85 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 11/21/2011 | 14.94 | Stove Pipe | Top of Steel | 23.16 | 8.22 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/26/2011 | 14.46 | Stove Pipe | Top of Steel | 23.16 | 8.7 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/20/2011 | 14.23 | Stove Pipe | Top of Steel | 23.16 | 8.93 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/24/2011 | 14.36 | Stove Pipe | Top of Steel | 23.16 | 8.80 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/21/2010 | 7.39 | Stove Pipe | Top of Steel | 23.16 | 15.77 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 7/26/2010 | 16.21 | Stove Pipe | Top of Steel | 23.16 | 6.95 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/27/2010 | 12.14 | Flush | Top Flush Mount | 20.36 | 8.22 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 1/28/2010 | 13.09 | Flush | Top Flush Mount | 20.36 | 7.27 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/19/2009 | 14.36 | Flush | Top Flush Mount | 20.36 | 6.00 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 8/19/2009 | 14.81 | Flush | Top Flush Mount | 20.36 | 5.55 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 5/12/2009 | 14.34 | Flush | Top Flush Mount | 20.36 | 6.02 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/7/2009 | 12.28 | Flush | Top Flush Mount | 20.36 | 8.08 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 10/15/2008 | 15.34 | Flush | Top Flush Mount | 20.36 | 5.02 |
| 32S/13E-30F02 | Highway 1 Middle | Paso Robles | 4/15/2008 | 12.40 | Flush | Top Flush Mount | 20.36 | 7.96 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/10/2017 | 14.70 | Stove Pipe | Top of Steel | 23.16 | 8.46 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/11/2017 | 13.64 | Stove Pipe | Top of Steel | 23.16 | 9.52 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|------------------|----------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/11/2017 | 12.36 | Stove Pipe | Top of Steel | 23.16 | 10.80 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/10/2017 | 14.25 | Stove Pipe | Top of Steel | 23.16 | 8.91 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/12/2016 | 17.82 | Stove Pipe | Top of Steel | 23.16 | 5.34 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/19/2016 | 17.22 | Stove Pipe | Top of Steel | 23.16 | 5.94 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/12/2016 | 14.90 | Stove Pipe | Top of Steel | 23.16 | 8.26 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/12/2016 | 14.84 | Stove Pipe | Top of Steel | 23.16 | 8.32 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/13/2015 | 18.87 | Stove Pipe | Top of Steel | 23.16 | 4.29 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/14/2015 | 18.87 | Stove Pipe | Top of Steel | 23.16 | 4.29 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/14/2015 | 17.92 | Stove Pipe | Top of Steel | 23.16 | 5.24 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/13/2015 | 14.13 | Stove Pipe | Top of Steel | 23.16 | 9.03 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/14/2014 | 18.98 | Stove Pipe | Top of Steel | 23.16 | 4.18 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/29/2014 | 18.62 | Stove Pipe | Top of Steel | 23.16 | 4.54 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 6/4/2014 | 22.27 | Stove Pipe | Top of Steel | 23.16 | 0.89 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 5/5/2014 | 21.34 | Stove Pipe | Top of Steel | 23.16 | 1.82 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/15/2014 | 16.14 | Stove Pipe | Top of Steel | 23.16 | 7.02 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/14/2014 | 15.35 | Stove Pipe | Top of Steel | 23.16 | 7.81 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/14/2013 | 17.30 | Stove Pipe | Top of Steel | 23.16 | 5.86 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/9/2013 | 16.61 | Stove Pipe | Top of Steel | 23.16 | 6.55 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/10/2013 | 14.69 | Stove Pipe | Top of Steel | 23.16 | 8.47 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/14/2013 | 12.62 | Stove Pipe | Top of Steel | 23.16 | 10.54 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/30/2012 | 14.61 | Stove Pipe | Top of Steel | 23.16 | 8.55 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/24/2012 | 14.50 | Stove Pipe | Top of Steel | 23.16 | 8.66 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/18/2012 | 10.43 | Stove Pipe | Top of Steel | 23.16 | 12.73 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/12/2012 | 12.37 | Stove Pipe | Top of Steel | 23.16 | 10.79 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 11/21/2011 | 13.24 | Stove Pipe | Top of Steel | 23.16 | 9.92 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/26/2011 | 14.22 | Stove Pipe | Top of Steel | 23.16 | 8.94 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/20/2011 | 12.51 | Stove Pipe | Top of Steel | 23.16 | 10.65 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/24/2011 | 12.67 | Stove Pipe | Top of Steel | 23.16 | 10.49 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/21/2010 | 6.62 | Stove Pipe | Top of Steel | 23.16 | 16.54 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 7/26/2010 | 17.32 | Stove Pipe | Top of Steel | 23.16 | 5.84 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/27/2010 | 11.38 | Flush | Top Flush Mount | 20.36 | 8.98 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 1/28/2010 | 10.98 | Flush | Top Flush Mount | 20.36 | 9.38 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/19/2009 | 14.18 | Flush | Top Flush Mount | 20.36 | 6.18 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 8/19/2009 | 20.23 | Flush | Top Flush Mount | 20.36 | 0.13 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 5/12/2009 | 17.68 | Flush | Top Flush Mount | 20.36 | 2.68 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 10/15/2008 | 22.52 | Flush | Top Flush Mount | 20.36 | -2.16 |
| 32S/13E-30F03 | Highway 1 Deep | Careaga | 4/15/2008 | 17.86 | Flush | Top Flush Mount | 20.36 | 2.50 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/10/2017 | 9.35 | Stove Pipe | Top of Steel | 16.13 | 6.78 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/11/2017 | 9.00 | Stove Pipe | Top of Steel | 16.13 | 7.13 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/11/2017 | 8.70 | Stove Pipe | Top of Steel | 16.13 | 7.43 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/10/2017 | 7.89 | Stove Pipe | Top of Steel | 16.13 | 8.24 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|------------------|----------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/12/2016 | 10.21 | Stove Pipe | Top of Steel | 16.13 | 5.92 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/19/2016 | 9.91 | Stove Pipe | Top of Steel | 16.13 | 6.22 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/12/2016 | 8.93 | Stove Pipe | Top of Steel | 16.13 | 7.20 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/12/2016 | 8.73 | Stove Pipe | Top of Steel | 16.13 | 7.40 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/13/2015 | 10.11 | Stove Pipe | Top of Steel | 16.13 | 6.02 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/14/2015 | 9.91 | Stove Pipe | Top of Steel | 16.13 | 6.22 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/14/2015 | 9.51 | Stove Pipe | Top of Steel | 16.13 | 6.62 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/13/2015 | 9.03 | Stove Pipe | Top of Steel | 16.13 | 7.10 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/14/2014 | 9.95 | Stove Pipe | Top of Steel | 16.13 | 6.18 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/29/2014 | 9.88 | Stove Pipe | Top of Steel | 16.13 | 6.25 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 6/4/2014 | 9.54 | Stove Pipe | Top of Steel | 16.13 | 6.59 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/15/2014 | 9.17 | Stove Pipe | Top of Steel | 16.13 | 6.96 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/14/2014 | 9.61 | Stove Pipe | Top of Steel | 16.13 | 6.52 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/14/2013 | 9.86 | Stove Pipe | Top of Steel | 16.13 | 6.27 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/9/2013 | 9.40 | Stove Pipe | Top of Steel | 16.13 | 6.73 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/10/2013 | 8.98 | Stove Pipe | Top of Steel | 16.13 | 7.15 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/14/2013 | 8.60 | Stove Pipe | Top of Steel | 16.13 | 7.53 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/29/2012 | 8.96 | Stove Pipe | Top of Steel | 16.13 | 7.17 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/23/2012 | 8.54 | Stove Pipe | Top of Steel | 16.13 | 7.59 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/18/2012 | 8.53 | Stove Pipe | Top of Steel | 16.13 | 7.60 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/9/2012 | 8.74 | Stove Pipe | Top of Steel | 16.13 | 7.39 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 11/21/2011 | 8.78 | Stove Pipe | Top of Steel | 16.13 | 7.35 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/26/2011 | 9.01 | Stove Pipe | Top of Steel | 16.13 | 7.12 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/20/2011 | 8.59 | Stove Pipe | Top of Steel | 16.13 | 7.54 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/24/2011 | 8.18 | Stove Pipe | Top of Steel | 16.13 | 7.95 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/21/2010 | 9.99 | Stove Pipe | Top of Steel | 16.13 | 6.14 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 7/27/2010 | 8.97 | Stove Pipe | Top of Steel | 16.13 | 7.16 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/27/2010 | 6.14 | Flush | Top Flush Mount | 13.53 | 7.39 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 1/26/2010 | 4.90 | Flush | Top Flush Mount | 13.53 | 8.63 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/20/2009 | 6.53 | Flush | Top Flush Mount | 13.53 | 7.00 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 8/20/2009 | 6.71 | Flush | Top Flush Mount | 13.53 | 6.82 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 5/11/2009 | 6.03 | Flush | Top Flush Mount | 13.53 | 7.50 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/7/2009 | 5.83 | Flush | Top Flush Mount | 13.53 | 7.70 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 10/15/2008 | 7.19 | Flush | Top Flush Mount | 13.53 | 6.34 |
| 32S/13E-30N01 | Pier Ave Shallow | Alluvium | 4/15/2008 | 6.20 | Flush | Top Flush Mount | 13.53 | 7.33 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-----------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/10/2017 | 8.61 | Stove Pipe | Top of Steel | 16.13 | 7.52 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/11/2017 | 8.84 | Stove Pipe | Top of Steel | 16.13 | 7.29 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/11/2017 | 7.55 | Stove Pipe | Top of Steel | 16.13 | 8.58 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/10/2017 | 7.11 | Stove Pipe | Top of Steel | 16.13 | 9.02 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/12/2016 | 10.13 | Stove Pipe | Top of Steel | 16.13 | 6.00 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/19/2016 | 10.62 | Stove Pipe | Top of Steel | 16.13 | 5.51 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/12/2016 | 9.21 | Stove Pipe | Top of Steel | 16.13 | 6.92 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/12/2016 | 7.98 | Stove Pipe | Top of Steel | 16.13 | 8.15 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/13/2015 | 10.48 | Stove Pipe | Top of Steel | 16.13 | 5.65 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/14/2015 | 10.88 | Stove Pipe | Top of Steel | 16.13 | 5.25 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/14/2015 | 11.88 | Stove Pipe | Top of Steel | 16.13 | 4.25 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/13/2015 | 9.40 | Stove Pipe | Top of Steel | 16.13 | 6.73 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/14/2014 | 10.52 | Stove Pipe | Top of Steel | 16.13 | 5.61 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/29/2014 | 10.22 | Stove Pipe | Top of Steel | 16.13 | 5.91 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 6/4/2014 | 11.33 | Stove Pipe | Top of Steel | 16.13 | 4.80 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/15/2014 | 9.31 | Stove Pipe | Top of Steel | 16.13 | 6.82 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/14/2014 | 10.26 | Stove Pipe | Top of Steel | 16.13 | 5.87 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/14/2013 | 10.72 | Stove Pipe | Top of Steel | 16.13 | 5.41 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/9/2013 | 10.36 | Stove Pipe | Top of Steel | 16.13 | 5.77 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/10/2013 | 8.26 | Stove Pipe | Top of Steel | 16.13 | 7.87 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/14/2013 | 7.71 | Stove Pipe | Top of Steel | 16.13 | 8.42 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/29/2012 | 8.01 | Stove Pipe | Top of Steel | 16.13 | 8.12 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/23/2012 | 9.15 | Stove Pipe | Top of Steel | 16.13 | 6.98 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/18/2012 | 6.72 | Stove Pipe | Top of Steel | 16.13 | 9.41 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/11/2012 | 7.17 | Stove Pipe | Top of Steel | 16.13 | 8.96 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 11/21/2011 | 6.45 | Stove Pipe | Top of Steel | 16.13 | 9.68 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/26/2011 | 7.59 | Stove Pipe | Top of Steel | 16.13 | 8.54 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/20/2011 | 6.65 | Stove Pipe | Top of Steel | 16.13 | 9.48 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/24/2011 | 6.68 | Stove Pipe | Top of Steel | 16.13 | 9.45 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/21/2010 | 10.76 | Stove Pipe | Top of Steel | 16.13 | 5.37 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 7/27/2010 | 9.53 | Stove Pipe | Top of Steel | 16.13 | 6.60 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/27/2010 | 5.26 | Flush | Top Flush Mount | 13.53 | 8.27 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 1/26/2010 | 5.88 | Flush | Top Flush Mount | 13.53 | 7.65 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 10/20/2009 | 6.56 | Flush | Top Flush Mount | 13.53 | 6.97 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 8/20/2009 | 7.50 | Flush | Top Flush Mount | 13.53 | 6.03 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 5/12/2009 | 6.33 | Flush | Top Flush Mount | 13.53 | 7.20 |
| 32S/13E-30N03 | Pier Ave Middle | Paso Robles | 4/15/2008 | 5.50 | Flush | Top Flush Mount | 13.53 | 8.03 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|---------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/10/2017 | 10.40 | Stove Pipe | Top of Steel | 16.13 | 5.73 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/11/2017 | 8.38 | Stove Pipe | Top of Steel | 16.13 | 7.75 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/11/2017 | 5.35 | Stove Pipe | Top of Steel | 16.13 | 10.78 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/10/2017 | 7.34 | Stove Pipe | Top of Steel | 16.13 | 8.79 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/12/2016 | 13.44 | Stove Pipe | Top of Steel | 16.13 | 2.69 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/19/2016 | 12.40 | Stove Pipe | Top of Steel | 16.13 | 3.73 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/12/2016 | 8.57 | Stove Pipe | Top of Steel | 16.13 | 7.56 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/12/2016 | 7.48 | Stove Pipe | Top of Steel | 16.13 | 8.65 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/13/2015 | 14.14 | Stove Pipe | Top of Steel | 16.13 | 1.99 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/14/2015 | 13.55 | Stove Pipe | Top of Steel | 16.13 | 2.58 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/14/2015 | 10.02 | Stove Pipe | Top of Steel | 16.13 | 6.11 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/13/2015 | 7.85 | Stove Pipe | Top of Steel | 16.13 | 8.28 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/14/2014 | 13.69 | Stove Pipe | Top of Steel | 16.13 | 2.44 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/29/2014 | 13.27 | Stove Pipe | Top of Steel | 16.13 | 2.86 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 6/4/2014 | 15.20 | Stove Pipe | Top of Steel | 16.13 | 0.93 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 5/5/2014 | 13.19 | Stove Pipe | Top of Steel | 16.13 | 2.94 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/15/2014 | 8.57 | Stove Pipe | Top of Steel | 16.13 | 7.56 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/14/2014 | 9.30 | Stove Pipe | Top of Steel | 16.13 | 6.83 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/14/2013 | 12.13 | Stove Pipe | Top of Steel | 16.13 | 4.00 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/9/2013 | 11.05 | Stove Pipe | Top of Steel | 16.13 | 5.08 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/10/2013 | 7.06 | Stove Pipe | Top of Steel | 16.13 | 9.07 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/14/2013 | 4.98 | Stove Pipe | Top of Steel | 16.13 | 11.15 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/29/2012 | 8.52 | Stove Pipe | Top of Steel | 16.13 | 7.61 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/23/2012 | 8.31 | Stove Pipe | Top of Steel | 16.13 | 7.82 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/18/2012 | 3.45 | Stove Pipe | Top of Steel | 16.13 | 12.68 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/11/2012 | 4.88 | Stove Pipe | Top of Steel | 16.13 | 11.25 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 11/21/2011 | 5.35 | Stove Pipe | Top of Steel | 16.13 | 10.78 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/26/2011 | 7.25 | Stove Pipe | Top of Steel | 16.13 | 8.88 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/20/2011 | 3.53 | Flush | Top Flush Mount | 13.53 | 10.00 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/24/2011 | 3.67 | Flush | Top Flush Mount | 13.53 | 9.86 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/21/2010 | 10.42 | Flush | Top Flush Mount | 13.53 | 3.11 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 7/27/2010 | 10.02 | Flush | Top Flush Mount | 13.53 | 3.51 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/27/2010 | 6.14 | Flush | Top Flush Mount | 13.53 | 7.39 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 2/25/2010 | 1.72 | Flush | Top Flush Mount | 13.53 | 11.81 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 2/25/2010 | 1.72 | Flush | Top Flush Mount | 13.53 | 11.81 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 1/26/2010 | 3.72 | Flush | Top Flush Mount | 13.53 | 9.81 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/20/2009 | 7.38 | Flush | Top Flush Mount | 13.53 | 6.15 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 8/20/2009 | 11.94 | Flush | Top Flush Mount | 13.53 | 1.59 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 5/11/2009 | 6.98 | Flush | Top Flush Mount | 13.53 | 6.55 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 10/15/2008 | 12.23 | Flush | Top Flush Mount | 13.53 | 1.30 |
| 32S/13E-30N02 | Pier Ave Deep | Paso Robles | 4/15/2008 | 5.60 | Flush | Top Flush Mount | 13.53 | 7.93 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|--------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/10/2017 | 26.53 | Manhole | Top Flush Mount | 34.63 | 8.10 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/11/2017 | 25.11 | Manhole | Top Flush Mount | 34.63 | 9.52 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/11/2017 | 21.98 | Manhole | Top Flush Mount | 34.63 | 12.65 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/10/2017 | 24.50 | Manhole | Top Flush Mount | 34.63 | 10.13 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/12/2016 | 30.74 | Manhole | Top Flush Mount | 34.63 | 3.89 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/19/2016 | 29.77 | Manhole | Top Flush Mount | 34.63 | 4.86 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/12/2016 | 25.64 | Manhole | Top Flush Mount | 34.63 | 8.99 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/12/2016 | 20.83 | Manhole | Top of Casing | 30.49 | 9.66 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/13/2015 | 31.88 | Manhole | Top Flush Mount | 34.63 | 2.75 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/14/2015 | 31.61 | Manhole | Top Flush Mount | 34.63 | 3.02 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/14/2015 | 28.81 | Manhole | Top Flush Mount | 34.63 | 5.82 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/13/2015 | 26.11 | Manhole | Top Flush Mount | 34.63 | 8.52 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/14/2014 | 31.64 | Manhole | Top Flush Mount | 34.63 | 2.99 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/29/2014 | 32.30 | Manhole | Top Flush Mount | 34.63 | 2.33 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 6/4/2014 | 32.82 | Manhole | Top Flush Mount | 34.63 | 1.81 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/15/2014 | 27.98 | Manhole | Top Flush Mount | 34.63 | 6.65 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/14/2014 | 28.55 | Manhole | Top Flush Mount | 34.63 | 6.08 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/14/2013 | 30.31 | Manhole | Top Flush Mount | 34.63 | 4.32 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/9/2013 | 29.98 | Manhole | Top Flush Mount | 34.63 | 4.65 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/10/2013 | 23.30 | Manhole | Top Flush Mount | 34.63 | 11.33 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/14/2013 | 23.59 | Manhole | Top Flush Mount | 34.63 | 11.04 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/30/2012 | 27.31 | Manhole | Top Flush Mount | 34.63 | 7.32 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/25/2012 | 27.15 | Manhole | Top Flush Mount | 34.63 | 7.48 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/18/2012 | 21.65 | Manhole | Top Flush Mount | 34.63 | 12.98 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/12/2012 | 23.29 | Manhole | Top Flush Mount | 34.63 | 11.34 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 11/21/2011 | 22.46 | Manhole | Top Flush Mount | 34.63 | 12.17 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/26/2011 | 25.51 | Manhole | Top Flush Mount | 34.63 | 9.12 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/20/2011 | 114.79 | Manhole | Top Flush Mount | 34.63 | -80.16 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/24/2011 | 106.59 | Manhole | Top Flush Mount | 34.63 | -71.96 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/21/2010 | 112.71 | Manhole | Top of Casing | 30.49 | -82.22 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 7/26/2010 | 95.61 | Manhole | Top of Casing | 30.49 | -65.12 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/26/2010 | 63.90 | Manhole | Top of Casing | 30.49 | -33.41 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 1/27/2010 | 43.71 | Manhole | Top of Casing | 30.49 | -13.22 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/20/2009 | 29.20 | Manhole | Top of Casing | 30.49 | 1.29 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 8/19/2009 | 24.55 | Manhole | Top of Casing | 30.49 | 5.94 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/7/2009 | 28.12 | Manhole | Top of Casing | 30.49 | 2.37 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 10/15/2008 | 27.84 | Manhole | Top of Casing | 30.49 | 2.65 |
| 32S/13E-31H10 | Oceano Green | Paso Robles | 4/16/2008 | 26.82 | Manhole | Top of Casing | 30.49 | 3.67 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/10/2017 | 28.03 | Manhole | Top Flush Mount | 34.63 | 6.6 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/11/2017 | 26.18 | Manhole | Top Flush Mount | 34.63 | 8.45 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/11/2017 | 21.90 | Manhole | Top Flush Mount | 34.63 | 12.73 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/10/2017 | 25.00 | Manhole | Top Flush Mount | 34.63 | 9.63 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/12/2016 | 30.74 | Manhole | Top Flush Mount | 34.63 | 3.89 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/19/2016 | 29.62 | Manhole | Top Flush Mount | 34.63 | 5.01 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/12/2016 | 25.13 | Manhole | Top Flush Mount | 34.63 | 9.50 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/12/2016 | 22.00 | Manhole | Top of Casing | 30.54 | 8.54 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/13/2015 | 32.70 | Manhole | Top Flush Mount | 34.63 | 1.93 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/14/2015 | 32.21 | Manhole | Top Flush Mount | 34.63 | 2.42 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/14/2015 | 28.41 | Manhole | Top Flush Mount | 34.63 | 6.22 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/13/2015 | 25.98 | Manhole | Top Flush Mount | 34.63 | 8.65 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/14/2014 | 32.70 | Manhole | Top Flush Mount | 34.63 | 1.93 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/29/2014 | 32.69 | Manhole | Top Flush Mount | 34.63 | 1.94 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 6/4/2014 | 34.02 | Manhole | Top Flush Mount | 34.63 | 0.61 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/15/2014 | 27.07 | Manhole | Top Flush Mount | 34.63 | 7.56 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/14/2014 | 27.86 | Manhole | Top Flush Mount | 34.63 | 6.77 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/14/2013 | 30.98 | Manhole | Top Flush Mount | 34.63 | 3.65 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/9/2013 | 29.36 | Manhole | Top Flush Mount | 34.63 | 5.27 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/10/2013 | 24.45 | Manhole | Top Flush Mount | 34.63 | 10.18 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/14/2013 | 23.14 | Manhole | Top Flush Mount | 34.63 | 11.49 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/30/2012 | 27.68 | Manhole | Top Flush Mount | 34.63 | 6.95 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/25/2012 | 27.18 | Manhole | Top Flush Mount | 34.63 | 7.45 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/18/2012 | 20.10 | Manhole | Top Flush Mount | 34.63 | 14.53 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/12/2012 | 22.26 | Manhole | Top Flush Mount | 34.63 | 12.37 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 11/21/2011 | 22.73 | Manhole | Top Flush Mount | 34.63 | 11.90 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/26/2011 | 25.29 | Manhole | Top Flush Mount | 34.63 | 9.34 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/20/2011 | 22.59 | Manhole | Top Flush Mount | 34.63 | 12.04 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/24/2011 | 24.87 | Manhole | Top Flush Mount | 34.63 | 9.76 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/21/2010 | 30.11 | Manhole | Top of Casing | 30.54 | 0.43 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 7/26/2010 | 24.74 | Manhole | Top of Casing | 30.54 | 5.80 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/26/2010 | 18.52 | Manhole | Top of Casing | 30.54 | 12.02 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 1/27/2010 | 22.06 | Manhole | Top of Casing | 30.54 | 8.48 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/20/2009 | 27.50 | Manhole | Top of Casing | 30.54 | 3.04 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 8/19/2009 | 24.65 | Manhole | Top of Casing | 30.54 | 5.89 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/7/2009 | 27.65 | Manhole | Top of Casing | 30.54 | 2.89 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 10/15/2008 | 29.29 | Manhole | Top of Casing | 30.54 | 1.25 |
| 32S/13E-31H11 | Oceano Blue | Paso Robles | 4/16/2008 | 26.98 | Manhole | Top of Casing | 30.54 | 3.56 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|---------------|---------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/10/2017 | 28.06 | Manhole | Top Flush Mount | 34.63 | 6.57 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/11/2017 | 24.09 | Manhole | Top Flush Mount | 34.63 | 10.54 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/11/2017 | 21.14 | Manhole | Top Flush Mount | 34.63 | 13.49 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/10/2017 | 24.80 | Manhole | Top Flush Mount | 34.63 | 9.83 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/12/2016 | 31.00 | Manhole | Top Flush Mount | 34.63 | 3.63 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/19/2016 | 26.95 | Manhole | Top of Casing | 30.48 | 3.53 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/12/2016 | 25.32 | Manhole | Top Flush Mount | 34.63 | 9.31 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/12/2016 | 21.44 | Manhole | Top of Casing | 30.48 | 9.04 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/13/2015 | 32.30 | Manhole | Top Flush Mount | 34.63 | 2.33 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/14/2015 | 32.58 | Manhole | Top Flush Mount | 34.63 | 2.05 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/14/2015 | 30.38 | Manhole | Top Flush Mount | 34.63 | 4.25 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/13/2015 | 26.19 | Manhole | Top Flush Mount | 34.63 | 8.44 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/14/2014 | 43.01 | Manhole | Top Flush Mount | 34.63 | -8.38 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/29/2014 | 33.65 | Manhole | Top Flush Mount | 34.63 | 0.98 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 6/4/2014 | 36.33 | Manhole | Top Flush Mount | 34.63 | -1.70 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/15/2014 | 42.20 | Manhole | Top Flush Mount | 34.63 | -7.57 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/14/2014 | 27.78 | Manhole | Top Flush Mount | 34.63 | 6.85 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/14/2013 | 30.92 | Manhole | Top Flush Mount | 34.63 | 3.71 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/9/2013 | 30.91 | Manhole | Top Flush Mount | 34.63 | 3.72 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/10/2013 | 26.08 | Manhole | Top Flush Mount | 34.63 | 8.55 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/14/2013 | 23.12 | Manhole | Top Flush Mount | 34.63 | 11.51 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/30/2012 | 27.14 | Manhole | Top Flush Mount | 34.63 | 7.49 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/25/2012 | 27.68 | Manhole | Top Flush Mount | 34.63 | 6.95 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/18/2012 | 20.13 | Manhole | Top Flush Mount | 34.63 | 14.5 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/11/2012 | 23.00 | Manhole | Top Flush Mount | 34.63 | 11.63 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 11/21/2011 | 22.85 | Manhole | Top Flush Mount | 34.63 | 11.78 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/26/2011 | 25.23 | Manhole | Top Flush Mount | 34.63 | 9.4 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/20/2011 | 21.27 | Manhole | Top Flush Mount | 34.63 | 13.36 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/24/2011 | 22.02 | Manhole | Top Flush Mount | 34.63 | 12.61 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/21/2010 | 29.11 | Manhole | Top Flush Mount | 34.63 | 5.52 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 7/26/2010 | 24.24 | Manhole | Well Casing | 30.48 | 6.24 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/26/2010 | 19.04 | Manhole | Well Casing | 30.48 | 11.44 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 1/27/2010 | 21.05 | Manhole | Well Casing | 30.48 | 9.43 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/20/2009 | 27.52 | Manhole | Well Casing | 30.48 | 2.96 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 8/19/2009 | 29.34 | Manhole | Well Casing | 30.48 | 1.14 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/7/2009 | 31.32 | Manhole | Well Casing | 30.48 | -0.84 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 10/15/2008 | 41.62 | Manhole | Well Casing | 30.48 | -11.14 |
| 32S/13E-31H12 | Oceano Silver | Careaga | 4/16/2008 | 29.70 | Manhole | Well Casing | 30.48 | 0.78 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|---------------|---------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/10/2017 | 27.96 | Manhole | Top Flush Mount | 34.63 | 6.67 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/11/2017 | 23.68 | Manhole | Top Flush Mount | 34.63 | 10.95 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/11/2017 | 21.18 | Manhole | Top Flush Mount | 34.63 | 13.45 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/10/2017 | 24.79 | Manhole | Top Flush Mount | 34.63 | 9.84 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/12/2016 | 30.91 | Manhole | Top Flush Mount | 34.63 | 3.72 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/19/2016 | 29.58 | Manhole | Top Flush Mount | 34.63 | 5.05 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/12/2016 | 25.25 | Manhole | Top Flush Mount | 34.63 | 9.38 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/12/2016 | 21.66 | Manhole | Top of Casing | 30.52 | 8.86 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/13/2015 | 32.28 | Manhole | Top Flush Mount | 34.63 | 2.35 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/14/2015 | 32.60 | Manhole | Top Flush Mount | 34.63 | 2.03 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/14/2015 | 30.42 | Manhole | Top Flush Mount | 34.63 | 4.21 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/13/2015 | 26.32 | Manhole | Top Flush Mount | 34.63 | 8.31 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/14/2014 | 41.12 | Manhole | Top Flush Mount | 34.63 | -6.49 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/29/2014 | 33.72 | Manhole | Top Flush Mount | 34.63 | 0.91 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 6/4/2014 | 36.55 | Manhole | Top Flush Mount | 34.63 | -1.92 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/15/2014 | 39.06 | Manhole | Top Flush Mount | 34.63 | -4.43 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/14/2014 | 27.80 | Manhole | Top Flush Mount | 34.63 | 6.83 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/14/2013 | 30.83 | Manhole | Top Flush Mount | 34.63 | 3.80 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/9/2013 | 30.41 | Manhole | Top Flush Mount | 34.63 | 4.22 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/10/2013 | 26.09 | Manhole | Top Flush Mount | 34.63 | 8.54 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/14/2013 | 23.25 | Manhole | Top Flush Mount | 34.63 | 11.38 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/30/2012 | 27.23 | Manhole | Top Flush Mount | 34.63 | 7.40 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/25/2012 | 27.69 | Manhole | Top Flush Mount | 34.63 | 6.94 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/18/2012 | 20.05 | Manhole | Top Flush Mount | 34.63 | 14.58 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/12/2012 | 23.08 | Manhole | Top Flush Mount | 34.63 | 11.55 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 11/21/2011 | 22.98 | Manhole | Top Flush Mount | 34.63 | 11.65 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/26/2011 | 26.73 | Manhole | Top Flush Mount | 34.63 | 7.90 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/20/2011 | 21.30 | Manhole | Top Flush Mount | 34.63 | 13.33 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/24/2011 | 22.01 | Manhole | Top Flush Mount | 34.63 | 12.62 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/21/2010 | 28.22 | Manhole | Well Casing | 30.52 | 2.30 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 7/26/2010 | 25.50 | Manhole | Well Casing | 30.52 | 5.02 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/26/2010 | 19.17 | Manhole | Well Casing | 30.52 | 11.35 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 1/27/2010 | 20.58 | Manhole | Well Casing | 30.52 | 9.94 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/20/2009 | 25.80 | Manhole | Well Casing | 30.52 | 4.72 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 8/19/2009 | 31.04 | Manhole | Well Casing | 30.52 | -0.52 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/7/2009 | 34.78 | Manhole | Well Casing | 30.52 | -4.26 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 10/15/2008 | 37.72 | Manhole | Well Casing | 30.52 | -7.20 |
| 32S/13E-31H13 | Oceano Yellow | Careaga | 4/16/2008 | 29.80 | Manhole | Well Casing | 30.52 | 0.72 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VDatum) |
|---------------|---------------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-------------------------------------|
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/10/2017 | 21.23 | Stove Pipe | Top of Steel | 26.77 | 5.54 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/11/2017 | 21.59 | Stove Pipe | Top of Steel | 26.77 | 5.18 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/11/2017 | 19.38 | Stove Pipe | Top of Steel | 26.77 | 7.39 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/10/2017 | 19.70 | Stove Pipe | Top of Steel | 26.77 | 7.07 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/12/2016 | 21.86 | Stove Pipe | Top of Steel | 26.77 | 4.91 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/19/2016 | 22.21 | Stove Pipe | Top of Steel | 26.77 | 4.56 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/12/2016 | 20.56 | Stove Pipe | Top of Steel | 26.77 | 6.21 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/12/2016 | 18.76 | Stove Pipe | Top of Steel | 26.77 | 8.01 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/13/2015 | 22.14 | Stove Pipe | Top of Steel | 26.77 | 4.63 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/14/2015 | 21.84 | Stove Pipe | Top of Steel | 26.77 | 4.93 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/14/2015 | 21.18 | Stove Pipe | Top of Steel | 26.77 | 5.59 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/13/2015 | 19.89 | Stove Pipe | Top of Steel | 26.77 | 6.88 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/14/2014 | 21.75 | Stove Pipe | Top of Steel | 26.77 | 5.02 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/29/2014 | 21.57 | Stove Pipe | Top of Steel | 26.77 | 5.20 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 6/4/2014 | 22.36 | Stove Pipe | Top of Steel | 26.77 | 4.41 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/15/2014 | 19.89 | Stove Pipe | Top of Steel | 26.77 | 6.88 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/14/2014 | 20.38 | Stove Pipe | Top of Steel | 26.77 | 6.39 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/14/2013 | 21.71 | Stove Pipe | Top of Steel | 26.77 | 5.06 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/9/2013 | 21.37 | Stove Pipe | Top of Steel | 26.77 | 5.4 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/10/2013 | 20.10 | Stove Pipe | Top of Steel | 26.77 | 6.67 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/14/2013 | 18.62 | Stove Pipe | Top of Steel | 26.77 | 8.15 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/31/2012 | 20.11 | Stove Pipe | Top of Steel | 26.77 | 6.66 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/24/2012 | 19.42 | Stove Pipe | Top of Steel | 26.77 | 7.35 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/20/2012 | 18.26 | Stove Pipe | Top of Steel | 26.77 | 8.51 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/18/2012 | 23.83 | Stove Pipe | Top of Steel | 26.77 | 2.94 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/11/2012 | 17.68 | Stove Pipe | Top of Steel | 26.77 | 9.09 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 11/21/2011 | 18.08 | Stove Pipe | Top of Steel | 26.77 | 8.69 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/26/2011 | 19.63 | Stove Pipe | Top of Steel | 26.77 | 7.14 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/20/2011 | 18.26 | Stove Pipe | Top of Steel | 26.77 | 8.51 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 1/24/2011 | 17.61 | Stove Pipe | Top of Steel | 26.77 | 9.16 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/21/2010 | 20.75 | Stove Pipe | Top of Steel | 26.77 | 6.02 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 7/27/2010 | 21.18 | Stove Pipe | Top of Steel | 26.77 | 5.59 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/26/2010 | 15.94 | Flush | Top Flush Mount | 23.98 | 8.04 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/21/2009 | 17.72 | Flush | Top Flush Mount | 23.98 | 6.26 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 8/20/2009 | 19.16 | Flush | Top Flush Mount | 23.98 | 4.82 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 5/11/2009 | 17.68 | Flush | Top Flush Mount | 23.98 | 6.30 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/18/2009 | 15.95 | Flush | Top Flush Mount | 23.98 | 8.03 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 10/23/2008 | 18.75 | Flush | Top Flush Mount | 23.98 | 5.23 |
| 12N/36W-36L01 | Oceano Dunes Middle | Paso Robles | 4/23/2008 | 16.87 | Flush | Top Flush Mount | 23.98 | 7.11 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-------------------|---------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/10/2017 | 24.70 | Stove Pipe | Top of Steel | 26.77 | 2.07 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/11/2017 | 23.65 | Stove Pipe | Top of Steel | 26.77 | 3.12 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/10/2017 | 15.00 | Stove Pipe | Top of Steel | 26.77 | 11.77 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/10/2017 | 16.15 | Stove Pipe | Top of Steel | 26.77 | 10.62 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/12/2016 | 27.86 | Stove Pipe | Top of Steel | 26.77 | -1.09 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/19/2016 | 25.76 | Stove Pipe | Top of Steel | 26.77 | 1.01 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/12/2016 | 18.43 | Stove Pipe | Top of Steel | 26.77 | 8.34 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/12/2016 | 16.27 | Stove Pipe | Top of Steel | 26.77 | 10.50 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/13/2015 | 27.17 | Stove Pipe | Top of Steel | 26.77 | -0.40 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/14/2015 | 26.11 | Stove Pipe | Top of Steel | 26.77 | 0.66 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/14/2015 | 22.24 | Stove Pipe | Top of Steel | 26.77 | 4.53 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/13/2015 | 16.91 | Stove Pipe | Top of Steel | 26.77 | 9.86 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/14/2014 | 26.30 | Stove Pipe | Top of Steel | 26.77 | 0.47 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/29/2014 | 25.64 | Stove Pipe | Top of Steel | 26.77 | 1.13 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 6/4/2014 | 25.22 | Stove Pipe | Top of Steel | 26.77 | 1.55 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/15/2014 | 16.94 | Stove Pipe | Top of Steel | 26.77 | 9.83 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/14/2014 | 18.76 | Stove Pipe | Top of Steel | 26.77 | 8.01 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/14/2013 | 23.94 | Stove Pipe | Top of Steel | 26.77 | 2.83 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/9/2013 | 23.15 | Stove Pipe | Top of Steel | 26.77 | 3.62 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/10/2013 | 15.35 | Stove Pipe | Top of Steel | 26.77 | 11.42 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/14/2013 | 11.24 | Stove Pipe | Top of Steel | 26.77 | 15.53 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/31/2012 | 18.81 | Stove Pipe | Top of Steel | 26.77 | 7.96 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/24/2012 | 19.05 | Stove Pipe | Top of Steel | 26.77 | 7.72 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/18/2012 | 10.81 | Stove Pipe | Top of Steel | 26.77 | 15.96 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/11/2012 | 11.18 | Stove Pipe | Top of Steel | 26.77 | 15.59 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 11/21/2011 | 13.99 | Stove Pipe | Top of Steel | 26.77 | 12.78 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/26/2011 | 18.03 | Stove Pipe | Top of Steel | 26.77 | 8.74 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 1/24/2011 | 9.37 | Stove Pipe | Top of Steel | 26.77 | 17.40 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/21/2010 | 19.77 | Stove Pipe | Top of Steel | 26.77 | 7.00 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 7/27/2010 | 20.53 | Stove Pipe | Top of Steel | 26.77 | 6.24 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/26/2010 | 9.24 | Flush | Top Flush Mount | 23.98 | 14.74 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/21/2009 | 17.65 | Flush | Top Flush Mount | 23.98 | 6.33 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 8/20/2009 | 19.15 | Flush | Top Flush Mount | 23.98 | 4.83 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 5/11/2009 | 14.38 | Flush | Top Flush Mount | 23.98 | 9.60 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 10/23/2008 | 18.73 | Flush | Top Flush Mount | 23.98 | 5.25 |
| 12N/36W-36L02 | Oceano Dunes Deep | Careaga | 4/23/2008 | 11.55 | Flush | Top Flush Mount | 23.98 | 12.43 |

Appendix A: NCMA Sentry Wells Water Level Data



| Well | Common Name | Aquifer | Date | Depth to Water (feet) | Surface Completion | RP Description | RP Elev, feet NAVD88 | Groundwater Elevation (feet VD88) |
|---------------|-------------|-------------|------------|-----------------------|--------------------|-----------------|----------------------|-----------------------------------|
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/10/2017 | 42.05 | Flush | Top Flush Mount | 47.70 | 5.65 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/11/2017 | 38.34 | Flush | Top Flush Mount | 47.70 | 9.36 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/11/2017 | 28.44 | Flush | Top Flush Mount | 47.70 | 19.26 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 1/10/2017 | 34.85 | Flush | Top Flush Mount | 47.70 | 12.85 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/12/2016 | 47.49 | Flush | Top Flush Mount | 47.70 | 0.21 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/19/2016 | 44.51 | Flush | Top Flush Mount | 47.70 | 3.19 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/12/2016 | 36.41 | Flush | Top Flush Mount | 47.70 | 11.29 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 1/12/2016 | 36.48 | Flush | Top Flush Mount | 47.70 | 11.22 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/13/2015 | 51.21 | Flush | Top Flush Mount | 47.70 | -3.51 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/14/2015 | 49.07 | Flush | Top Flush Mount | 47.70 | -1.37 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/14/2015 | 44.00 | Flush | Top Flush Mount | 47.70 | 3.70 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 1/13/2015 | 38.90 | Flush | Top Flush Mount | 47.70 | 8.80 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/14/2014 | 50.50 | Flush | Top Flush Mount | 47.70 | -2.80 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/29/2014 | 44.02 | Flush | Top Flush Mount | 47.70 | 3.68 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 6/4/2014 | 45.46 | Flush | Top Flush Mount | 47.70 | 2.24 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/15/2014 | 41.51 | Flush | Top Flush Mount | 47.70 | 6.19 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 1/14/2014 | 41.00 | Flush | Top Flush Mount | 47.70 | 6.70 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/14/2013 | 45.26 | Flush | Top Flush Mount | 47.70 | 2.44 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/9/2013 | 43.83 | Flush | Top Flush Mount | 47.70 | 3.87 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/10/2013 | 37.89 | Flush | Top Flush Mount | 47.70 | 9.81 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 1/14/2013 | 32.26 | Flush | Top Flush Mount | 47.70 | 15.44 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 10/30/2012 | 40.05 | Flush | Top Flush Mount | 47.70 | 7.65 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 7/25/2012 | 38.62 | Flush | Top Flush Mount | 47.70 | 9.08 |
| 12N/35W-32C03 | County MW-3 | Paso Robles | 4/19/2012 | 23.02 | Flush | Top Flush Mount | 47.70 | 24.68 |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/12E-24B01 | 10/11/2017 | 3100 | 1400 | 590 | 36 | 180 | 190 | 430 | 190 | ND | 2.3 | 0.17 | 0.13 | 0.11 | 1.4 | 0.64 | 430 | ND | ND | 5180 | 1.7 | 0.0005 | 2188 |
| 32S/12E-24B01 | 4/11/2017 | 3,400 | 1,400 | 680 | 41 | 190 | 210 | 420 | 190 | ND | 2.4 | 0.16 | 0.17 | 0.11 | 1.6 | 4.7 | 420 | ND | ND | 5,020 | 1.8 | 0.0034 | 298 |
| 32S/12E-24B01 | 10/11/2016 | 3,100 | 1,400 | 700 | 44 | 210 | 220 | 450 | 190 | 0.26 | 2.1 | 0.18 | ND | 0.12 | 1.6 | 4.1 | 450 | ND | ND | 5,020 | 1.3 | 0.0029 | 341 |
| 32S/12E-24B01 | 4/12/2016 | 2,800 | 1,400 | 640 | 37 | 170 | 180 | 420 | 190 | <0.48 | 2.2 | 0.16 | <0.055 | 0.081 | 1.3 | 4.8 | 420 | <8.2 | <8.2 | 5,000 | 0.73 | 0.0034 | 292 |
| 32S/12E-24B01 | 10/15/2015 | 3,230 | 230 | 560 | 34 | 160 | 170 | 413 | 42 | <0.05 | 2.2 | 0.14 | <0.10 | 0.091 | 1.1 | 0.68 | 413 | <10 | <10 | 4,880 | 0.54 | 0.0030 | 338 |
| 32S/12E-24B01 | 4/15/2015 | 3,010 | 1,300 | 510 | 30 | 150 | 160 | 410 | 220 | <0.05 | 2.9 | 0.15 | <0.5 | 0.023 | 1.0 | 3.4 | 410 | <10 | <10 | 4,760 | 0.72 | 0.0026 | 382 |
| 32S/12E-24B01 | 1/14/2015 | 2,980 | 1,300 | 520 | 30 | 150 | 170 | 400 | 210 | <0.25 | 2.2 | 0.14 | <0.5 | <0.021 | 1.0 | 2.9 | 400 | <10 | <10 | 4,640 | 0.52 | 0.0022 | 448 |
| 32S/12E-24B01 | 10/14/2014 | 3,160 | 1,100 | 530 | 32 | 150 | 170 | 390 | 180 | 0.32 | 2.2 | 0.16 | <0.5 | <0.01 | 1.1 | <0.5 | 390 | <10 | <10 | 4,780 | 0.67 | NA | NA |
| 32S/12E-24B01 | 7/30/2014 | 2,950 | 1,300 | 520 | 29 | 140 | 170 | 440 | 190 | <0.25 | 1.9 | 0.11 | <0.5 | 0.03 | 1.1 | 2.6 | 440 | <10 | <10 | 4,830 | 0.62 | 0.0020 | 500 |
| 32S/12E-24B01 | 4/16/2014 | 2,880 | 1,200 | 560 | 29 | 140 | 140 | 390 | 190 | <0.05 | 2.2 | 0.130 | <0.5 | 0.03 | 0.92 | 2.9 | 390 | <10 | <10 | 4,790 | 0.72 | 0.0024 | 414 |
| 32S/12E-24B01 | 1/15/2014 | 2,870 | 1,300 | 540 | 30 | 140 | 160 | 380 | 214 | <0.25 | 2.4 | 0.17 | <0.5 | <0.01 | 1.0 | 3.0 | 380 | <10 | <10 | 4,800 | 0.71 | 0.0023 | 433 |
| 32S/12E-24B01 | 10/15/2013 | 2,860 | 1,200 | 560 | 31 | 150 | 160 | 380 | 200 | <0.25 | 2.2 | 0.13 | <0.5 | <0.01 | 1.0 | 3.0 | 380 | <10 | <10 | 4,810 | 0.75 | 0.0025 | 400 |
| 32S/12E-24B01 | 7/9/2013 | 2,960 | 1,300 | 560 | 32 | 150 | 160 | 395 | 215 | <0.25 | 2.4 | 0.16 | <0.5 | <0.01 | 1.1 | 2.0 | 395 | <10 | <10 | 4,850 | 0.81 | 0.0015 | 650 |
| 32S/12E-24B01 | 4/10/2013 | 2,920 | 1,300 | 540 | 30 | 140 | 150 | 410 | 220 | <0.25 | 1.9 | 0.16 | <0.1 | <0.01 | 1.00 | 3.5 | 410 | <10 | <10 | 4,830 | 0.67 | 0.0027 | 371 |
| 32S/12E-24B01 | 1/14/2013 | 2,630 | 1,300 | 540 | 30 | 140 | 140 | 410 | 220 | <0.05 | 2.7 | 0.15 | <0.1 | <0.01 | 0.96 | 2.8 | 410 | <10 | <10 | 4,790 | 0.72 | 0.0022 | 464 |
| 32S/12E-24B01 | 10/29/2012 | 2,950 | 1,200 | 590 | 34 | 150 | 160 | 360 | 200 | <0.25 | 2.4 | 0.18 | <0.5 | <0.01 | 1.1 | 11 | 360 | <10 | <10 | 4,750 | 0.78 | 0.0092 | 109 |
| 32S/12E-24B01 | 7/23/2012 | 3,010 | 1,400 | 530 | 30 | 120 | 130 | 397 | 210 | <0.05 | 2.1 | 0.15 | <0.1 | 0.041 | 0.86 | 3 | 397 | <10 | <10 | 4,720 | 1.4 | 0.0021 | 467 |
| 32S/12E-24B01 | 4/18/2012 | 3,000 | 1,500 | 450 | 27 | 120 | 120 | 400 | 230 | <0.1 | 2 | 0.13 | 0.13 | <0.01 | 0.89 | 3.12 | 400 | <10 | <10 | 4,660 | 0.6 | 0.0021 | 481 |
| 32S/12E-24B01 | 1/11/2012 | 2,750 | 1,200 | 520 | 30 | 140 | 140 | 400 | 170 | <0.1 | 4 | 0.18 | 0.1 | 0.033 | 0.94 | 3.2 | 400 | <10 | <10 | 4,560 | 0.55 | 0.0027 | 375 |
| 32S/12E-24B01 | 11/21/2011 | 2,740 | 1,200 | 410 | 25 | 130 | 120 | 380 | 200 | <0.3 | 2.3 | 0.13 | <0.6 | 0.053 | 0.9 | 2.73 | 380 | <10 | <10 | 4,470 | 0.7 | 0.0023 | 440 |
| 32S/12E-24B01 | 7/25/2011 | 3,690 | 1,200 | 530 | 33 | 140 | 150 | 380 | 200.2 | <0.05 | 1.8 | 0.14 | <0.1 | 0.053 | 0.91 | 3.281 | 380 | <5 | <5 | 4,900 | 0.73 | 0.0027 | 366 |
| 32S/12E-24B01 | 4/20/2011 | 2,810 | 1,214 | 500 | 27 | 140 | 130 | 400 | 216 | <0.05 | 1.7 | 0.24 | 0.18 | 0.067 | 0.95 | 3.3 | 400 | <2.0 | <2.0 | 4,430 | NA | 0.0027 | 368 |
| 32S/12E-24B01 | 1/24/2011 | 2,380 | 1,100 | 370 | 24 | 110 | 120 | 380 | 180 | <0.15 | 1.8 | 0.16 | <0.3 | 0.63 | 0.68 | 2.8 | 380 | <2.0 | <2.0 | 4,020 | 0.89 | 0.0025 | 393 |
| 32S/12E-24B01 | 10/28/2010 | 2,330 | 960 | 390 | 25 | 140 | 140 | 350 | 160 | <0.1 | 3.9 | 0.15 | <0.1 | NA | 0.75 | 2.6 | 350 | <10 | <10 | 3,860 | 1.3 | 0.0027 | 369 |
| 32S/12E-24B01 | 7/27/2010 | 616 | 43 | 52.5 | 6.21 | 115 | 44.7 | 341 | 160 | <0.10 | 2.9 | 0.063 | <0.10 | 0.11 | 0.274 | 0.18 | 341 | <1.0 | <1.0 | 1,000 | 9.34 | 0.0042 | 239 |
| 32S/12E-24B01 | 4/27/2010 | 676 | 47 | 54.7 | 4.60 | 107 | 43.6 | 327 | 140 | <0.10 | 0.98 | 0.0714 | <0.10 | <0.10 | 0.0458 | 0.18 | 327 | <1.0 | <1.0 | 990 | 4.06 | 0.0038 | 261 |
| 32S/12E-24B01 | 1/27/2010 | 694 | 55 | 56.2 | 6.80 | 123 | 43.2 | 340 | 150 | 0.40 | 1.7 | 0.12 | <0.10 | 0.33 | 0.875 | 0.19 | 340 | <1.0 | <1.0 | 1,000 | 16.6 | 0.0035 | 289 |
| 32S/12E-24B01 | 10/19/2009 | 766 | 140 | 121 | 16.7 | 111 | 52.4 | 303 | 150 | 0.25 | 2.8 | 0.0959 | 0.11 | <0.10 | 0.208 | 0.47 | 303 | <1.0 | <1.0 | 1,200 | 7.79 | 0.0034 | 298 |
| 32S/12E-24B01 | 8/20/2009 | 705 | 94 | 86.8 | 11.7 | 116 | 35.6 | 286 | 150 | 0.21 | 2.7 | NA | <0.10 | 0.12 | 0.248 | 0.38 | 286 | <1.0 | <1.0 | 1,000 | 7.15 | 0.0040 | 247 |
| 32S/12E-24B01 | 5/12/2009 | 695 | 100 | 82.1 | 13.2 | 108 | 45 | 288 | 150 | NA | NA | NA | 0.11 | NA | 0.66 | 0.29 | 288 | <1.0 | <1.0 | 1,100 | 23.9 | 0.0029 | 345 |
| 32S/12E-24B01 | 3/26/1996 | 1,870 | 773 | 380 | 24.0 | 125 | 95 | 427 | 154 | 0.2 | NA | 0.27 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B01 | 6/9/1976 | 1,706 | 667 | 400 | 16.2 | 94 | 95 | 474 | 159 | 0.4 | NA | 0.12 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B01 | 1/17/1966 | 1,700 | 652 | 406 | 20.0 | 95 | 83 | 440 | 175 | 1 | NA | 0.07 | 0.3 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/12E-24B02 | 10/11/2017 | 670 | 31 | 45 | 3.7 | 120 | 38 | 330 | 160 | ND | 0.41 | 0.077 | 0.045 | 0.014 | 0.18 | 0.1 | 330 | ND | ND | 962 | 0.74 | 0.0032 | 310 |
| 32S/12E-24B02 | 7/12/2017 | 760 | 31 | 48 | 4 | 130 | 39 | 310 | 160 | ND | 0.18 | 0.072 | 0.04 | 0.015 | 0.2 | 0.12 | 310 | ND | ND | 948 | 0.93 | 0.0039 | 258 |
| 32S/12E-24B02 | 4/11/2017 | 630 | 34 | 46 | 3.7 | 120 | 35 | 310 | 170 | ND | 0.31 | 0.062 | 0.09 | 0.017 | 0.17 | 0.12 | 310 | ND | ND | 933 | 0.59 | 0.0035 | 283 |
| 32S/12E-24B02 | 1/12/2017 | 660 | 34 | 47 | 3.7 | 120 | 36 | 320 | 170 | ND | 0.26 | 0.069 | 0.031 | 0.023 | 0.2 | 0.097 | 320 | ND | ND | 938 | 0.79 | 0.0029 | 351 |
| 32S/12E-24B02 | 10/11/2016 | 660 | 35 | 48 | 4 | 120 | 39 | 320 | 170 | ND | 0.26 | 0.069 | 0.038 | 0.023 | 0.18 | 0.12 | 320 | ND | ND | 953 | 0.75 | 0.0034 | 292 |
| 32S/12E-24B02 | 7/19/2016 | 660 | 36 | 50 | 3.9 | 120 | 38 | 320 | 160 | <0.096 | 0.15 | 0.07 | 0.036 | 0.016 | 0.17 | 0.15 | 320 | <4.1 | <4.1 | 947 | 0.67 | 0.0042 | 240 |
| 32S/12E-24B02 | 4/12/2016 | 640 | 35 | 48 | 3.8 | 110 | 37 | 300 | 160 | <0.096 | 0.38 | 0.064 | 0.045 | 0.011 | 0.17 | 0.13 | 300 | <4.1 | <4.1 | 939 | 0.53 | 0.0037 | 269 |
| 32S/12E-24B02 | 1/12/2016 | 570 | 38 | 48 | 3.8 | 110 | 36 | 290 | 170 | <0.022 | 0.27 | 0.044 | 0.11 | 0.015 | 0.16 | 0.15 | 290 | <4.1 | <4.1 | 951 | 0.48 | 0.0039 | 253 |
| 32S/12E-24B02 | 10/15/2015 | 650 | 34 | 41 | 3.8 | 100 | 33 | 306 | 160 | <0.05 | <1 | 0.054 | <0.10 | 0.014 | 0.18 | <0.10 | 306 | <10 | <10 | 950 | 0.72 | NA | NA |
| 32S/12E-24B02 | 7/15/2015 | 650 | 35 | 50 | 3.0 | 120 | 36 | 295 | 160 | <0.05 | <1 | 0.069 | <0.1 | 0.01 | 0.16 | <0.1 | 295 | <10 | <10 | 950 | 0.69 | NA | NA |
| 32S/12E-24B02 | 4/15/2015 | 620 | 35 | 40 | 3.4 | 100 | 31 | 300 | 170 | <0.05 | <1 | 0.066 | <0.1 | 0.01 | 0.14 | <0.1 | 300 | <10 | <10 | 900 | 0.45 | NA | NA |
| 32S/12E-24B02 | 1/14/2015 | 640 | 36 | 41 | 3.3 | 110 | 32 | 290 | 170 | <0.05 | <1 | 0.062 | <0.1 | <0.01 | 0.14 | <0.1 | 290 | <10 | <10 | 900 | 0.48 | NA | NA |
| 32S/12E-24B02 | 10/14/2014 | 630 | 30 | 41 | 3.9 | 100 | 32 | 290 | 140 | <0.05 | <1 | 0.065 | <0.1 | <0.01 | 0.15 | <0.1 | 290 | <10 | <10 | 940 | 0.44 | NA | NA |
| 32S/12E-24B02 | 7/29/2014 | 620 | 33 | 42 | 3.5 | 100 | 33 | 300 | 150 | <0.05 | <1 | <0.1 | <0.1 | <0.01 | 0.14 | <0.1 | 300 | <10 | <10 | 940 | 0.37 | NA | NA |
| 32S/12E-24B02 | 4/16/2014 | 630 | 32 | 43 | 4.3 | 88 | 28 | 300 | 150 | <0.05 | <1 | 0.067 | <0.1 | <0.01 | 0.12 | <0.1 | 300 | <10 | <10 | 940 | 0.32 | NA | NA |
| 32S/12E-24B02 | 1/15/2014 | 630 | 33 | 46 | 3.9 | 100 | 34 | 290 | 165 | <0.05 | <1 | <0.05 | <0.1 | <0.01 | 0.14 | <0.1 | 290 | <10 | <10 | 940 | 0.37 | NA | NA |
| 32S/12E-24B02 | 10/15/2013 | 630 | 30 | 44 | 3.8 | 98 | 32 | 290 | 170 | <0.05 | <1 | <0.05 | <0.1 | <0.01 | 0.13 | <0.1 | 290 | <10 | <10 | 920 | 0.39 | NA | NA |
| 32S/12E-24B02 | 7/9/2013 | 630 | 30 | 43 | 3.9 | 110 | 33 | 295 | 170 | <0.05 | <1 | 0.076 | <0.1 | <0.01 | 0.14 | <0.1 | 295 | <10 | <10 | 940 | 0.6 | NA | NA |
| 32S/12E-24B02 | 4/10/2013 | 630 | 31 | 44 | 4 | 100 | 32 | 310 | 160 | <0.05 | <1 | 0.08 | <0.1 | <0.01 | 0.13 | <0.1 | 310 | <10 | <10 | 940 | 0.41 | NA | NA |
| 32S/12E-24B02 | 1/14/2013 | 620 | 30 | 43 | 4 | 97 | 31 | 305 | 170 | <0.05 | <1 | 0.079 | <0.1 | <0.01 | 0.12 | <0.1 | 305 | <10 | <10 | 950 | 0.72 | NA | NA |
| 32S/12E-24B02 | 10/29/2012 | 650 | 29 | 45 | 4.2 | 100 | 32 | 280 | 160 | <0.05 | <1 | 0.074 | 0.14 | <0.01 | 0.13 | <0.1 | 280 | <10 | <10 | 950 | 0.56 | NA | NA |
| 32S/12E-24B02 | 7/23/2012 | 650 | 35 | 45 | 4.3 | 87 | 27 | 297 | 170 | <0.05 | <1 | <0.1 | <0.1 | <0.01 | 0.12 | <0.1 | 297 | <10 | <10 | 950 | 0.43 | NA | NA |
| 32S/12E-24B02 | 4/18/2012 | 630 | 37 | 39 | 3.7 | 88 | 28 | 310 | 171 | <0.1 | <1 | <0.1 | 0.16 | <0.01 | 0.099 | <0.2 | 310 | <10 | <10 | 950 | 0.26 | NA | NA |
| 32S/12E-24B02 | 1/11/2012 | 650 | 33 | 46 | 4.6 | 110 | 32 | 300 | 150 | <0.1 | 1.3 | <0.1 | 0.21 | <0.02 | 0.13 | 0.03 | 300 | <10 | <10 | 950 | 1.7 | 0.0010 | 971 |
| 32S/12E-24B02 | 11/21/2011 | 640 | 32 | 39 | 3.9 | 93 | 29 | 290 | 150 | <0.05 | <1 | 0.064 | <0.1 | <0.01 | 0.096 | <0.1 | 290 | <10 | <10 | 930 | 0.32 | NA | NA |
| 32S/12E-24B02 | 7/25/2011 | 640 | 36 | 48 | 4.2 | 97 | 31 | 290 | 165.3 | <0.05 | <1 | <0.1 | <0.1 | <0.01 | 0.096 | <0.1 | 290 | <5 | <5 | 950 | 0.88 | NA | NA |
| 32S/12E-24B02 | 4/20/2011 | 620 | 39 | 46 | 7.4 | 90 | 36 | 320 | 174 | <0.05 | <1 | 0.17 | 0.14 | 0.014 | <0.005 | <0.1 | 320 | <2.0 | <2.0 | 950 | NA | NA | NA |
| 32S/12E-24B02 | 1/24/2011 | 640 | 43 | 44 | 5.9 | 87 | 28 | 270 | 170 | <0.05 | <1.0 | 0.11 | <0.1 | 0.14 | 0.085 | <0.1 | 270 | <2.0 | <2.0 | 940 | 1.3 | NA | NA |
| 32S/12E-24B02 | 10/28/2010 | 650 | 43 | 50 | 4.5 | 110 | 35 | 270 | 160 | <0.1 | <1.0 | 0.12 | <0.1 | NA | 0.085 | <0.3 | 270 | <10 | <10 | 970 | 0.63 | NA | NA |
| 32S/12E-24B02 | 7/27/2010 | 598 | 42 | 48.9 | 4.29 | 111 | 40.5 | 318 | 160 | <0.10 | 1.3 | 0.0609 | <0.10 | 0.11 | 0.106 | 0.15 | 318 | <1.0 | <1.0 | 980 | 2.84 | 0.0036 | 280 |
| 32S/12E-24B02 | 4/27/2010 | 668 | 46 | 52.7 | 4.73 | 111 | 43.2 | 349 | 150 | <0.10 | 1.3 | 0.0666 | <0.10 | 0.14 | 0.101 | 0.16 | 349 | <1.0 | <1.0 | 980 | 6.66 | 0.0035 | 288 |
| 32S/12E-24B02 | 1/27/2010 | 622 | 45 | 58.0 | 5.39 | 115 | 32.2 | 270 | 160 | 0.18 | 0.84 | 0.117 | <0.10 | 0.14 | 0.209 | 0.16 | 270 | <1.0 | <1.0 | 920 | 3.49 | 0.0036 | 281 |
| 32S/12E-24B02 | 10/19/2009 | 600 | 49 | 59.1 | 5.12 | 112 | 30.1 | 281 | 160 | <0.10 | 0.98 | 0.0776 | 0.14 | <0.10 | 0.163 | 0.19 | 281 | <1.0 | <1.0 | 870 | 1.14 | 0.0039 | 258 |
| 32S/12E-24B02 | 8/20/2009 | 630 | 49 | 63.5 | 5.85 | 128 | 30.1 | 288 | 150 | <0.10 | 0.98 | NA | <0.10 | <0.10 | 0.203 | 0.20 | 288 | <1.0 | <1.0 | 920 | 3.22 | 0.0041 | 245 |
| 32S/12E-24B02 | 5/12/2009 | 622 | 82 | 67.5 | 6.33 | 114 | 34.5 | 282 | 150 | NA | NA | NA | 0.11 | NA | 0.252 | 0.24 | 282 | <1.0 | <1.0 | 990 | 6.76 | 0.0029 | 342 |
| 32S/12E-24B02 | 3/26/1996 | 652 | 54 | 46 | 5 | 107 | 24 | 344 | 169 | 0.2 | NA | 0.1 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B02 | 6/9/1976 | 565 | 34 | 52 | 4 | 104 | 27 | 337 | 153 | 0.6 | NA | 0.02 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B02 | 1/17/1966 | 651 | 62 | 79 | 5 | 101 | 32 | 380 | 147 | 0 | NA | 0.05 | 0.3 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 32S/12E-24B03 | 10/11/2017 | 660 | 49 | 54 | 4 | 120 | 45 | 330 | 160 | ND | 0.16 | 0.069 | 0.022 | 0.02 | 0.011 | 0.19 | 330 | ND | ND | 1020 | 0.2 | 0.0039 | 258 |
| 32S/12E-24B03 | 7/12/2017 | 790 | 46 | 54 | 4 | 120 | 45 | 320 | 160 | ND | ND | 0.062 | 0.015 | 0.02 | 0.011 | 0.18 | 320 | ND | ND | 1,010 | 0.19 | 0.0039 | 256 |
| 32S/12E-24B03 | 4/11/2017 | 670 | 48 | 55 | 4.1 | 120 | 45 | 330 | 160 | ND | 0.17 | 0.058 | ND | 0.019 | 0.012 | 0.21 | 330 | ND | ND | 988 | 0.23 | 0.0044 | 229 |
| 32S/12E-24B03 | 1/12/2017 | 670 | 47 | 58 | 4.3 | 130 | 50 | 340 | 160 | ND | ND | 0.068 | 0.012 | 0.024 | 0.014 | 0.18 | 340 | ND | ND | 1,000 | 0.27 | 0.0038 | 261 |
| 32S/12E-24B03 | 10/11/2016 | 680 | 49 | 53 | 4 | 110 | 47 | 340 | 160 | ND | ND | 0.06 | 0.015 | 0.025 | 0.013 | 0.17 | 340 | ND | ND | 1020 | 0.22 | 0.0035 | 288 |
| 32S/12E-24B03 | 7/19/2016 | 690 | 47 | 54 | 4.1 | 110 | 46 | 340 | 160 | <0.096 | 0.32 | 0.063 | 0.017 | 0.016 | 0.013 | 0.20 | 340 | <8.2 | <8.2 | 1,010 | 0.32 | 0.0043 | 235 |
| 32S/12E-24B03 | 4/12/2016 | 680 | 48 | 55 | 4.1 | 110 | 45 | 320 | 160 | <0.096 | 0.21 | 0.056 | 0.019 | 0.018 | 0.012 | 0.17 | 320 | <8.2 | <8.2 | 1,010 | 0.28 | 0.0035 | 282 |
| 32S/12E-24B03 | 1/12/2016 | 610 | 51 | 53 | 4.0 | 110 | 46 | 320 | 170 | <0.022 | 0.11 | 0.037 | 0.038 | <0.10 | 0.015 | 0.19 | 320 | <8.2 | <8.2 | 1,050 | 0.27 | 0.0037 | 268 |
| 32S/12E-24B03 | 10/15/2015 | 650 | 44 | 48 | 4.4 | 100 | 42 | 325 | 160 | <0.05 | <1 | <0.05 | <0.10 | 0.016 | 0.010 | <0.10 | 325 | <10 | <10 | 1,020 | 0.21 | NA | NA |
| 32S/12E-24B03 | 7/15/2015 | 680 | 46 | 60 | 40.0 | 120 | 47 | 333 | 160 | <0.05 | <1 | 0.064 | <0.1 | 0.01 | 0.010 | <0.1 | 333 | <10 | <10 | 1,020 | 0.20 | NA | NA |
| 32S/12E-24B03 | 4/15/2015 | 650 | 46 | 44 | 3.5 | 96 | 38 | 330 | 170 | <0.05 | <1 | 0.061 | <0.1 | 0.012 | 0.0080 | <0.1 | 330 | <10 | <10 | 980 | 0.17 | NA | NA |
| 32S/12E-24B03 | 1/14/2015 | 670 | 47 | 48 | 3.6 | 110 | 43 | 330 | 170 | <0.05 | <1 | 0.052 | <0.10 | 0.01 | 0.090 | <0.1 | 330 | <10 | <10 | 970 | 0.17 | NA | NA |
| 32S/12E-24B03 | 10/14/2014 | 650 | 40 | 48 | 4.1 | 100 | 41 | 330 | 142 | <0.05 | <1 | 0.061 | <0.1 | <0.01 | 0.010 | <0.1 | 330 | <10 | <10 | 1,010 | 0.19 | NA | NA |
| 32S/12E-24B03 | 7/30/2014 | 650 | 45 | 45 | 3.1 | 94 | 40 | 390 | 150 | <0.05 | <1 | <0.1 | <0.1 | <0.01 | <0.005 | <0.1 | 390 | <10 | <10 | 1,020 | 0.19 | NA | NA |
| 32S/12E-24B03 | 4/16/2014 | 660 | 43 | 46 | 4.3 | 90 | 35 | 330 | 150 | 0.23 | <1 | 0.056 | <0.1 | <0.01 | <0.005 | 0.11 | 330 | <10 | <10 | 1,010 | 0.16 | 0.0026 | 391 |
| 32S/12E-24B03 | 1/15/2014 | 660 | 45 | 52 | 4.0 | 100 | 41 | 320 | 165 | <0.05 | <1 | <0.05 | <0.1 | <0.01 | 0.0090 | <0.1 | 320 | <10 | <10 | 1,010 | 0.17 | NA | NA |
| 32S/12E-24B03 | 10/15/2013 | 720 | 40 | 51 | 4.0 | 100 | 40 | 310 | 170 | <0.05 | <1 | <0.05 | <0.1 | <0.01 | 0.0090 | <0.1 | 310 | <10 | <10 | 1,010 | 0.2 | NA | NA |
| 32S/12E-24B03 | 7/9/2013 | 660 | 46 | 47 | 3.9 | 110 | 41 | 310 | 170 | <0.05 | <1 | 0.066 | <0.1 | <0.01 | 0.0100 | <0.1 | 310 | <10 | <10 | 1,010 | 0.27 | NA | NA |
| 32S/12E-24B03 | 4/10/2013 | 670 | 44 | 46 | 3.8 | 96 | 38 | 320 | 160 | <0.05 | <1 | 0.071 | <0.1 | <0.01 | 0.0080 | <0.1 | 320 | <10 | <10 | 1,010 | 0.19 | NA | NA |
| 32S/12E-24B03 | 1/14/2013 | 630 | 45 | 47 | 3.9 | 96 | 37 | 320 | 170 | <0.05 | <1 | 0.065 | <0.1 | <0.01 | 0.0080 | <0.1 | 320 | <10 | <10 | 1,010 | 0.26 | NA | NA |
| 32S/12E-24B03 | 10/29/2012 | 680 | 45 | 49 | 4.1 | 100 | 39 | 305 | 158 | <0.05 | <1 | 0.069 | 0.1 | <0.01 | 0.0090 | <0.1 | 305 | <10 | <10 | 1,010 | 0.22 | NA | NA |
| 32S/12E-24B03 | 7/23/2012 | 670 | 49 | 47 | 4.1 | 86 | 35 | 318 | 170 | <0.05 | <1 | <0.1 | <0.1 | <0.01 | 0.0150 | <0.1 | 318 | <10 | <10 | 1,010 | 0.24 | NA | NA |
| 32S/12E-24B03 | 4/18/2012 | 640 | 50 | 40 | 3.4 | 84 | 33 | 320 | 160 | <0.1 | <1 | <0.1 | <0.2 | <0.01 | 0.0070 | <0.2 | 320 | <10 | <10 | 1,010 | 0.23 | NA | NA |
| 32S/12E-24B03 | 1/12/2012 | 660 | 46 | 48 | 3.2 | 92 | 36 | 300 | 150 | <0.1 | <1 | <0.1 | 0.35 | <0.02 | 0.0080 | <0.2 | 300 | <10 | <10 | 1,000 | 0.15 | NA | NA |
| 32S/12E-24B03 | 11/21/2011 | 660 | 43 | 41 | 3.7 | 91 | 34 | 310 | 150 | <0.05 | 1.6 | 0.046 | <0.1 | 0.014 | 0.0090 | <0.1 | 310 | <10 | <10 | 970 | 0.12 | NA | NA |
| 32S/12E-24B03 | 7/25/2011 | 650 | 46 | 50 | 6.0 | 98 | 38 | 310 | 159.6 | <0.05 | <1 | <0.1 | <0.1 | 0.011 | 0.0100 | <0.1 | 310 | <5 | <5 | 1,010 | 0.21 | NA | NA |
| 32S/12E-24B03 | 4/20/2011 | 650 | 47 | 48 | 4.6 | 95 | 31 | 310 | 168 | <0.05 | <1 | 0.11 | 0.08 | 0.015 | 0.0080 | <0.1 | 310 | <2.0 | <2.0 | 1,020 | NA | NA | NA |
| 32S/12E-24B03 | 1/24/2011 | 660 | 46 | 44 | 5.6 | 87 | 33 | 320 | 160 | <0.05 | <1.0 | NA | <0.1 | 0.15 | 0.0096 | <0.1 | 320 | <2.0 | <2.0 | 1,020 | 0.22 | NA | NA |
| 32S/12E-24B03 | 10/28/2010 | 660 | 44 | 48 | 3.8 | 110 | 39 | 315 | 50 | <0.1 | <1.0 | 0.089 | <0.1 | NA | 0.0120 | <0.3 | 315 | <10 | <10 | 1,020 | 0.55 | NA | NA |
| 32S/12E-24B03 | 7/27/2010 | 610 | 44 | 51.4 | 8.34 | 112 | 41.6 | 328 | 160 | <0.10 | 1.8 | 0.0533 | <0.10 | 0.17 | 0.0602 | 0.16 | 328 | <1.0 | <1.0 | 1,000 | 6.7 | 0.0036 | 275 |
| 32S/12E-24B03 | 4/27/2010 | 666 | 45 | 53.2 | 4.84 | 118 | 44 | 357 | 150 | <0.10 | 1.5 | 0.0636 | <0.10 | 0.1 | 0.0519 | 0.17 | 357 | <1.0 | <1.0 | 980 | 9.71 | 0.0038 | 265 |
| 32S/12E-24B03 | 1/27/2010 | 672 | 48 | 56.4 | 5.40 | 119 | 43.4 | 336 | 150 | <0.10 | 1.4 | 0.101 | <0.10 | 0.15 | 0.140 | 0.15 | 336 | <1.0 | <1.0 | 1,000 | 5.18 | 0.0031 | 320 |
| 32S/12E-24B03 | 10/19/2009 | 622 | 40 | 55.1 | 3.93 | 110 | 42.6 | 342 | 160 | <0.10 | <0.50 | 0.0613 | <0.10 | 0.13 | 0.0181 | 0.14 | 342 | <1.0 | <1.0 | 880 | 0.343 | 0.0035 | 286 |
| 32S/12E-24B03 | 8/19/2009 | 680 | 47 | 54.9 | 5.21 | 128 | 43.4 | 337 | 150 | <0.10 | 2.2 | NA | <0.10 | 0.66 | 0.182 | 0.15 | 337 | <1.0 | <1.0 | 1,000 | 14.3 | 0.0032 | 313 |
| 32S/12E-24B03 | 5/12/2009 | 645 | 44 | 53.2 | 4.53 | 108 | 41.8 | 332 | 140 | NA | NA | NA | <0.10 | NA | 0.124 | 0.16 | 332 | <1.0 | <1.0 | 1,000 | 5.9 | 0.0036 | 275 |
| 32S/12E-24B03 | 3/26/1996 | 646 | 41 | 52 | 4.3 | 104 | 42 | 412 | 164 | 0.2 | NA | 0.12 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B03 | 6/9/1976 | 569 | 36 | 53 | 3.7 | 85 | 39 | 330 | 165 | 0 | NA | 0.06 | 0.4 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/12E-24B03 | 1/17/1966 | 670 | 79 | 74 | 5 | 103 | 36 | 345 | 158 | 1 | NA | 0 | 0.2 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|--------|--------------------------|--------------------------|
| 32S/13E-30F01 | 10/11/2017 | 500 | 68 | 67 | 2.2 | 46 | 23 | 97 | 120 | 13 | 0.18 | 0.093 | 0.045 | ND | 0.018 | 0.28 | 97 | ND | ND | 752 | 0.061 | 0.0041 | 243 |
| 32S/13E-30F01 | 4/12/2017 | 510 | 61 | 65 | 2.1 | 42 | 20 | 85 | 120 | 13 | 0.12 | 0.074 | 0.062 | ND | ND | 0.28 | 85 | ND | ND | 682 | 0.045 | 0.0046 | 218 |
| 32S/13E-30F01 | 10/11/2016 | 480 | 62 | 72 | 2.3 | 46 | 23 | 91 | 120 | 12 | 0.13 | 0.09 | 0.046 | ND | ND | 0.32 | 91 | ND | ND | 702 | ND | 0.0052 | 194 |
| 32S/13E-30F01 | 4/13/2016 | 460 | 60 | 70 | 2.3 | 43 | 21 | 90 | 120 | 52 | 0.2 | 0.086 | 0.054 | <0.01 | <0.0040 | 0.30 | 90 | <4.1 | <4.1 | 696 | <0.030 | 0.0050 | 200 |
| 32S/13E-30F01 | 10/14/2015 | 450 | 58 | 61 | 2.1 | 39 | 19 | 87 | 120 | 13 | <1 | 0.084 | <0.10 | <0.01 | <0.005 | 0.18 | 87 | <10 | <10 | 700 | <0.05 | 0.0031 | 322 |
| 32S/13E-30F01 | 4/15/2015 | 460 | 64 | 60 | 2.0 | 40 | 19 | 90 | 130 | 12 | <1 | 0.081 | <0.1 | <0.01 | <0.005 | 0.202 | 90 | <10 | <10 | 700 | <0.05 | 0.0032 | 317 |
| 32S/13E-30F01 | 1/14/2015 | 550 | 95 | 69 | 2 | 50 | 24 | 98 | 140 | 12.50 | <1 | 0.085 | <0.1 | <0.01 | <0.005 | 0.2 | 98 | <10 | <10 | 820 | <0.05 | 0.0018 | 562 |
| 32S/13E-30F01 | 10/14/2014 | 470 | 58 | 64 | 2 | 42 | 19 | 84 | 120 | 10.00 | <1 | 0.081 | <0.1 | <0.01 | <0.005 | 0.2 | 84 | <10 | <10 | 730 | <0.05 | 0.0030 | 337 |
| 32S/13E-30F01 | 7/30/2014 | 540 | 89 | 71 | 2 | 46 | 24 | 94 | 130 | 13.6 | <1 | <0.1 | <0.1 | <0.01 | <0.005 | 0.101 | 94 | <10 | <10 | 860 | <0.05 | 0.0011 | 881 |
| 32S/13E-30F01 | 4/16/2014 | 610 | 122 | 78 | 3.3 | 47 | 22 | 100 | 140 | 12 | <1 | 0.100 | <0.1 | <0.01 | <0.005 | 0.17 | 100 | <10 | <10 | 970 | <0.05 | 0.0014 | 718 |
| 32S/13E-30F01 | 1/15/2014 | 510 | 80 | 69 | 2.3 | 45 | 22 | 94 | 136 | 12.6 | 13.00 | <0.1 | <0.1 | <0.01 | <0.005 | 0.19 | 94 | <10 | <10 | 810 | <0.05 | 0.0024 | 421 |
| 32S/13E-30F01 | 10/15/2013 | 530 | 78 | 73 | 2.3 | 47 | 22 | 86 | 140 | 12 | <1 | 0.072 | <0.1 | <0.01 | <0.005 | 0.17 | 86 | <10 | <10 | 830 | <0.05 | 0.0022 | 459 |
| 32S/13E-30F01 | 7/10/2013 | 480 | 80 | 64 | 2.2 | 49 | 22 | 85 | 140 | 12.2 | <1 | 0.089 | <0.1 | <0.01 | <0.005 | <0.1 | 85 | <10 | <10 | 770 | <0.05 | NA | NA |
| 32S/13E-30F01 | 4/11/2013 | 460 | 60 | 60 | 2.20 | 38 | 18 | 78 | 120 | 12 | <1 | 0.091 | <0.1 | <0.01 | <0.005 | 0.2 | 78 | <10 | <10 | 710 | <0.05 | 0.0033 | 300 |
| 32S/13E-30F01 | 1/15/2013 | 440 | 65 | 64 | 2.40 | 40 | 19 | 95 | 130 | 12 | <1 | 0.090 | <0.1 | <0.01 | <0.005 | 0.11 | 95 | <10 | <10 | 720 | 0.05 | 0.0017 | 591 |
| 32S/13E-30F01 | 10/30/2012 | 470 | 60 | 66 | 2.50 | 43 | 20 | 75 | 123 | 12 | <1 | 0.087 | <0.1 | <0.01 | <0.005 | 0.13 | 75 | <10 | <10 | 720 | <0.05 | 0.0022 | 462 |
| 32S/13E-30F01 | 7/24/2012 | 470 | 73 | 66 | 2.70 | 36 | 18 | 86 | 120 | 13 | <1 | <0.1 | <0.1 | <0.01 | 0.019 | 0.11 | 86 | <10 | <10 | 720 | <0.05 | 0.0015 | 664 |
| 32S/13E-30F01 | 4/19/2012 | 450 | 72 | 52 | 1.90 | 32 | 15 | 81 | 130 | 13 | <1 | <0.1 | <0.2 | <0.01 | <0.005 | <0.2 | 81 | <10 | <10 | 700 | <0.1 | NA | NA |
| 32S/13E-30F01 | 1/10/2012 | 460 | 67 | 61 | 2.00 | 35 | 17 | 81 | 120 | 11 | <1 | <0.1 | 0.12 | <0.01 | <0.005 | <0.1 | 81 | <10 | <10 | 720 | <0.1 | NA | NA |
| 32S/13E-30F01 | 11/17/2011 | 470 | 70 | 82 | 2.40 | 40 | 19 | 78 | 120 | 12 | <1 | <0.1 | <0.1 | <0.01 | <0.005 | 0.16 | 78 | <10 | <10 | 720 | <0.1 | 0.0023 | 438 |
| 32S/13E-30F01 | 7/25/2011 | 460 | 66 | 68 | 4.40 | 37 | 19 | 78 | 117.4 | 12.17 | <1 | 0.100 | 0.101 | <0.01 | 0.014 | 0.178 | 78 | <5 | <5 | 720 | 0.11 | 0.0027 | 370 |
| 32S/13E-30F01 | 4/20/2011 | 460 | 71 | 69 | 2.60 | 36 | 14 | 87 | 124 | 12 | <1 | 0.180 | 0.11 | <0.01 | <0.005 | 0.17 | 87 | <2.0 | <2.0 | 730 | NA | 0.0024 | 418 |
| 32S/13E-30F01 | 1/24/2011 | 510 | 75 | 64 | 4.00 | 34 | 18 | 83 | 140 | 11 | <1.0 | 0.170 | 0.11 | <0.10 | <0.005 | <0.1 | 83 | <2.0 | <2.0 | 780 | <0.1 | NA | NA |
| 32S/13E-30F01 | 10/21/2010 | 540 | 100 | 73 | 2.00 | 43 | 21 | 88 | 120 | 13 | <1.0 | 0.067 | <0.1 | NA | <0.005 | <0.3 | 88 | <10 | <10 | 894 | <.1 | NA | NA |
| 32S/13E-30F01 | 7/26/2010 | 464 | 74 | 82.2 | 2.16 | 47.9 | 25.1 | 88.0 | 120 | 12 | < 0.50 | 0.098 | < 0.10 | < 0.10 | 0.0817 | 0.37 | 88.0 | < 1.0 | < 1.0 | 710 | 0.79 | 0.0050 | 200 |
| 32S/13E-30F01 | 4/27/2010 | 534 | 72 | 77.1 | 2.59 | 45.8 | 23.6 | 100 | 140 | 9.8 | 0.56 | 0.129 | < 0.10 | < 0.10 | 0.112 | 0.29 | 100 | < 1.0 | < 1.0 | 780 | 1.02 | 0.0040 | 248 |
| 32S/13E-30F01 | 1/28/2010 | 725 | 140 | 99.9 | 2.70 | 76.4 | 35.8 | 214 | 170 | 1.6 | 0.84 | 0.120 | < 0.10 | < 0.10 | 0.112 | 0.56 | 214 | < 1.0 | < 1.0 | 1,200 | 0.640 | 0.0040 | 250 |
| 32S/13E-30F01 | 10/19/2009 | 522 | 74 | 85.6 | 2.35 | 52.8 | 26.3 | 102 | 150 | 13 | 0.70 | 0.136 | 0.13 | < 0.10 | 0.123 | 0.32 | 102 | < 1.0 | < 1.0 | 770 | 1.30 | 0.0043 | 231 |
| 32S/13E-30F01 | 8/19/2009 | 648 | 92 | 98.9 | 3.84 | 63.1 | 31.9 | 113 | 190 | 10 | 0.56 | NA | < 0.10 | 0.12 | 1.03 | 0.32 | 113 | < 1.0 | < 1.0 | 970 | 4.52 | 0.0035 | 288 |
| 32S/13E-30F01 | 5/12/2009 | 792 | 110 | 108 | 2.89 | 80.2 | 39.9 | 136 | 280 | NA | NA | NA | < 0.10 | NA | 0.0353 | 0.39 | 136 | < 1.0 | < 1.0 | 1,200 | 0.281 | 0.0035 | 282 |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|---------|--------------------------|--------------------------|
| 32S/13E-30F02 | 10/11/2017 | 580 | 51 | 46 | 2.6 | 80 | 34 | 200 | 130 | 14 | 0.16 | 0.094 | 0.083 | ND | 0.037 | 0.65 | 200 | ND | ND | 877 | 0.037 | 0.0127 | 78 |
| 32S/13E-30F02 | 7/12/2017 | 570 | 52 | 49 | 2.9 | 89 | 39 | 200 | 130 | 13 | ND | 0.094 | 0.096 | ND | 0.15 | 0.66 | 200 | ND | ND | 861 | ND | 0.0127 | 79 |
| 32S/13E-30F02 | 4/12/2017 | 620 | 52 | 51 | 2.9 | 88 | 38 | 200 | 130 | 13 | ND | 0.088 | 0.063 | ND | 0.022 | 0.67 | 200 | ND | ND | 856 | 0.041 | 0.0129 | 78 |
| 32S/13E-30F02 | 1/10/2017 | 590 | 52 | 50 | 2.8 | 90 | 37 | 220 | 140 | 13 | ND | 0.09 | 0.08 | ND | 1.1 | 0.6 | 220 | ND | ND | 884 | 0.15 | 0.0115 | 87 |
| 32S/13E-30F02 | 10/11/2016 | 600 | 52 | 50 | 2.9 | 89 | 40 | 220 | 140 | 13 | 0.089 | 0.09 | 0.074 | ND | 0.025 | 0.6 | 220 | ND | ND | 886 | ND | 0.0115 | 87 |
| 32S/13E-30F02 | 7/20/2016 | 590 | 51 | 51 | 3.0 | 88 | 38 | 220 | 130 | 58 | 0.14 | 0.091 | 0.072 | <0.010 | 0.170 | 0.57 | 220 | <4.1 | <4.1 | 880 | 0.033 | 0.0112 | 89 |
| 32S/13E-30F02 | 4/13/2016 | 570 | 51 | 51 | 2.9 | 89 | 40 | 200 | 130 | 58 | 0.08 | 0.1 | 0.086 | <0.010 | 0.014 | 0.60 | 200 | <4.1 | <4.1 | 876 | <0.030 | 0.0118 | 85 |
| 32S/13E-30F02 | 1/13/2016 | 610 | 53 | 51 | 2.9 | 89 | 38 | 210 | 140 | 13 | 0.14 | 0.091 | 0.15 | <0.010 | 0.035 | 0.47 | 210 | <4.1 | <4.1 | 858 | <0.030 | 0.0089 | 113 |
| 32S/13E-30F02 | 10/14/2015 | 570 | 49 | 45 | 2.8 | 80 | 35 | 212 | 130 | 13 | <1 | 0.085 | <0.10 | <0.01 | 0.20 | 0.39 | 212 | <10 | <10 | 890 | 0.078 | 0.0080 | 126 |
| 32S/13E-30F02 | 7/15/2015 | 610 | 50 | 51 | 2.0 | 88 | 38 | 204 | 140 | 13 | <1 | 0.091 | <0.1 | <0.01 | 0.048 | 0.30 | 204 | <10 | <10 | 890 | <0.05 | 0.0060 | 167 |
| 32S/13E-30F02 | 4/15/2015 | 570 | 51 | 43 | 2.7 | 78 | 34 | 200 | 140 | 13.5 | <1 | 0.085 | <0.1 | <0.01 | 0.087 | 0.42 | 200 | <10 | <10 | 850 | <0.05 | 0.0082 | 121 |
| 32S/13E-30F02 | 1/14/2015 | 590 | 51 | 42 | 2.4 | 80 | 34 | 210 | 140 | 13 | <1 | 0.08 | <0.1 | <0.01 | 0.014 | 0.324 | 210 | <10 | <10 | 860 | <0.05 | 0.0064 | 157 |
| 32S/13E-30F02 | 10/14/2014 | 600 | 46 | 42 | 2.6 | 76 | 32 | 310 | 120 | 12 | <1 | 0.08 | <0.1 | <0.01 | 0.22 | 0.37 | 310 | <10 | <10 | 890 | <0.05 | 0.0080 | 124 |
| 32S/13E-30F02 | 7/30/2014 | 580 | 49 | 46 | 2.6 | 80 | 35 | 210 | 130 | 13 | <1 | <0.1 | <0.1 | <0.01 | 0.02 | 0.27 | 210 | <10 | <10 | 890 | <0.05 | 0.0055 | 181 |
| 32S/13E-30F02 | 4/16/2014 | 590 | 49 | 45 | 3.3 | 68 | 30 | 200 | 130 | 12 | <1 | 0.089 | <0.1 | <0.01 | 0.011 | 0.44 | 200 | <10 | <10 | 890 | <0.05 | 0.0090 | 111 |
| 32S/13E-30F02 | 1/15/2014 | 580 | 50 | 45 | 2.7 | 76 | 31 | 190 | 136 | 13.1 | 13.4 | <0.1 | <0.1 | <0.01 | 0.054 | 0.4 | 190 | <10 | <10 | 890 | <0.05 | 0.0080 | 125 |
| 32S/13E-30F02 | 10/15/2013 | 570 | 50 | 45 | 2.7 | 75 | 33 | 190 | 140 | 12 | <1 | 0.69 | 0.19 | <0.01 | 0.099 | 0.38 | 190 | <10 | <10 | 890 | <0.05 | 0.0076 | 132 |
| 32S/13E-30F02 | 7/10/2013 | 570 | 50 | 38 | 2.6 | 78 | 32 | 190 | 180 | <0.05 | <1 | 0.08 | 0.13 | <0.01 | 0.14 | <0.1 | 190 | <10 | <10 | 880 | <0.05 | NA | NA |
| 32S/13E-30F02 | 4/11/2013 | 590 | 50 | 41 | 2.6 | 70 | 30 | 190 | 140 | 14 | <1 | 0.09 | 0.1 | <0.01 | 0.082 | 0.43 | 190 | <10 | <10 | 880 | <0.05 | 0.0086 | 116 |
| 32S/13E-30F02 | 1/15/2013 | 550 | 50 | 44 | 2.9 | 72 | 31 | 200 | 140 | 13 | <1 | 0.09 | 0.1 | <0.01 | 0.011 | 0.32 | 200 | <10 | <10 | 880 | 0.12 | 0.0064 | 156 |
| 32S/13E-30F02 | 10/30/2012 | 610 | 48 | 45 | 3.0 | 79 | 34 | 188 | 135 | 13 | <1 | 0.09 | <0.1 | <0.01 | 0.06 | 0.31 | 188 | <10 | <10 | 890 | 0.011 | 0.0065 | 155 |
| 32S/13E-30F02 | 7/24/2012 | 590 | 56 | 46 | 3.2 | 69 | 30 | 194 | 140 | 14 | <1 | <0.1 | 0.11 | <0.01 | 0.038 | 0.27 | 194 | <10 | <10 | 880 | <0.05 | 0.0048 | 207 |
| 32S/13E-30F02 | 4/19/2012 | 600 | 60 | 40 | 2.7 | 68 | 30 | 200 | 140 | 14 | <1 | <0.1 | <0.2 | <0.01 | 0.19 | 0.3 | 200 | <10 | <10 | 890 | 0.11 | 0.0050 | 200 |
| 32S/13E-30F02 | 1/12/2012 | 610 | 52 | 45 | 3.0 | 73 | 32 | 200 | 130 | 12 | <1 | <0.1 | 0.25 | <0.02 | 0.29 | 0.33 | 200 | <10 | <10 | 890 | <0.1 | 0.0063 | 158 |
| 32S/13E-30F02 | 11/21/2011 | 580 | 49 | 38 | 2.7 | 73 | 30 | 190 | 120 | 13 | <1 | 0.07 | <0.1 | <0.01 | 0.022 | 0.34 | 190 | <10 | <10 | 870 | <0.1 | 0.0069 | 144 |
| 32S/13E-30F02 | 7/25/2011 | 590 | 52 | 46 | 5.1 | 73 | 31 | 190 | 134.3 | 13.19 | <1 | <0.1 | 0.127 | <0.1 | 0.025 | 0.387 | 190 | <5 | <5 | 900 | <0.1 | 0.0074 | 135 |
| 32S/13E-30F02 | 4/20/2011 | 600 | 54 | 57 | 4.2 | 74 | 29 | 200 | 141 | 13 | <1 | 0.18 | 0.17 | <0.01 | 0.025 | 0.38 | 200 | <2.0 | <2.0 | 920 | NA | 0.0070 | 142 |
| 32S/13E-30F02 | 1/24/2011 | 600 | 51 | 43 | 4.9 | 71 | 31 | 210 | 140 | 12 | <1.0 | 0.15 | 0.12 | 0.27 | 0.041 | 0.3 | 210 | <2.0 | <2.0 | 920 | <0.1 | 0.0059 | 170 |
| 32S/13E-30F02 | 10/28/2010 | 610 | 49 | 38 | 2.3 | 70 | 30 | 210 | 130 | 11 | <1.0 | 0.10 | <0.1 | NA | 0.0094 | <0.3 | 210 | <10 | <10 | 920 | <0.1 | NA | NA |
| 32S/13E-30F02 | 7/26/2010 | 560 | 49 | 45.8 | 2.95 | 85.4 | 36.8 | 223 | 130 | 11 | 2.5 | 0.0928 | < 0.10 | 0.13 | 0.0646 | 0.59 | 223 | < 1.0 | < 1.0 | 890 | < 0.100 | 0.0120 | 83 |
| 32S/13E-30F02 | 4/27/2010 | 634 | 51 | 50.3 | 3.12 | 87.9 | 38.6 | 225 | 130 | 10 | 0.8 | 0.112 | < 0.10 | < 0.10 | 0.615 | 0.51 | 225 | < 1.0 | < 1.0 | 880 | 3.28 | 0.0100 | 100 |
| 32S/13E-30F02 | 1/28/2010 | 604 | 44 | 52.2 | 4.47 | 92.1 | 38.5 | 230 | 150 | 11 | 1.4 | 0.127 | < 0.10 | < 0.10 | 0.913 | 0.48 | 230 | < 1.0 | < 1.0 | 920 | 4.55 | 0.0109 | 92 |
| 32S/13E-30F02 | 10/19/2009 | 566 | 49 | 49.5 | 2.80 | 88.3 | 37.6 | 240 | 140 | 11 | 1.0 | 0.0942 | 0.17 | < 0.10 | 0.924 | 0.51 | 240 | < 1.0 | < 1.0 | 850 | 2.15 | 0.0104 | 96 |
| 32S/13E-30F02 | 8/19/2009 | 614 | 49 | 51.8 | 3.19 | 87.3 | 36.8 | 225 | 130 | 11 | 2.00 | NA | 0.10 | < 0.10 | 2.24 | 0.54 | 225 | < 1.0 | < 1.0 | 920 | 19.4 | 0.0110 | 91 |
| 32S/13E-30F02 | 5/12/2009 | 514 | 54 | 48.7 | 3.26 | 81.1 | 34.9 | 206 | 120 | NA | NA | NA | 0.11 | NA | 1.87 | 0.53 | 206 | < 1.0 | < 1.0 | 890 | 3.23 | 0.0098 | 102 |
| 32S/13E-30F02 | 3/27/1996 | 678 | 49 | 52 | 3.8 | 98 | 42 | 305 | 166 | 49 | NA | 0.16 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30F02 | 6/9/1976 | 637 | 48 | 55 | 2.8 | 98 | 43 | 343 | 172 | 17.6 | NA | 0.1 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30F02 | 1/20/1966 | 580 | 68 | 47 | 2 | 94 | 38 | 280 | 152 | 27 | NA | 0.08 | 0.2 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 32S/13E-30F03 | 10/11/2017 | 660 | 47 | 42 | 2.6 | 110 | 50 | 320 | 170 | ND | 0.13 | 0.067 | 0.13 | 0.037 | 0.021 | 0.2 | 320 | ND | ND | 996 | 0.056 | 0.0043 | 235 |
| 32S/13E-30F03 | 7/12/2017 | 750 | 46 | 44 | 3 | 120 | 53 | 280 | 170 | ND | ND | 0.064 | 0.14 | 0.035 | 0.023 | 0.2 | 280 | ND | ND | 980 | 0.046 | 0.0043 | 230 |
| 32S/13E-30F03 | 4/12/2017 | 640 | 48 | 45 | 2.9 | 120 | 51 | 310 | 170 | ND | ND | 0.076 | 0.16 | 0.035 | 0.022 | 0.22 | 310 | ND | ND | 972 | 0.065 | 0.0046 | 218 |
| 32S/13E-30F03 | 1/10/2017 | 670 | 49 | 44 | 2.7 | 120 | 51 | 330 | 170 | ND | ND | 0.064 | 0.13 | 0.045 | 0.023 | 0.31 | 330 | ND | ND | 993 | 0.14 | 0.0063 | 158 |
| 32S/13E-30F03 | 10/11/2016 | 680 | 48 | 41 | 2.6 | 110 | 49 | 320 | 170 | ND | 0.11 | 0.056 | 0.13 | 0.042 | 0.02 | 0.22 | 320 | ND | ND | 992 | ND | 0.0046 | 218 |
| 32S/13E-30F03 | 7/20/2016 | 660 | 47 | 44 | 2.9 | 110 | 51 | 320 | 170 | <0.096 | <0.080 | 0.062 | 0.12 | 0.032 | 0.023 | 0.20 | 320 | <4.1 | <4.1 | 992 | 0.04 | 0.0043 | 235 |
| 32S/13E-30F03 | 4/13/2016 | 650 | 47 | 42 | 2.7 | 110 | 51 | 310 | 170 | <0.096 | 0.2 | 0.072 | 0.13 | 0.028 | 0.021 | 0.22 | 310 | <4.1 | <4.1 | 981 | 0.03 | 0.0047 | 214 |
| 32S/13E-30F03 | 1/14/2016 | 580 | 49 | 45 | 2.8 | 120 | 52 | 310 | 180 | 0.05 | 0.1 | 0.061 | 0.2 | <0.010 | 0.025 | 0.21 | 310 | <4.1 | <4.1 | 947 | 0.054 | 0.0043 | 233 |
| 32S/13E-30F03 | 10/14/2015 | 660 | 44 | 38 | 2.8 | 100 | 44 | 306 | 160 | <0.05 | <1 | <0.05 | 0.13 | 0.028 | 0.021 | 0.10 | 306 | <10 | <10 | 990 | <0.05 | 0.0023 | 440 |
| 32S/13E-30F03 | 7/15/2015 | 670 | 45 | 45 | 1.9 | 120 | 51 | 305 | 170 | <0.05 | <1 | 0.060 | 0.11 | 0.03 | 0.019 | <0.1 | 305 | <10 | <10 | 990 | <0.05 | NA | NA |
| 32S/13E-30F03 | 4/15/2015 | 650 | 46 | 35 | 2.3 | 99 | 44 | 300 | 170 | <0.05 | <1 | 0.056 | 0.126 | 0.02 | 0.015 | 0.1 | 300 | <10 | <10 | 950 | <0.05 | NA | NA |
| 32S/13E-30F03 | 1/14/2015 | 670 | 46 | 36 | 2.2 | 100 | 45 | 310 | 180 | <0.05 | <1 | 0.05 | 0.121 | 0.02 | 0.016 | <0.1 | 310 | <10 | <10 | 950 | 0.01 | NA | NA |
| 32S/13E-30F03 | 10/14/2014 | 660 | 41 | 35 | 3.0 | 99 | 42 | 310 | 150 | <0.05 | <1 | <0.05 | <0.1 | 0.011 | 0.017 | <0.1 | 310 | <10 | <10 | 990 | <0.05 | NA | NA |
| 32S/13E-30F03 | 7/30/2014 | 660 | 44 | 38 | 2.6 | 96 | 46 | 300 | 160 | <0.05 | <1 | 0.28 | 0.12 | 0.02 | 0.015 | <0.1 | 300 | <10 | <10 | 990 | <0.05 | NA | NA |
| 32S/13E-30F03 | 4/16/2014 | 640 | 44 | 36 | 3.3 | 55 | 38 | 310 | 169 | <0.05 | <1 | 0.062 | 0.12 | 0.02 | 0.011 | 0.11 | 310 | <10 | <10 | 990 | <0.05 | 0.0025 | 400 |
| 32S/13E-30F03 | 1/15/2014 | 650 | 45 | 35 | 2.5 | 90 | 41 | 300 | 173 | <0.05 | <1 | <0.05 | 0.13 | 0.01 | 0.015 | 0.12 | 300 | <10 | <10 | 990 | <0.05 | 0.0027 | 375 |
| 32S/13E-30F03 | 10/15/2013 | 670 | 41 | 40 | 2.7 | 100 | 44 | 280 | 179 | <0.05 | <1 | <0.05 | 0.14 | 0.02 | 0.016 | <0.1 | 280 | <10 | <10 | 990 | <0.05 | NA | NA |
| 32S/13E-30F03 | 7/10/2013 | 650 | 50 | 33 | 2.4 | 100 | 43 | 290 | 140 | 13.5 | <1 | 0.055 | <0.1 | 0.02 | 0.017 | 0.23 | 290 | <10 | <10 | 990 | <0.05 | 0.0046 | 217 |
| 32S/13E-30F03 | 4/11/2013 | 670 | 45 | 36 | 2.7 | 94 | 42 | 300 | 170 | <0.05 | <1 | 0.06 | 0.13 | 0.02 | 0.016 | 0.12 | 300 | <10 | <10 | 990 | <0.05 | 0.0027 | 375 |
| 32S/13E-30F03 | 1/15/2013 | 630 | 45 | 36 | 2.3 | 92 | 41 | 295 | 180 | <0.05 | <1 | 0.06 | 0.11 | <0.01 | 0.015 | <0.1 | 295 | <10 | <10 | 980 | <0.05 | NA | NA |
| 32S/13E-30F03 | 10/30/2012 | 650 | 43 | 40 | 3.1 | 100 | 46 | 280 | 170 | <0.05 | <1 | 0.06 | <0.1 | 0.03 | 0.016 | <0.1 | 280 | <10 | <10 | 990 | 0.02 | NA | NA |
| 32S/13E-30F03 | 7/24/2012 | 640 | 51 | 36 | 2.7 | 81 | 37 | 296 | 180 | <0.05 | <1 | <0.1 | 0.17 | <0.01 | 0.016 | 0.2 | 296 | <10 | <10 | 990 | <0.05 | 0.0039 | 255 |
| 32S/13E-30F03 | 4/19/2012 | 640 | 54 | 32 | 2.3 | 84 | 36 | 290 | 180 | <0.1 | <1 | <0.1 | <0.2 | 0.01 | 0.014 | <0.2 | 290 | <10 | <10 | 990 | <0.1 | NA | NA |
| 32S/13E-30F03 | 1/12/2012 | 660 | 46 | 39 | 2.1 | 94 | 42 | 280 | 160 | <0.1 | <1 | <0.1 | 0.2 | 0.025 | 0.016 | <0.2 | 280 | <10 | <10 | 990 | <0.1 | NA | NA |
| 32S/13E-30F03 | 11/21/2011 | 650 | 43 | 33 | 2.6 | 93 | 39 | 290 | 160 | <0.05 | <1 | 0.04 | 0.15 | 0.028 | 0.016 | <0.1 | 290 | <10 | <10 | 960 | <0.1 | NA | NA |
| 32S/13E-30F03 | 7/25/2011 | 650 | 47 | 46 | 5.1 | 73 | 31 | 190 | 170.5 | <0.05 | <1 | <0.1 | 0.155 | 0.02 | 0.025 | <0.1 | 190 | <5 | <5 | 900 | <0.1 | NA | NA |
| 32S/13E-30F03 | 4/21/2011 | 650 | 48 | 40 | 3.8 | 91 | 34 | 280 | 179 | <0.05 | <1 | 0.1 | 0.2 | 0.029 | 0.015 | 0.11 | 280 | <2.0 | <2.0 | 1,000 | NA | 0.0023 | 436 |
| 32S/13E-30F03 | 1/24/2011 | 650 | 46 | 36 | 4.7 | 87 | 38 | 300 | 170 | <0.05 | <1.0 | 0.11 | 0.17 | 0.24 | 0.016 | <0.1 | 300 | <2.0 | <2.0 | 990 | <0.1 | NA | NA |
| 32S/13E-30F03 | 10/28/2010 | 650 | 46 | 37 | 2.7 | 100 | 43 | 280 | 160 | <0.1 | <1.0 | 0.10 | <0.1 | NA | 0.032 | <0.3 | 280 | <10 | <10 | 1,000 | 0.53 | NA | NA |
| 32S/13E-30F03 | 7/26/2010 | 608 | 45 | 43.8 | 2.94 | 107 | 46.8 | 294 | 160 | 1.3 | 0.84 | 0.0479 | < 0.10 | 0.10 | 0.129 | 0.24 | 294 | < 1.0 | < 1.0 | 900 | 7.55 | 0.0053 | 188 |
| 32S/13E-30F03 | 4/27/2010 | 668 | 48 | 40.8 | 2.91 | 101 | 44.7 | 304 | 160 | 0.21 | 0.84 | 0.0733 | 0.14 | 0.11 | 0.0694 | 0.23 | 304 | < 1.0 | < 1.0 | 940 | 2.62 | 0.0048 | 209 |
| 32S/13E-30F03 | 1/28/2010 | 656 | 40 | 43.1 | 3.91 | 112 | 47.2 | 310 | 180 | < 0.20 | 2.8 | 0.0833 | 0.13 | < 0.10 | 0.287 | 0.21 | 310 | < 1.0 | < 1.0 | 980 | 4.80 | 0.0053 | 190 |
| 32S/13E-30F03 | 10/19/2009 | 626 | 48 | 43.3 | 3.14 | 108 | 46.2 | 308 | 170 | < 0.10 | 1.8 | 0.0646 | 0.22 | < 0.10 | 0.255 | 0.17 | 308 | < 1.0 | < 1.0 | 910 | 2.09 | 0.0035 | 282 |
| 32S/13E-30F03 | 8/19/2009 | 672 | 45 | 43.1 | 3.15 | 111 | 44.3 | 290 | 170 | < 0.10 | 2.5 | NA | 0.14 | < 0.10 | 0.468 | 0.19 | 290 | < 1.0 | < 1.0 | 980 | 18.5 | 0.0042 | 237 |
| 32S/13E-30F03 | 5/12/2009 | 678 | 49 | 44.8 | 3.32 | 109 | 42.9 | 276 | 180 | NA | NA | NA | 0.17 | NA | 0.146 | 0.18 | 276 | < 1.0 | < 1.0 | 960 | 1.16 | 0.0037 | 272 |
| 32S/13E-30F03 | 3/27/1996 | 686 | 41 | 40 | 3.4 | 109 | 48 | 379 | 197 | 0.2 | NA | 0.13 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30F03 | 6/7/1976 | 616 | 43 | 41 | 2.6 | 96 | 49 | 333 | 190 | 0.4 | NA | 0.05 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30F03 | 1/19/1966 | 642 | 69 | 49 | 4 | 109 | 40 | 321 | 182 | 1 | NA | 0.05 | 0.3 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/13E-30N01 | 10/11/2017 | 870 | 150 | 120 | 31 | 78 | 57 | 320 | 170 | ND | 0.68 | 0.24 | 0.38 | 0.019 | 0.12 | 1.5 | 320 | ND | ND | 1350 | 3 | 0.0100 | 100 |
| 32S/13E-30N01 | 4/11/2017 | 960 | 260 | 160 | 35 | 92 | 73 | 350 | 150 | ND | 0.84 | 0.23 | 0.42 | 0.015 | 0.14 | 1.5 | 350 | ND | ND | 1,690 | 3.9 | 0.0058 | 173 |
| 32S/13E-30N01 | 10/12/2016 | 900 | 180 | 130 | 32 | 77 | 61 | 290 | 180 | ND | 0.53 | 0.19 | 0.34 | 0.021 | 0.11 | 1.7 | 290 | ND | ND | 1420 | 2.7 | 0.0094 | 106 |
| 32S/13E-30N01 | 4/12/2016 | 790 | 110 | 110 | 27 | 55 | 46 | 230 | 190 | 0.21 | 0.5 | 0.18 | 0.42 | 0.013 | 0.1 | 1.7 | 230 | <8.2 | <8.2 | 1,190 | 1.7 | 0.0155 | 65 |
| 32S/13E-30N01 | 10/15/2015 | 740 | 120 | 100 | 27 | 52 | 41 | 250 | 190 | <0.05 | <1 | 0.18 | 0.43 | 0.032 | 0.072 | 1.3 | 250 | <10 | <10 | 1,220 | 1.8 | 0.0108 | 92 |
| 32S/13E-30N01 | 4/14/2015 | 930 | 190 | 130 | 28 | 69 | 54 | 360 | 170 | <0.05 | 1.4 | 0.23 | 0.334 | 0.01 | 0.087 | 1.2 | 360 | <10 | <10 | 1,500 | 2.5 | 0.0063 | 158 |
| 32S/13E-30N01 | 1/14/2015 | 845 | 170 | 110 | 29.0 | 71 | 54 | 320 | 180 | <0.05 | <1 | 0.21 | 0.332 | 0.01 | 0.087 | 1.2 | 320 | <10 | <10 | 1,360 | 2.3 | 0.0071 | 140 |
| 32S/13E-30N01 | 10/15/2014 | 790 | 140 | 110 | 30.0 | 62 | 53 | 300 | 160 | 0.68 | <1 | 0.21 | 0.29 | <0.01 | 0.084 | 1.2 | 300 | <10 | <10 | 1,350 | 2.5 | 0.0086 | 117 |
| 32S/13E-30N01 | 7/30/2014 | 800 | 150 | 110 | 27.0 | 61 | 52 | 310 | 160 | <0.05 | <1 | 0.81 | 0.33 | 0.01 | 0.081 | 1.1 | 310 | <10 | <10 | 1,360 | 2.4 | 0.0073 | 136 |
| 32S/13E-30N01 | 4/16/2014 | 850 | 160 | 112 | 26.0 | 55 | 43 | 310 | 170 | <0.05 | <1 | 0.20 | 0.33 | 0.01 | 0.077 | 1.3 | 310 | <10 | <10 | 1,410 | 2.4 | 0.0081 | 123 |
| 32S/13E-30N01 | 1/15/2014 | 790 | 154 | 110 | 26.0 | 56 | 45 | 260 | 190 | <0.05 | <1 | 0.19 | 0.41 | <0.01 | 0.077 | 1.4 | 260 | <10 | <10 | 1,340 | 2.5 | 0.0091 | 110 |
| 32S/13E-30N01 | 10/15/2013 | 950 | 200 | 140 | 32.0 | 74 | 60 | 330 | 180 | <0.05 | <1 | 0.21 | 0.33 | 0.01 | 0.095 | 1.3 | 330 | <10 | <10 | 1,570 | 2.8 | 0.0065 | 154 |
| 32S/13E-30N01 | 7/10/2013 | 830 | 175 | 120 | 29.0 | 71 | 54 | 310 | 185 | <0.05 | <1 | 0.22 | 0.32 | 0.01 | 0.087 | 0.84 | 310 | <10 | <10 | 1,430 | 2.3 | 0.0048 | 208 |
| 32S/13E-30N01 | 4/10/2013 | 860 | 180 | 120 | 29.0 | 67 | 54 | 320 | 180 | <0.05 | 1.1 | 0.21 | 0.31 | 0.01 | 0.087 | 1.2 | 320 | <10 | <10 | 1,470 | 2.5 | 0.0067 | 150 |
| 32S/13E-30N01 | 1/14/2013 | 800 | 170 | 120 | 32.0 | 66 | 53 | 280 | 200 | <0.05 | 1.1 | 0.22 | 0.26 | <0.01 | 0.09 | 1.2 | 280 | <10 | <10 | 1,380 | 2.5 | 0.0071 | 142 |
| 32S/13E-30N01 | 10/29/2012 | 900 | 180 | 120 | 34.0 | 77 | 60 | 300 | 190 | <0.05 | <1 | 0.21 | 0.40 | 0.011 | 0.098 | 1.2 | 300 | <10 | <10 | 1,500 | 2.8 | 0.0067 | 150 |
| 32S/13E-30N01 | 7/23/2012 | 840 | 190 | 120 | 31.0 | 56 | 45 | 266 | 200 | <0.05 | <1 | 0.22 | 0.43 | <0.01 | 0.096 | 1.2 | 266 | <10 | <10 | 1,370 | 2.3 | 0.0063 | 158 |
| 32S/13E-30N01 | 4/18/2012 | 1,050 | 280 | 140 | 31.0 | 59 | 47 | 330 | 210 | <0.1 | 1.4 | 0.2 | 0.50 | <0.01 | 0.078 | 1.3 | 330 | <10 | <10 | 1,680 | 2.4 | 0.0046 | 215 |
| 32S/13E-30N01 | 1/9/2012 | 1,050 | 260 | 170 | 34.0 | 68 | 52 | 307 | 200 | <0.05 | 2.7 | 0.21 | 0.41 | <0.01 | 0.088 | 1.9 | 307 | <10 | <10 | 1,760 | 2.9 | 0.0073 | 137 |
| 32S/13E-30N01 | 11/17/2011 | 1,300 | 360 | 320 | 40 | 90 | 69 | 390 | 220 | <0.1 | <1 | 0.23 | 0.38 | 0.017 | 0.11 | 2.5 | 390 | <10 | <10 | 2,210 | 3.4 | 0.0069 | 144 |
| 32S/13E-30N01 | 7/25/2011 | 1,680 | 445 | 230 | 42 | 99 | 81 | 380 | 255.5 | <0.05 | 1.2 | 0.21 | <0.1 | <0.01 | 0.12 | 3.016 | 380 | <5 | <5 | 2,480 | 4.2 | 0.0068 | 148 |
| 32S/13E-30N01 | 4/20/2011 | 890 | 210 | 130 | 26 | 68 | 46 | 180 | 215 | <0.05 | <1 | 0.24 | 0.39 | 0.013 | 0.086 | 4.57 | 180 | <2.0 | <2.0 | 1,550 | NA | 0.0218 | 46 |
| 32S/13E-30N01 | 1/24/2011 | 870 | 180 | 100 | 28 | 84 | 46 | 240 | 210 | <0.05 | <1.0 | <0.1 | 0.34 | 0.12 | 0.24 | 3.63 | 240 | <2.0 | <2.0 | 1,430 | 18 | 0.0202 | 50 |
| 32S/13E-30N01 | 10/21/2010 | 890 | 190 | 120 | 26 | 58 | 45 | 246 | 200 | <0.1 | <1.0 | <0.1 | 0.37 | NA | 0.078 | 2.3 | 246 | <10 | <10 | 1,498 | <0.1 | 0.0121 | 83 |
| 32S/13E-30N01 | 7/27/2010 | 917 | 200 | 130 | 30.0 | 75.0 | 56.2 | 241 | 220 | <0.10 | <0.50 | 0.165 | 0.29 | 0.23 | 0.101 | 2.8 | 241 | <1.0 | <1.0 | 1,400 | 2.61 | 0.0140 | 71 |
| 32S/13E-30N01 | 4/27/2010 | 808 | 150 | 130 | 29 | 136 | 55.6 | 286 | 210 | 0.76 | 1.7 | 0.171 | 0.37 | 0.19 | 0.276 | 2.6 | 286 | <1.0 | <1.0 | 1,300 | 20.4 | 0.0173 | 58 |
| 32S/13E-30N01 | 1/26/2010 | 902 | 210 | 155 | 33.5 | 156 | 66.4 | 307 | 230 | <0.10 | 1.7 | 0.317 | 0.30 | 0.12 | 0.333 | 3.2 | 307 | <1.0 | <1.0 | 1,500 | 27.3 | 0.0152 | 66 |
| 32S/13E-30N01 | 10/20/2009 | 828 | 200 | 159 | 34.3 | 118 | 59.8 | 238 | 230 | <0.10 | 1.3 | 0.241 | 0.38 | <0.10 | 0.157 | 3.2 | 238 | <1.0 | <1.0 | 1,300 | 5.33 | 0.0160 | 63 |
| 32S/13E-30N01 | 8/20/2009 | 835 | 160 | 150 | 27.8 | 121 | 49.4 | 235 | 220 | <0.10 | 1.3 | NA | 0.37 | 0.12 | 0.228 | 2.9 | 235 | <1.0 | <1.0 | 1,400 | 15.9 | 0.0181 | 55 |
| 32S/13E-30N01 | 5/11/2009 | 960 | 180 | 175 | 33.5 | 86.7 | 46.2 | 274 | 220 | NA | NA | NA | 0.36 | NA | 0.113 | 3.2 | 274 | <1.0 | <1.0 | 1,500 | 2.26 | 0.0178 | 56 |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|--------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|---------|--------------------------|--------------------------|
| 32S/13E-30N03 | 10/11/2017 | 580 | 63 | 54 | 3.2 | 73 | 33 | 150 | 130 | 15 | 0.24 | 0.1 | 0.16 | ND | 0.86 | 0.64 | 150 | ND | ND | 836 | 0.59 | 0.0102 | 98 |
| 32S/13E-30N03 | 7/11/2017 | 560 | 64 | 60 | 3.2 | 77 | 34 | 150 | 140 | 14 | 0.1 | 0.089 | 0.14 | ND | 0.54 | 0.66 | 150 | ND | ND | 871 | 0.18 | 0.0103 | 97 |
| 32S/13E-30N03 | 4/11/2017 | 560 | 69 | 62 | 3.6 | 82 | 36 | 160 | 140 | 14 | 0.12 | 0.08 | 0.15 | ND | 0.62 | 0.69 | 160 | ND | ND | 866 | 0.43 | 0.0100 | 100 |
| 32S/13E-30N03 | 1/12/2017 | 580 | 69 | 62 | 3.6 | 83 | 38 | 170 | 150 | 14 | 0.13 | 0.088 | 0.13 | ND | 3.3 | 0.74 | 170 | ND | ND | 878 | 1.5 | 0.0107 | 93 |
| 32S/13E-30N03 | 10/12/2016 | 580 | 68 | 62 | 3.5 | 80 | 37 | 170 | 140 | 15 | ND | 0.088 | 0.16 | ND | 0.56 | 0.76 | 170 | ND | ND | 879 | 0.17 | 0.0112 | 89 |
| 32S/13E-30N03 | 7/19/2016 | 580 | 66 | 61 | 3.6 | 75 | 36 | 160 | 130 | 65 | 0.20 | 0.084 | 0.16 | <0.010 | 0.030 | 0.76 | 160 | <4.1 | <4.1 | 864 | <0.030 | 0.0115 | 87 |
| 32S/13E-30N03 | 4/12/2016 | 610 | 69 | 60 | 3.4 | 75 | 36 | 160 | 130 | 64 | 0.16 | 0.078 | 0.18 | <0.010 | 0.0095 | 0.78 | 160 | <4.1 | <4.1 | 895 | <0.05 | 0.0113 | 88 |
| 32S/13E-30N03 | 1/13/2016 | 570 | 72 | 62 | 3.4 | 77 | 35 | 160 | 140 | 15 | 0.15 | 0.083 | 0.22 | <0.010 | 0.0089 | 0.66 | 160 | <4.1 | <4.1 | 867 | 0.079 | 0.0092 | 109 |
| 32S/13E-30N03 | 10/15/2015 | 570 | 63 | 54 | 3.3 | 69 | 32 | 162 | 130 | 15 | <1 | 0.0161 | 0.23 | <0.01 | 0.015 | 0.56 | 162 | <10 | <10 | 860 | <0.05 | 0.0089 | 113 |
| 32S/13E-30N03 | 7/16/2015 | 580 | 65 | 65 | 3.0 | 81 | 35 | 160 | 140 | 15 | 15.3 | 0.079 | 0.14 | 0.45 | 0.011 | 0.46 | 160 | <10 | <10 | 880 | <0.05 | 0.0071 | 141 |
| 32S/13E-30N03 | 4/14/2015 | 580 | 65 | 49 | 2.9 | 65 | 31 | 160 | 140 | 15.2 | <1 | 0.078 | <0.1 | <0.01 | <0.005 | 0.47 | 160 | <10 | <10 | 860 | <0.05 | 0.0072 | 138 |
| 32S/13E-30N03 | 1/14/2015 | 610 | 68 | 53 | 3.0 | 73 | 34 | 170 | 150 | 15 | <1 | 0.074 | 0.151 | <0.01 | 0.0540 | 0.43 | 170 | <10 | <10 | 870 | 0.49 | 0.0063 | 158 |
| 32S/13E-30N03 | 10/15/2014 | 560 | 59 | 52 | 3.5 | 67 | 32 | 160 | 130 | 14 | 0.54 | 0.066 | 0.14 | <0.01 | <0.005 | 0.452 | 160 | <10 | <10 | 890 | <0.05 | 0.0077 | 131 |
| 32S/13E-30N03 | 7/30/2014 | 580 | 65 | 55 | 3.2 | 69 | 32 | 170 | 130 | 15 | <1 | <0.1 | 0.16 | <0.01 | <0.005 | 0.34 | 170 | <10 | <10 | 910 | <0.05 | 0.0052 | 191 |
| 32S/13E-30N03 | 4/16/2014 | 610 | 63 | 55 | 4.3 | 65 | 29 | 170 | 140 | 13.00 | <1 | 0.08 | 0.15 | <0.01 | 0.058 | 0.38 | 170 | <10 | <10 | 910 | <0.05 | 0.0060 | 166 |
| 32S/13E-30N03 | 1/15/2014 | 610 | 66 | 54 | 3.2 | 67 | 31 | 170 | 149 | 14.8 | 15 | <0.1 | 0.16 | <0.01 | 0.065 | 0.46 | 170 | <10 | <10 | 910 | 0.27 | 0.0070 | 143 |
| 32S/13E-30N03 | 10/15/2013 | 580 | 60 | 57 | 3.3 | 71 | 32 | 170 | 150 | 14 | <1 | 0.057 | 0.16 | <0.01 | 0.370 | 0.41 | 170 | <10 | <10 | 910 | 0.1 | 0.0068 | 146 |
| 32S/13E-30N03 | 7/10/2013 | 590 | 60 | 48 | 3.1 | 71 | 31 | 160 | 150 | 15.1 | <1 | 0.074 | 0.18 | <0.01 | 1.3 | 0.17 | 160 | <10 | <10 | 900 | 0.43 | 0.0028 | 353 |
| 32S/13E-30N03 | 4/10/2013 | 600 | 66 | 53 | 3.3 | 69 | 31 | 160 | 150 | 15 | <1 | 0.11 | 0.2 | <0.01 | 0.064 | 0.35 | 160 | <10 | <10 | 910 | <0.05 | 0.0053 | 189 |
| 32S/13E-30N03 | 1/14/2013 | 570 | 66 | 55 | 3.4 | 68 | 30 | 165 | 150 | 15 | <1 | 0.093 | 0.2 | <0.01 | 0.028 | 0.27 | 165 | <10 | <10 | 900 | 0.084 | 0.0041 | 244 |
| 32S/13E-30N03 | 10/29/2012 | 610 | 60 | 56 | 3.7 | 74 | 33 | 155 | 148 | 14 | <1 | 0.081 | 0.2 | <0.01 | 0.027 | 0.3 | 155 | <10 | <10 | 900 | 0.04 | 0.0050 | 200 |
| 32S/13E-30N03 | 7/23/2012 | 600 | 71 | 56 | 3.5 | 61 | 28 | 152 | 200 | <0.05 | <1 | 0.1 | <0.1 | <0.02 | 0.120 | 0.3 | 152 | <10 | <10 | 890 | 0.44 | 0.0042 | 237 |
| 32S/13E-30N03 | 4/18/2012 | 570 | 80 | 47 | 3.0 | 57 | 25 | 150 | 150 | 16 | <1 | 0.1 | 0.3 | <0.01 | <0.005 | 0.28 | 150 | <10 | <10 | 880 | <0.1 | 0.0035 | 286 |
| 32S/13E-30N03 | 1/11/2012 | 570 | 67 | 55 | 3.9 | 68 | 30 | 140 | 130 | 14 | <1 | 0.1 | 0.2 | <0.02 | 0.0510 | 0.39 | 140 | <10 | <10 | 870 | 0.17 | 0.0058 | 172 |
| 32S/13E-30N03 | 11/21/2011 | 600 | 67 | 47 | 3.2 | 64 | 28 | 140 | 130 | 15 | 1.2 | 0.088 | 0.2 | <0.01 | <0.005 | 0.62 | 140 | <10 | <10 | 850 | <0.1 | 0.0093 | 108 |
| 32S/13E-30N03 | 7/25/2011 | 590 | 67 | 47 | 5.0 | 54 | 24 | 290 | 139.8 | 15 | <1 | <0.1 | 0.2 | <0.01 | 0.0520 | 0.79 | 290 | <5 | <5 | 890 | 0.14 | 0.0118 | 85 |
| 32S/13E-30N03 | 4/20/2011 | 580 | 76 | 58 | 4.2 | 62 | 23 | 140 | 142 | 16 | <1 | 0.12 | 0.2 | <0.1 | 0.0510 | 0.92 | 140 | <2.0 | <2.0 | 890 | NA | 0.0121 | 83 |
| 32S/13E-30N03 | 1/24/2011 | 570 | 76 | 48 | 4.8 | 55 | 25 | 130 | 130 | 16 | <1.0 | 0.12 | 0.2 | <0.10 | 0.0088 | 1.7 | 130 | <2.0 | <2.0 | 900 | <0.1 | 0.0224 | 45 |
| 32S/13E-30N03 | 10/21/2010 | 550 | 69 | 59 | 3.3 | 65 | 31 | 133 | 130 | 15 | <1.0 | <0.1 | 0.1 | NA | <0.005 | 1.1 | 133 | <10 | <10 | 886 | <0.1 | 0.0159 | 63 |
| 32S/13E-30N03 | 7/27/2010 | 528 | 72 | 55.1 | 3.41 | 68.7 | 31.0 | 139 | 130 | 15.0 | < 0.50 | 0.0672 | 0.14 | 0.11 | < 0.00500 | 1.3 | 139 | < 1.0 | < 1.0 | 860 | < 0.100 | 0.0181 | 55 |
| 32S/13E-30N03 | 4/27/2010 | 672 | 89 | 60.6 | 3.65 | 70.6 | 32.5 | 134 | 130 | 14.0 | < 0.50 | 0.0779 | 0.18 | 0.11 | < 0.00500 | 1.2 | 134 | < 1.0 | < 1.0 | 870 | < 0.100 | 0.0135 | 74 |
| 32S/13E-30N03 | 1/26/2010 | 606 | 110 | 75.0 | 4.51 | 77.8 | 34.3 | 126 | 130 | 14 | 1.4 | 0.0654 | 0.15 | < 0.10 | 0.0130 | 1.3 | 126 | < 1.0 | < 1.0 | 990 | 0.653 | 0.0118 | 85 |
| 32S/13E-30N03 | 10/20/2009 | 806 | 180 | 93.3 | 25.5 | 92.3 | 41.5 | 162 | 150 | 9.7 | 2.2 | 0.107 | 0.26 | < 0.10 | 0.245 | 1.4 | 162 | < 1.0 | < 1.0 | 1,200 | 0.344 | 0.0078 | 129 |
| 32S/13E-30N03 | 8/20/2009 | 1,070 | 190 | 151 | 61.6 | 112 | 44.2 | 130 | 130 | 16 | 3.4 | NA | 0.20 | < 0.10 | 0.151 | 1.6 | 130 | < 1.0 | < 1.0 | 1,700 | 1.93 | 0.0084 | 119 |
| 32S/13E-30N03 | 5/12/2009 | 602 | 97 | 63.4 | 3.96 | 72.9 | 32.2 | 122 | 120 | NA | NA | NA | 0.22 | NA | 24 | 1.2 | 122 | < 1.0 | < 1.0 | 900 | 2.24 | 0.0124 | 81 |
| 32S/13E-30N03 | 3/27/1996 | 624 | 70 | 62 | 4 | 78 | 35 | 150 | 161 | 106.8 | NA | 0.13 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30N03 | 6/7/1976 | 705 | 90 | 54 | 2.9 | 99 | 43 | 189 | 168 | 112.5 | NA | 0.08 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30N03 | 1/21/1966 | 804 | 57 | 54 | 3 | 132 | 59 | 410 | 250 | 1 | NA | 0.08 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|----------------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|---------|--------------------------|--------------------------|
| 32S/13E-30N02 | 10/11/2017 | 1000 | 46 | 70 | 4.8 | 160 | 65 | 200 | 510 | 0.19 | 0.19 | 0.17 | 0.11 | ND | 0.005 | 0.27 | 200 | ND | ND | 1340 | 0.28 | 0.0059 | 170 |
| 32S/13E-30N02 | 7/11/2017 | 1,100 | 49 | 74 | 4.8 | 150 | 64 | 190 | 480 | 0.2 | 0.13 | 0.15 | 0.08 | ND | 0.023 | 0.16 | 190 | ND | ND | 1,360 | 2.0 | 0.0033 | 306 |
| 32S/13E-30N02 | 4/11/2017 | 980 | 50 | 74 | 4.8 | 160 | 64 | 190 | 510 | 0.2 | 0.12 | 0.14 | 0.14 | ND | ND | 0.18 | 190 | ND | ND | 1,320 | 0.2 | 0.0036 | 278 |
| 32S/13E-30N02 | 1/13/2017 | 980 | 49 | 80 | 5.1 | 170 | 69 | 200 | 490 | 0.19 | 0.12 | 0.16 | 0.078 | ND | 0.011 | 0.16 | 200 | ND | ND | 1,340 | 0.63 | 0.0033 | 306 |
| 32S/13E-30N02 | 10/12/2016 | 1,000 | 50 | 77 | 5 | 160 | 69 | 200 | 500 | 0.18 | ND | 0.15 | 0.11 | ND | ND | 0.27 | 200 | ND | ND | 1370 | ND | 0.0054 | 185 |
| 32S/13E-30N02 | 7/19/2016 | 1,000 | 48 | 78 | 5 | 160 | 68 | 200 | 500 | 0.97 | 0.17 | 0.15 | 0.11 | <0.010 | <0.0040 | 0.2 | 200 | <8.2 | <8.2 | 1,350 | <0.030 | 0.0042 | 240 |
| 32S/13E-30N02 | 4/12/2016 | 1,000 | 44 | 72 | 4.8 | 150 | 67 | 190 | 470 | 1.0 | <0.080 | 0.14 | 0.096 | <0.010 | <0.0040 | 0.21 | 190 | <8.2 | <8.2 | 1,390 | <0.030 | 0.0048 | 210 |
| 32S/13E-30N02 | 1/13/2016 | 990 | 48 | 74 | 4.9 | 150 | 64 | 190 | 520 | 0.27 | 0.12 | 0.14 | 0.22 | <0.010 | <0.0040 | <0.046 | 190 | <8.2 | <8.2 | 1,300 | 0.041 | NA | NA |
| 32S/13E-30N02 | 10/15/2015 | 1,040 | 47 | 64 | 4.6 | 140 | 60 | 192 | 480 | 0.72 | <1 | 0.13 | 0.18 | <0.01 | <0.005 | <0.10 | 192 | <10 | <10 | 1,350 | <0.05 | NA | NA |
| 32S/13E-30N02 | 7/16/2015 | 1,030 | 49 | 82 | 4.4 | 170 | 70 | 190 | 480 | 1.4 | 1.52 | 0.15 | <0.1 | <0.01 | <0.005 | 0.11 | 190 | <10 | <10 | 1,360 | <0.05 | 0.0022 | 445 |
| 32S/13E-30N02 | 4/14/2015 | 840 | 47 | 61 | 4.3 | 130 | 58 | 190 | 500 | 0.576 | <1 | 0.14 | <0.3 | <0.01 | <0.005 | <0.3 | 190 | <10 | <10 | 1,330 | <0.05 | NA | NA |
| 32S/13E-30N02 | 1/14/2015 | 1,050 | 50 | 62 | 4.2 | 140 | 59 | 190 | 520 | 0.40 | <1 | 0.13 | 0.115 | <0.01 | <0.005 | <0.1 | 190 | <10 | <10 | 1,320 | <0.05 | NA | NA |
| 32S/13E-30N02 | 10/15/2014 | 1,040 | 44 | 65 | 5.0 | 140 | 58 | 200 | 440 | 0.77 | <1 | 0.13 | <0.1 | <0.01 | <0.005 | <0.1 | 200 | <10 | <10 | 1,370 | <0.05 | NA | NA |
| 32S/13E-30N02 | 7/30/2014 | 1,020 | 45 | 66 | 4.6 | 140 | 60 | 220 | 470 | 0.51 | <1 | 0.10 | 0.13 | <0.01 | <0.005 | <0.4 | 220 | <10 | <10 | 1,340 | <0.05 | NA | NA |
| 32S/13E-30N02 | 4/16/2014 | 1,040 | 46 | 66 | 5.0 | 120 | 50 | 190 | 520 | 0.47 | <1 | 0.14 | 0.1 | <0.01 | <0.005 | <0.1 | 190 | <10 | <10 | 1,350 | <0.05 | NA | NA |
| 32S/13E-30N02 | 1/15/2014 | 1,060 | 45 | 60 | 4.1 | 120 | 49 | 190 | 477 | 0.65 | 1.1 | 0.13 | 0.43 | <0.01 | <0.005 | <0.2 | 190 | <10 | <10 | 1,370 | <0.05 | NA | NA |
| 32S/13E-30N02 | 10/15/2013 | 1,030 | 46 | 70 | 4.9 | 140 | 58 | 190 | 541 | 0.46 | <1 | 0.12 | 0.18 | <0.01 | <0.005 | <0.2 | 190 | <10 | <10 | 1,360 | <0.05 | NA | NA |
| 32S/13E-30N02 | 7/10/2013 | 1,020 | 50 | 61 | 4.5 | 140 | 59 | 185 | 500 | 0.63 | <1 | 0.14 | 0.12 | <0.01 | <0.005 | <0.1 | 185 | <10 | <10 | 1,370 | <0.05 | NA | NA |
| 32S/13E-30N02 | 4/10/2013 | 1,080 | 48 | 60 | 4.3 | 120 | 52 | 185 | 500 | 0.50 | <1 | 0.15 | <0.2 | <0.01 | <0.005 | <0.2 | 185 | <10 | <10 | 1,360 | <0.05 | NA | NA |
| 32S/13E-30N02 | 1/14/2013 | 1,010 | 48 | 63 | 4.5 | 120 | 53 | 188 | 530 | 0.40 | <1 | 0.14 | <0.2 | <0.01 | <0.005 | <0.2 | 188 | <10 | <10 | 1,350 | 0.07 | NA | NA |
| 32S/13E-30N02 | 10/29/2012 | 1,030 | 40 | 68 | 5.0 | 140 | 58 | 180 | 500 | <0.25 | <1 | 0.14 | <0.5 | <0.01 | <0.005 | <0.5 | 180 | <10 | <10 | 1,360 | <0.05 | NA | NA |
| 32S/13E-30N02 | 7/23/2012 | 1,040 | 54 | 63 | 4.5 | 110 | 48 | 188 | 510 | 0.13 | <1 | 0.15 | 0.15 | <0.01 | 0.01 | <0.1 | 188 | <10 | <10 | 1,360 | <0.05 | NA | NA |
| 32S/13E-30N02 | 4/18/2012 | 990 | 60 | 56 | 4.2 | 110 | 47 | 190 | 560 | 0.14 | <1 | 0.12 | 0.21 | <0.01 | <0.005 | 0.28 | 190 | <10 | <10 | 1,360 | <0.1 | 0.0047 | 214 |
| 32S/13E-30N02 | 1/11/2012 | 1,040 | 49 | 64 | 4.9 | 130 | 54 | 180 | 460 | 1.30 | <1 | 0.17 | 0.16 | <0.02 | <0.005 | <0.2 | 180 | <10 | <10 | 1,360 | <0.1 | NA | NA |
| 32S/13E-30N02 | 11/21/2011 | 1,020 | 46 | 57 | 4.5 | 130 | 54 | 180 | 450 | 0.15 | <1 | 0.15 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,360 | <0.1 | NA | NA |
| 32S/13E-30N02 | 7/25/2011 | 1,050 | 50 | 81 | 7.7 | 150 | 62 | 180 | 479.1 | 0.15 | <1 | 0.16 | 0.144 | <0.01 | 0.006 | <0.1 | 180 | <5 | <5 | 1,370 | 0.49 | NA | NA |
| 32S/13E-30N02 | 4/20/2011 | 1,030 | 52 | 63 | 5.4 | 130 | 44 | 180 | 508 | 0.17 | <1 | 0.19 | 0.2 | <0.01 | <0.005 | <0.1 | 180 | <2.0 | <2.0 | 1,380 | NA | NA | NA |
| 32S/13E-30N02 | 1/24/2011 | 1,050 | 50 | 60 | 6.4 | 120 | 49 | 190 | 490 | 0.24 | <1.0 | 0.17 | 0.17 | <0.10 | 0.064 | <0.1 | 190 | <2.0 | <2.0 | 1,380 | 0.12 | NA | NA |
| 32S/13E-30N02 | 10/21/2010 | 1,040 | 48 | 52 | 3.5 | 100 | 45 | 181 | 460 | 0.15 | <1.0 | <0.1 | <0.1 | NA | <0.005 | <0.3 | 181 | <10 | <10 | 1,377 | <0.1 | NA | NA |
| 32S/13E-30N02 | 7/27/2010 | 777 | 57 | 67.6 | 7.31 | 141 | 58.5 | 190 | 470 | 0.3 | 3.5 | 0.138 | < 0.10 | 0.11 | 0.102 | 0.28 | 190 | < 1.0 | < 1.0 | 1,300 | 3.43 | 0.0049 | 204 |
| 32S/13E-30N02 | 4/27/2010 | 800 | 93 | 71.9 | 12.50 | 108 | 46.3 | 159 | 300 | 7.0 | 3.2 | 0.123 | 0.13 | 0.11 | 0.0776 | 0.7 | 159 | < 1.0 | < 1.0 | 1,100 | 3.27 | 0.0075 | 133 |
| 32S/13E-30N02 | 2/25/2010 | 1,000 | 48 | 71.4 | 4.70 | 141 | 58.1 | 195 | 490 | 0.16 | < 0.50 | 0.15 | 0.15 | < 0.10 | 0.0393 | 0.16 | 195 | < 1.0 | < 1.0 | 1,300 | 3.30 | 0.0033 | 300 |
| 32S/13E-30N02 | 2/25/2010 | 1,010 | 74 | 76.9 | 10.2 | 138 | 55.8 | 195 | 440 | 0.13 | 2.4 | 0.142 | 0.16 | < 0.10 | 0.0579 | 0.24 | 195 | < 1.0 | < 1.0 | 1,400 | 1.69 | 0.0032 | 308 |
| 32S/13E-30N02 | 1/26/2010 | 970 | 50 | 74.2 | 4.77 | 152 | 62.2 | 195 | 510 | 0.14 | < 0.50 | 0.129 | 0.11 | < 0.10 | < 0.00500 | 0.16 | 195 | < 1.0 | < 1.0 | 1,300 | < 0.100 | 0.0032 | 313 |
| 32S/13E-30N02 | 10/20/2009 | 2,080 | 690 | 274 | 151 | 239 | 101.0 | 220 | 400 | < 0.10 | 7.0 | 0.201 | 0.16 | 0.87 | 0.398 | 2.0 | 220 | < 1.0 | < 1.0 | 2,800 | 5.50 | 0.0029 | 345 |
| 32S/13E-30N02 | 8/20/2009 | 1,350 | 500 | 199 | 82.2 | 123 | 49.0 | 199 | 220 | 6.4 | 6.3 | NA | 0.23 | 0.14 | 0.339 | 2.8 | 199 | < 1.0 | < 1.0 | 2,100 | 4.91 | 0.0056 | 179 |
| 32S/13E-30N02 | 5/11/2009 | 1,290 | 170 | 129 | 52 | 137 | 66.9 | 176 | 470 | NA | NA | NA | 0.18 | NA | 0.128 | 0.56 | 176 | < 1.0 | < 1.0 | 1,800 | 5.24 | 0.0033 | 304 |
| 32S/13E-30N02 | 3/27/1996 | 1,050 | 50 | 71 | 5.5 | 145 | 60 | 243 | 516 | 0.9 | NA | 0.23 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30N02 | 6/7/1976 | 1,093 | 48 | 62 | 4.7 | 150 | 60 | 248 | 484 | 0 | NA | 0.13 | 0.7 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 32S/13E-30N02 | 1/21/1966 | 1,069 | 54 | 71 | 5 | 148 | 63 | 232 | 483 | 0 | NA | 0.12 | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|----------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 32S/13E-31H10 | 10/11/2017 | 640 | 33 | 41 | 3.1 | 120 | 57 | 360 | 160 | ND | 0.38 | 0.083 | 0.18 | ND | 0.21 | 0.13 | 450 | 89 | ND | 1070 | 4.3 | 0.0039 | 254 |
| 32S/13E-31H10 | 7/11/2017 | 720 | 36 | 48 | 3.8 | 120 | 60 | 350 | 170 | ND | 0.17 | 0.09 | 0.15 | 0.011 | 0.17 | 0.13 | 350 | ND | ND | 1,020 | 4.7 | 0.0036 | 277 |
| 32S/13E-31H10 | 4/12/2017 | 600 | 39 | 47 | 3.4 | 120 | 62 | 340 | 190 | ND | ND | 0.09 | 0.19 | 0.013 | 0.19 | 0.22 | 340 | ND | ND | 1,020 | 5.2 | 0.0056 | 177 |
| 32S/13E-31H10 | 1/13/2017 | 670 | 34 | 45 | 3.4 | 130 | 60 | 370 | 180 | ND | 0.16 | 0.076 | 0.17 | 0.014 | 0.22 | 0.1 | 370 | ND | ND | 1,020 | 7.8 | 0.0029 | 340 |
| 32S/13E-31H10 | 10/12/2016 | 700 | 33 | 40 | 3.2 | 120 | 59 | 380 | 170 | ND | 0.22 | 0.062 | 0.18 | 0.012 | 0.15 | 0.12 | 380 | ND | ND | 1040 | 5.3 | 0.0036 | 275 |
| 32S/13E-31H10 | 7/20/2016 | 630 | 33 | 42 | 4.4 | 99 | 57 | 370 | 150 | <0.096 | 0.3 | 0.068 | 0.14 | <0.01 | 0.19 | 0.14 | 370 | <8.2 | <8.2 | 991 | 8.9 | 0.0042 | 236 |
| 32S/13E-31H10 | 4/13/2016 | 670 | 37 | 46 | 3.4 | 120 | 57 | 350 | 180 | <0.096 | 0.21 | 0.078 | 0.19 | 0.011 | 0.23 | 0.14 | 350 | <8.2 | <8.2 | 1,030 | 6.7 | 0.0038 | 264 |
| 32S/13E-31H10 | 1/13/2016 | 380 | 37 | 49 | 9.9 | 6.8 | 46 | 170 | 54 | <0.022 | 0.43 | 0.044 | 0.088 | 0.014 | 0.084 | 0.19 | 210 | 34 | <4.1 | 603 | 2.2 | 0.0051 | 195 |
| 32S/13E-31H10 | 10/14/2015 | 320 | 32 | 33 | 2.7 | 17 | 48 | 216 | 68 | <0.05 | <1 | 0.089 | 0.12 | 0.016 | 0.098 | <0.10 | 227 | 11 | <10 | 600 | 1.4 | NA | NA |
| 32S/13E-31H10 | 7/15/2015 | 330 | 34 | 44 | 3.4 | 15 | 54 | 195 | 81 | <0.05 | <1 | 0.082 | <0.1 | <0.01 | 0.081 | <0.1 | 213 | 18 | <10 | 610 | 0.98 | NA | NA |
| 32S/13E-31H10 | 4/16/2015 | 660 | 35 | 33 | 2.7 | 99 | 48 | 360 | 170 | <0.05 | <1 | 0.083 | 0.163 | <0.01 | 0.17 | <0.1 | 360 | <10 | <10 | 1,000 | 4.6 | NA | NA |
| 32S/13E-31H10 | 1/14/2015 | 760 | 55 | 56 | 3.0 | 110 | 50 | 300 | 250 | <0.05 | <1 | 0.11 | 0.159 | 0.021 | 0.17 | <0.1 | 300 | <10 | <10 | 1,070 | 4.2 | NA | NA |
| 32S/13E-31H10 | 10/16/2014 | 720 | 41 | 46 | 3.7 | 110 | 53 | 330 | 200 | <0.05 | <1 | 0.10 | <0.1 | <0.01 | 0.17 | <0.1 | 330 | <10 | <10 | 1,090 | 6.5 | NA | NA |
| 32S/13E-31H10 | 7/30/2014 | 660 | 34 | 35 | 2.4 | 95 | 49 | 420 | 160 | <0.05 | <1 | <0.1 | 0.16 | <0.01 | 0.17 | <0.1 | 420 | <10 | <10 | 1,040 | 6.5 | NA | NA |
| 32S/13E-31H10 | 4/17/2014 | 890 | 55 | 70 | 5.4 | 100 | 45 | 250 | 380 | <0.05 | <1 | 0.15 | 0.12 | 0.01 | 0.31 | 0.13 | 250 | <10 | <10 | 1,260 | 4.9 | 0.0024 | 423 |
| 32S/13E-31H10 | 1/16/2014 | 900 | 57 | 66 | 4.60 | 110 | 50 | 240 | 360 | <0.05 | <1 | 0.180 | 0.2 | 0.02 | 0.32 | <0.1 | 240 | <10 | <10 | 1,260 | 6.0 | NA | NA |
| 32S/13E-31H10 | 10/16/2013 | 690 | 30 | 40 | 3.40 | 100 | 49 | 340 | 190 | <0.05 | <1 | 0.091 | 0.14 | <0.01 | 0.23 | <0.1 | 340 | <10 | <10 | 1,050 | 7.4 | NA | NA |
| 32S/13E-31H10 | 7/11/2013 | 860 | 60 | 50 | 4.40 | 110 | 47 | 240 | 340 | <0.05 | <1 | 0.18 | 0.15 | 0.02 | 0.28 | <0.1 | 240 | <10 | <10 | 1,230 | 4.9 | NA | NA |
| 32S/13E-31H10 | 4/11/2013 | 900 | 60 | 69 | 4.60 | 110 | 47 | 250 | 350 | 0.82 | <1 | 0.2 | 0.12 | 0.03 | 0.28 | <0.2 | 250 | <10 | <10 | 1,250 | 5.7 | NA | NA |
| 32S/13E-31H10 | 1/16/2013 | 820 | 66 | 76 | 5.00 | 100 | 47 | 260 | 320 | <0.1 | <1 | 0.21 | 0.13 | <0.01 | 0.31 | <0.2 | 260 | <10 | <10 | 1,230 | 4.2 | NA | NA |
| 32S/13E-31H10 | 10/30/2012 | 780 | 65 | 75 | 4.70 | 100 | 46 | 255 | 280 | <0.05 | <1 | 0.19 | 0.14 | 0.04 | 0.23 | <0.1 | 255 | <10 | <10 | 1,190 | 4 | NA | NA |
| 32S/13E-31H10 | 7/25/2012 | 830 | 76 | 80 | 5.30 | 96 | 45 | 250 | 310 | <0.05 | <1 | 0.22 | 0.15 | 0.04 | 0.24 | <0.1 | 250 | <10 | <10 | 1,220 | 6.7 | NA | NA |
| 32S/13E-31H10 | 4/19/2012 | 790 | 87 | 69 | 4.50 | 52 | 37 | 250 | 270 | <0.1 | <1 | 0.19 | 0.21 | 0.05 | 0.17 | <0.2 | 250 | <10 | <10 | 1,180 | 4 | NA | NA |
| 32S/13E-31H10 | 1/12/2012 | 760 | 76 | 85 | 4.00 | 79 | 40 | 270 | 190 | <0.1 | <1 | 0.23 | 0.21 | 0.069 | 0.23 | <0.2 | 270 | <10 | <10 | 1,150 | 4.8 | NA | NA |
| 32S/13E-31H10 | 11/21/2011 | 720 | 39 | 38 | 3.40 | 96 | 43 | 320 | 180 | <0.05 | 3.5 | 0.079 | 0.19 | 0.013 | 0.17 | <0.1 | 320 | <10 | <10 | 1,050 | 4.8 | NA | NA |
| 32S/13E-31H10 | 7/25/2011 | 760 | 69 | 66 | 6.40 | 80 | 35 | 310 | 208.8 | <0.05 | <1 | 0.16 | 0.17 | 0.041 | 0.23 | 0.199 | 310 | <5 | <5 | 1,170 | 5.3 | 0.0029 | 348 |
| 32S/13E-31H10 | 1/24/2011 | 310 | 98 | 22 | 8.1 | 34 | 9.2 | 19.0 | 53 | <0.05 | <1.0 | <0.1 | 0.2 | 4.42 | 0.4 | 0.63 | 19.0 | <2.0 | <2.0 | 480 | 10 | 0.0064 | 156 |
| 32S/13E-31H10 | 10/28/2010 | 290 | 81 | 26 | 9.3 | 64 | 11 | 160.0 | 68 | <0.1 | <1.0 | <0.1 | 0.2 | NA | 0.85 | 0.36 | 160.0 | <10 | <10 | 520 | 38 | 0.0044 | 225 |
| 32S/13E-31H10 | 7/26/2010 | 438 | 85 | 34.3 | 1.93 | 61.7 | 30.4 | 30.0 | 210 | < 0.10 | < 0.50 | 0.0435 | 0.58 | 0.22 | 1.46 | 0.32 | 30.0 | < 1.0 | < 1.0 | 690 | 36 | 0.0038 | 266 |
| 32S/13E-31H10 | 4/26/2010 | 560 | 83 | 47.7 | 5.7 | 86.1 | 48.3 | 62 | 310 | < 0.10 | 0.84 | < 0.02 | < 0.1 | 0.56 | 2.54 | 0.31 | 62.0 | < 1.0 | < 1.0 | 880 | 233 | 0.0037 | 268 |
| 32S/13E-31H10 | 1/27/2010 | 460 | 130 | 45.0 | 25.4 | 682 | 124 | 112 | 100 | 0.56 | NA | < 0.0200 | 0.21 | 0.25 | 32.4 | 0.49 | 112.0 | < 1.0 | < 1.0 | 760 | 4,360 | 0.0038 | 265 |
| 32S/13E-31H10 | 10/20/2009 | 362 | 92 | 39.6 | 2.92 | 19.2 | 45.1 | 76.8 | 110 | < 0.10 | < 0.50 | 0.0697 | < 0.10 | < 0.10 | 0.242 | 0.39 | 80.0 | 3.2 | < 1.0 | 590 | 11.4 | 0.0042 | 236 |
| 32S/13E-31H10 | 8/19/2009 | 420 | 160 | 48.4 | 3.37 | 49.9 | 20.4 | 17.6 | 54 | < 0.10 | 1.1 | NA | < 0.10 | 0.25 | 1.76 | 0.68 | 17.6 | < 1.0 | < 1.0 | 690 | 242 | 0.0043 | 235 |
| 32S/13E-31H10 | 5/16/1983 | 665 | 35 | 40 | NA | 85 | 65 | 360 | 90 | < 4 | NA | NA | 0.2 | NA | 0.01 | NA | 360 | ND | ND | 950 | 0.10 | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|----------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/13E-31H11 | 10/11/2017 | 720 | 38 | 45 | 3.7 | 120 | 56 | 350 | 200 | ND | 0.22 | 0.13 | 0.18 | 0.015 | 0.22 | 0.14 | 350 | ND | ND | 1080 | 5.6 | 0.0037 | 271 |
| 32S/13E-31H11 | 7/11/2017 | 820 | 43 | 53 | 3.9 | 130 | 58 | 320 | 230 | ND | 0.11 | 0.11 | 0.13 | 0.018 | 0.29 | 0.19 | 320 | ND | ND | 1,100 | 9.7 | 0.0044 | 226 |
| 32S/13E-31H11 | 4/12/2017 | 720 | 45 | 53 | 3.8 | 120 | 56 | 320 | 250 | ND | ND | 0.11 | 0.17 | 0.022 | 0.25 | 0.18 | 320 | ND | ND | 1,100 | 6.3 | 0.0040 | 250 |
| 32S/13E-31H11 | 1/13/2017 | 750 | 44 | 57 | 4 | 130 | 58 | 340 | 240 | ND | 0.11 | 0.11 | 0.13 | 0.024 | 0.29 | 0.15 | 340 | ND | ND | 1,100 | 7.20 | 0.0034 | 293 |
| 32S/13E-31H11 | 10/12/2016 | 780 | 41 | 49 | 3.9 | 120 | 57 | 350 | 220 | ND | 0.12 | 0.097 | 0.16 | 0.021 | 0.28 | 0.16 | 350 | ND | ND | 1100 | 8.10 | 0.0039 | 256 |
| 32S/13E-31H11 | 7/20/2016 | 420 | 120 | 64 | 6.8 | 4.3 | 38 | 60 | 39 | <0.096 | 0.097 | 0.12 | 0.059 | 0.084 | 0.084 | 0.59 | 89 | 29 | <4.1 | 617 | 9.0 | 0.0049 | 203 |
| 32S/13E-31H11 | 4/13/2016 | 410 | 110 | 64 | 604 | 3.9 | 40 | 51 | 56 | <0.096 | <0.080 | 0.11 | 0.058 | 0.084 | 0.053 | 0.58 | 92 | 41 | <4.1 | 628 | 6.7 | 0.0053 | 190 |
| 32S/13E-31H11 | 1/13/2016 | 450 | 120 | 70 | 7.7 | 4.5 | 36 | 49 | 65 | <0.022 | <0.080 | 0.11 | 0.095 | 0.11 | 0.072 | 0.76 | 86 | 37 | <4.1 | 675 | 8.6 | 0.0063 | 158 |
| 32S/13E-31H11 | 10/14/2015 | 350 | 110 | 69 | 9.2 | 3.7 | 31 | 42 | 74 | <0.05 | <1 | 0.16 | <0.10 | 0.099 | 0.036 | 0.44 | 75 | 33 | <10 | 670 | 5.7 | 0.0040 | 250 |
| 32S/13E-31H11 | 7/15/2015 | 380 | 120 | 85 | 11.0 | 4.3 | 35 | 40 | 85 | <0.05 | <1 | 0.19 | <0.1 | 0.1 | 0.05 | 0.409 | 65 | 25 | <10 | 690 | 9.6 | 0.0034 | 293 |
| 32S/13E-31H11 | 4/16/2015 | 400 | 120 | 66 | 7.6 | 4.9 | 36 | 54 | 100 | <0.05 | <1 | 0.17 | <0.1 | 0.088 | 0.039 | 0.481 | 76 | 22 | <10 | 700 | 6.6 | 0.0040 | 249 |
| 32S/13E-31H11 | 1/14/2015 | 420 | 125 | 68 | 7.0 | 6.4 | 37 | 45 | 126 | <0.05 | <1 | 0.15 | <0.1 | 0.097 | 0.038 | 0.39 | 65 | 20 | <10 | 720 | 3.5 | 0.0031 | 325 |
| 32S/13E-31H11 | 10/16/2014 | 370 | 120 | 78 | 13.0 | 4.2 | 29 | 53 | 77 | <0.05 | <1 | 0.17 | <0.1 | 0.11 | 0.040 | 0.35 | 88 | <10 | <10 | 740 | 4.5 | 0.0029 | 343 |
| 32S/13E-31H11 | 7/30/2014 | 450 | 120 | 71 | 4.4 | 9.6 | 43 | 53 | 130 | 0.13 | <1 | 0.15 | 0.12 | 0.1 | 0.078 | 0.29 | 73 | 20 | <10 | 800 | 8 | 0.0024 | 414 |
| 32S/13E-31H11 | 4/17/2014 | 370 | 120 | 89 | 14.0 | 2.4 | 17 | 76 | 39 | <0.05 | <1 | 0.16 | <0.1 | 0.12 | 0.03 | 0.43 | 121 | 45 | <10 | 720 | 3.7 | 0.0036 | 279 |
| 32S/13E-31H11 | 1/16/2014 | 350 | 122 | 89 | 15 | 2 | 18 | 68 | 42 | <0.05 | <1 | 0.17 | 0.1 | 0.09 | 0.026 | 0.48 | 125 | 57.5 | <10 | 710 | 2.3 | 0.0039 | 254 |
| 32S/13E-31H11 | 10/16/2013 | 360 | 100 | 98 | 20 | 3.1 | 15 | 66 | 36 | <0.05 | <1 | 0.19 | <0.1 | 0.11 | 0.057 | 0.38 | 139 | 73 | <10 | 710 | 4.1 | 0.0038 | 263 |
| 32S/13E-31H11 | 7/11/2013 | 370 | 140 | 70 | 6.3 | 4 | 23 | 82 | 40 | 0.4 | <1 | 0.2 | 0.11 | 0.11 | 0.043 | 0.44 | 117 | 35 | <10 | 730 | 3.2 | 0.0031 | 318 |
| 32S/13E-31H11 | 4/11/2013 | 340 | 90 | 81 | 14 | 2.9 | 18 | 78 | 30 | <0.05 | <1 | 0.19 | 0.12 | 0.07 | 0.046 | 0.3 | 155 | 77.5 | <10 | 650 | 3.2 | 0.0033 | 300 |
| 32S/13E-31H11 | 1/16/2013 | 360 | 107 | 99 | 7.1 | 3.3 | 24 | 110 | 36 | <0.05 | <1 | 0.25 | <0.1 | <0.01 | 0.048 | 0.4 | 165 | 55 | <10 | 720 | 3.7 | 0.0037 | 268 |
| 32S/13E-31H11 | 10/30/2012 | 380 | 97 | 100 | 6.4 | 4.5 | 24 | 130 | 38 | <0.05 | <1 | 0.28 | <0.1 | 0.1 | 0.09 | 0.2 | 168 | 38 | <10 | 720 | 6.1 | 0.0021 | 485 |
| 32S/13E-31H11 | 7/25/2012 | 240 | 49 | 56 | 11 | 5.4 | 22 | 99 | 43 | <0.05 | <1 | 0.16 | 0.19 | 0.023 | 0.11 | <0.1 | 132 | 33 | <10 | 470 | 6.6 | NA | NA |
| 32S/13E-31H11 | 4/19/2012 | 380 | 100 | 87 | 5.5 | 3.5 | 26 | 150 | 79 | <0.1 | <1 | 0.27 | 0.26 | 0.09 | 0.033 | 0.68 | 180 | 30 | <10 | 750 | 1.6 | 0.0068 | 147 |
| 32S/13E-31H11 | 1/12/2012 | 480 | 96 | 110 | 4.9 | 5.6 | 33 | 154 | 95 | <0.1 | <1 | 0.28 | <0.2 | 0.11 | 0.01 | 0.306 | 180 | 26 | <10 | 850 | 0.2 | 0.0032 | 314 |
| 32S/13E-31H11 | 11/21/2011 | 390 | 90 | 78 | 4.6 | 5.2 | 24 | 111 | 86 | <0.05 | <1 | 0.19 | 0.13 | 0.092 | 0.014 | 0.28 | 128 | 17 | <10 | 720 | 0.5 | 0.0031 | 321 |
| 32S/13E-31H11 | 7/25/2011 | 260 | 29 | 23 | 5.3 | 8.7 | 20 | 84 | 80 | <0.05 | <1 | <0.1 | 0.199 | 0.072 | 0.041 | <0.1 | 89 | <5 | <5 | 440 | 2.7 | NA | NA |
| 32S/13E-31H11 | 4/21/2011 | 580 | 118 | 70 | 19 | 49 | 17 | 8.8 | 274 | <0.05 | <1 | <0.1 | 0.29 | 0.109 | 0.091 | 0.4 | 11.3 | 2.5 | <2.0 | 950 | NA | 0.0034 | 295 |
| 32S/13E-31H11 | 1/24/2011 | 680 | 110 | 60 | 17 | 64 | 22 | 5.0 | 330 | <0.05 | <1.0 | <0.1 | 0.22 | 0.96 | 0.16 | 0.31 | 11.2 | 6.2 | <2.0 | 1,040 | 10.0 | 0.0028 | 355 |
| 32S/13E-31H11 | 10/21/2010 | 770 | 100 | 68 | 12 | 88 | 31 | 14.0 | 380 | <0.1 | <1.0 | <0.1 | 0.28 | NA | 0.054 | <0.3 | 14.0 | <10 | <10 | 1,163 | 2.2 | NA | NA |
| 32S/13E-31H11 | 7/26/2010 | 783 | 130 | 80.1 | 8.58 | 142 | 42.0 | 2.8 | 450 | < 0.10 | < 0.50 | < 0.0200 | 0.26 | 0.31 | 3.97 | 0.8 | 2.8 | < 1.0 | < 1.0 | 1,200 | 593 | 0.0059 | 169 |
| 32S/13E-31H11 | 4/26/2010 | 1,130 | 160 | 70.2 | 6.48 | 208 | 50.7 | 8.4 | 530 | < 0.10 | 0.56 | < 0.02 | 0.23 | 0.54 | 3.10 | 1.0 | 8.4 | < 1.0 | < 1.0 | 1,600 | 383 | 0.0061 | 165 |
| 32S/13E-31H11 | 1/27/2010 | 1,740 | 430 | 55.6 | 4.98 | 282 | 43.0 | < 1.0 | 680 | < 0.10 | < 0.50 | 0.0819 | 0.14 | 0.41 | 9.41 | 2.0 | < 1.0 | < 1.0 | < 1.0 | 2,300 | 170 | 0.0047 | 215 |
| 32S/13E-31H11 | 10/20/2009 | 2,250 | 1,000 | 19.5 | 2.40 | 487 | 22.5 | 5.0 | 410 | < 0.10 | 0.98 | 0.0532 | 0.13 | < 0.10 | 13.1 | 4.5 | 5.0 | < 1.0 | < 1.0 | 3,100 | 236 | 0.0045 | 222 |
| 32S/13E-31H11 | 8/19/2009 | 322 | 150 | 93.2 | 16.7 | 23.9 | 12.1 | 3.0 | 4.0 | < 0.10 | 1.3 | NA | 0.19 | 0.5 | 0.7 | 0.74 | 23.0 | 20.0 | < 1.0 | 640 | 153 | 0.0049 | 203 |
| 32S/13E-31H11 | 5/16/1983 | 840 | 80 | 90 | NA | 100 | 50 | 250 | 160.0 | < 4 | NA | ND | 0.2 | NA | 0.14 | NA | 250.0 | ND | ND | 1,200 | 0.10 | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/13E-31H12 | 4/21/2011 | 410 | 97 | 100 | 7.2 | 3.5 | 21 | 80 | 134 | <0.05 | <1 | 0.23 | 0.18 | 0.097 | 0.065 | 0.42 | 100 | 20 | <2.0 | 770 | NA | 0.0043 | 231 |
| 32S/13E-31H12 | 1/24/2011 | 440 | 92 | 90 | 9.2 | 3.4 | 27 | 90 | 140 | <0.05 | <1.0 | 0.25 | 0.11 | 0.94 | 0.041 | 0.35 | 110 | 20 | <2.0 | 810 | 2.2 | 0.0038 | 263 |
| 32S/13E-31H12 | 10/21/2010 | 460 | 90 | 110 | 15 | 6.8 | 32 | 94 | 140 | <0.1 | <1.0 | 0.2 | 0.1 | NA | 0.1 | 0.38 | 124 | 30 | <10 | 868 | 3.5 | 0.0042 | 237 |
| 32S/13E-31H12 | 7/26/2010 | 478 | 83 | 109 | 5.94 | 52.9 | 30.4 | 122.0 | 94 | <0.10 | <0.50 | 0.255 | <0.10 | 0.41 | 0.477 | 0.56 | 130.0 | 8.0 | <1.0 | 730 | 61.0 | 0.0067 | 148 |
| 32S/13E-31H12 | 4/26/2010 | 452 | 83 | 83 | 7.42 | 29.3 | 34.5 | 72.0 | 190 | <0.1 | 0.56 | 0.134 | <0.10 | 0.65 | 0.702 | 0.4 | 86.0 | 14.0 | <1.0 | 810 | 71.0 | 0.0048 | 208 |
| 32S/13E-31H12 | 1/27/2010 | 496 | 71 | 92.2 | 10.6 | 22.9 | 39.1 | 13.0 | 230 | <0.10 | <0.50 | 0.323 | <0.10 | 0.20 | 0.604 | 0.29 | 51.0 | 38.0 | <1.0 | 780 | 54.4 | 0.0041 | 245 |
| 32S/13E-31H12 | 10/20/2009 | 564 | 71 | 80.8 | 8.63 | 33.2 | 49.8 | 49.6 | 310 | <0.10 | <0.50 | 0.148 | <0.10 | <0.10 | 0.337 | 0.32 | 64.0 | 14.4 | <1.0 | 850 | 20.0 | 0.0045 | 222 |
| 32S/13E-31H12 | 8/19/2009 | 522 | 180 | 148 | 71.6 | 95.2 | 8.42 | 30.0 | 3.5 | <0.10 | 1.7 | NA | 0.24 | 0.52 | 2.36 | 0.76 | 170 | 140 | <1.0 | 1,000 | 278 | 0.0042 | 237 |
| 32S/13E-31H12 | 5/16/1983 | 630 | 40 | 40 | NA | 90 | 50 | 330 | 80 | <4 | NA | NA | 0.1 | NA | 0.02 | NA | 330 | ND | ND | 900 | 0.05 | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 32S/13E-31H09 | 10/11/2017 | 640 | 40 | 47 | 2.6 | 120 | 55 | 370 | 160 | 0.024 | 0.12 | 0.079 | 0.13 | 0.016 | 0.046 | 0.13 | 370 | ND | ND | 1020 | 0.34 | 0.0033 | 308 |
| 32S/13E-31H09 | 7/11/2017 | 750 | 40 | 48 | 2.8 | 120 | 56 | 360 | 170 | ND | ND | 0.075 | 0.11 | 0.015 | 0.057 | 0.15 | 360 | ND | ND | 1,050 | 0.42 | 0.0038 | 267 |
| 32S/13E-31H09 | 4/12/2017 | 620 | 42 | 52 | 3.1 | 130 | 60 | 360 | 170 | 0.037 | ND | 0.082 | 0.17 | 0.017 | 0.05 | 0.14 | 360 | ND | ND | 1,040 | 0.30 | 0.0033 | 300 |
| 32S/13E-31H09 | 1/11/2017 | 640 | 61 | 53 | 3 | 100 | 48 | 320 | 150 | ND | ND | 0.071 | 0.16 | 0.02 | 0.05 | 0.24 | 320 | ND | ND | 976 | 0.40 | 0.0039 | 254 |
| 32S/13E-31H09 | 10/12/2016 | 720 | 46 | 49 | 2.8 | 120 | 56 | 370 | 170 | 0.029 | 0.18 | 0.069 | 0.12 | 0.021 | 0.041 | 0.18 | 370 | ND | ND | 1070 | 0.36 | 0.0039 | 256 |
| 32S/13E-31H09 | 7/20/2016 | 680 | 45 | 50 | 2.9 | 120 | 56 | 370 | 160 | 0.18 | 0.14 | 0.075 | 0.15 | 0.013 | 0.049 | 0.16 | 370 | <8.2 | <8.2 | 1,060 | 0.33 | 0.0036 | 281 |
| 32S/13E-31H09 | 4/13/2016 | 670 | 43 | 48 | 2.9 | 110 | 57 | 350 | 160 | <0.096 | 0.2 | 0.062 | 0.14 | 0.012 | 0.056 | 0.18 | 350 | <8.2 | <8.2 | 1,040 | 0.46 | 0.0042 | 239 |
| 32S/13E-31H09 | 1/12/2016 | 630 | 48 | 48 | 2.8 | 110 | 54 | 350 | 180 | 0.051 | 0.14 | 0.042 | 0.24 | 0.017 | 0.047 | 0.36 | 350 | <8.2 | <8.2 | 1,100 | 0.46 | 0.0075 | 133 |
| 32S/13E-31H09 | 10/14/2015 | 680 | 43 | 44 | 3.1 | 100 | 50 | 360 | 160 | <0.05 | <1 | 0.089 | 0.28 | 0.02 | 0.033 | <0.10 | 360 | <10 | <10 | 1,060 | 0.18 | NA | NA |
| 32S/13E-31H09 | 7/15/2015 | 680 | 43 | 52 | 2.4 | 120 | 56 | 360 | 170 | <0.05 | <1 | 0.079 | 0.11 | 0.01 | 0.033 | <0.1 | 360 | <10 | <10 | 1,070 | 0.13 | NA | NA |
| 32S/13E-31H09 | 4/16/2015 | 680 | 49 | 41 | 2.4 | 100 | 47 | 350 | 170 | <0.05 | <1 | 0.068 | 0.114 | <0.01 | 0.039 | <0.1 | 350 | <10 | <10 | 1,030 | 0.47 | NA | NA |
| 32S/13E-31H09 | 10/16/2014 | 670 | 40 | 43 | 2.8 | 110 | 50 | 3500 | 150 | <0.05 | <1 | 0.055 | 0.103 | <0.01 | 0.03 | <0.1 | 350 | <10 | <10 | 1,060 | 0.064 | NA | NA |
| 32S/13E-31H09 | 7/30/2014 | 670 | 43 | 43 | 2.2 | 110 | 48 | 360 | 160 | <0.05 | <1 | <0.1 | 0.15 | <0.01 | 0.029 | <0.1 | 360 | <10 | <10 | 1,070 | 0.057 | NA | NA |
| 32S/13E-31H09 | 4/15/2014 | 680 | 42 | 43 | 3.3 | 87 | 43 | 340 | 170 | <0.05 | <1 | 0.09 | 0.11 | <0.01 | 0.023 | <0.1 | 340 | <10 | <10 | 1,070 | 0.05 | NA | NA |
| 32S/13E-31H09 | 1/16/2014 | 680 | 45 | 42 | 2.6 | 100 | 46 | 360 | 171 | <0.05 | <1 | <0.05 | 0.13 | <0.01 | 0.032 | <0.1 | 360 | <10 | <10 | 1,060 | 0.18 | NA | NA |
| 32S/13E-31H09 | 10/16/2013 | 670 | 40 | 44 | 2.6 | 100 | 47 | 350 | 180 | 0.47 | <1 | <0.05 | 0.15 | <0.01 | 0.03 | <0.1 | 350 | <10 | <10 | 1,053 | 0.11 | NA | NA |
| 32S/13E-31H09 | 7/10/2013 | 670 | 44 | 43 | 2.8 | 110 | 52 | 350 | 180 | <0.05 | <1 | 0.072 | 0.12 | <0.01 | 0.032 | <0.1 | 350 | <10 | <10 | 1,070 | 0.11 | NA | NA |
| 32S/13E-31H09 | 4/11/2013 | 720 | 43 | 40 | 2.7 | 98 | 46 | 350 | 170 | <0.05 | <1 | 0.072 | 0.14 | <0.01 | 0.029 | <0.1 | 350 | <10 | <10 | 1,070 | 0.12 | NA | NA |
| 32S/13E-31H09 | 1/16/2013 | 660 | 43 | 43 | 2.7 | 100 | 47 | 360 | 180 | <0.05 | <1 | 0.07 | 0.1 | <0.01 | 0.031 | <0.1 | 360 | <10 | <10 | 1,060 | 0.130 | NA | NA |
| 32S/13E-31H09 | 10/30/2012 | 660 | 40 | 44 | 2.9 | 110 | 49 | 345 | 170 | <0.05 | <1 | 0.071 | 0.14 | <0.01 | 0.03 | <0.1 | 345 | <10 | <10 | 1,070 | 0.086 | NA | NA |
| 32S/13E-31H09 | 7/24/2012 | 700 | 47 | 44 | 2.8 | 93 | 45 | 356 | 180 | <0.05 | <1 | <0.1 | 0.17 | <0.01 | 0.029 | <0.1 | 356 | <10 | <10 | 1,070 | 0.660 | NA | NA |
| 32S/13E-31H09 | 4/25/2012 | 680 | 48 | 44 | 2.7 | 95 | 43 | 350 | 200 | <0.1 | <1 | <0.1 | 0.26 | <0.01 | 0.032 | <0.2 | 350 | <10 | <10 | 1,070 | 0.200 | NA | NA |
| 32S/13E-31H09 | 1/10/2012 | 690 | 45 | 44 | 2.6 | 100 | 44 | 340 | 160 | <0.05 | <1 | <0.1 | 0.2 | <0.01 | 0.024 | <0.1 | 340 | <10 | <10 | 1,070 | 0.100 | NA | NA |
| 32S/13E-31H09 | 11/22/2011 | 690 | 41 | 39 | 2.7 | 100 | 46 | 350 | 160 | <0.1 | <1 | 0.046 | <0.2 | 0.013 | 0.03 | <0.2 | 350 | <10 | <10 | 1,010 | 0.0 | NA | NA |
| 32S/13E-31H09 | 7/25/2011 | 690 | 44 | 39 | 4.5 | 86 | 40 | 340 | 166.9 | <0.05 | <1 | <0.1 | 0.145 | <0.01 | 0.026 | <0.1 | 340 | <5 | <5 | 1,070 | <0.1 | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|------|--------------------------|--------------------------|
| 32S/13E-31H13 | 10/11/2017 | 390 | 77 | 70 | 3.7 | 4.9 | 38 | 190 | 15 | ND | 0.11 | 0.16 | 0.034 | 0.039 | 0.079 | 0.28 | 220 | 29 | ND | 648 | 1.1 | 0.0036 | 275 |
| 32S/13E-31H13 | 7/11/2017 | 390 | 76 | 80 | 3.9 | 7.8 | 45 | 190 | 30 | ND | ND | 0.15 | 0.033 | 0.036 | 0.13 | 0.28 | 210 | 19 | ND | 680 | 2.2 | 0.0037 | 271 |
| 32S/13E-31H13 | 4/12/2017 | 430 | 79 | 87 | 4.4 | 4 | 44 | 180 | 21 | ND | 0.13 | 0.17 | 0.024 | 0.043 | 0.77 | 0.28 | 220 | 40 | ND | 667 | 4.5 | 0.0035 | 282 |
| 32S/13E-31H13 | 1/13/2017 | 480 | 81 | 95 | 4.7 | 3.9 | 41 | 190 | 14 | ND | ND | 0.19 | 0.037 | 0.056 | 0.065 | 0.31 | 220 | 33 | ND | 652 | 3.3 | 0.0038 | 261 |
| 32S/13E-31H13 | 10/12/2016 | 410 | 80 | 87 | 4.3 | 4.2 | 43 | 190 | 22 | ND | ND | 0.18 | 0.04 | 0.055 | 0.072 | 0.29 | 220 | 33 | ND | 678 | 2.3 | 0.0036 | 276 |
| 32S/13E-31H13 | 7/20/2016 | 510 | 91 | 99 | 5.1 | 2.4 | 34 | 170 | 19 | <0.096 | <0.080 | 0.22 | 0.043 | 0.054 | 0.038 | 0.43 | 210 | 44 | <4.1 | 694 | 1.2 | 0.0047 | 212 |
| 32S/13E-31H13 | 4/13/2016 | 450 | 94 | 99 | 4.6 | 2.5 | 33 | 150 | 25 | <0.096 | <0.080 | 0.22 | 0.054 | 0.045 | 0.035 | 0.44 | 200 | 51 | <4.1 | 701 | 1.2 | 0.0047 | 214 |
| 32S/13E-31H13 | 1/13/2016 | 460 | 99 | 97 | 4.8 | 2.6 | 32 | 150 | 30 | <0.022 | <0.080 | 0.19 | 0.084 | <0.010 | 0.038 | 0.53 | 190 | 43 | <4.1 | 717 | 0.33 | 0.0054 | 187 |
| 32S/13E-31H13 | 10/14/2015 | 370 | 85 | 91 | 4.8 | 3.1 | 32 | 159 | 45 | <0.05 | <1 | 0.23 | <0.10 | 0.060 | 0.043 | 0.26 | 189 | 30 | <10 | 710 | 0.30 | 0.0031 | 327 |
| 32S/13E-31H13 | 7/15/2015 | 390 | 90 | 99 | 4.4 | 2.7 | 34 | 145 | 55 | <0.05 | <1 | 0.21 | <0.1 | 0.06 | 0.034 | 0.24 | 185 | 40 | <10 | 730 | 0.24 | 0.0027 | 375 |
| 32S/13E-31H13 | 4/16/2015 | 360 | 89 | 86 | 4.8 | 2.6 | 31 | 137 | 58 | <0.05 | <1 | 0.20 | <0.1 | 0.057 | 0.030 | 0.266 | 172 | 35 | <10 | 680 | 0.42 | 0.0030 | 335 |
| 32S/13E-31H13 | 1/14/2015 | 390 | 90 | 84 | 4.8 | 2 | 31 | 140 | 61 | <0.05 | <1 | 0.18 | <0.1 | 0.059 | 0.035 | 0.24 | 170 | 30 | <10 | 670 | 0.47 | 0.0026 | 383 |
| 32S/13E-31H13 | 10/16/2014 | 370 | 80 | 84 | 5.0 | 3.2 | 32 | 146 | 59 | <0.05 | <1 | 0.19 | <0.1 | 0.055 | 0.044 | 0.18 | 170 | 24 | <10 | 720 | 0.61 | 0.0023 | 444 |
| 32S/13E-31H13 | 7/30/2014 | 380 | 86 | 81 | 4.2 | 3.6 | 35 | 158 | 61 | <0.05 | <1 | 0.16 | <0.1 | 0.05 | 0.047 | 0.17 | 175 | 17 | <10 | 730 | 0.25 | 0.0020 | 506 |
| 32S/13E-31H13 | 4/17/2014 | 380 | 84 | 86 | 5.2 | 3 | 26 | 120 | 87 | <0.05 | <1 | 0.18 | <0.1 | 0.08 | 0.032 | 0.3 | 143 | 23 | <10 | 730 | 0.45 | 0.0036 | 280 |
| 32S/13E-31H13 | 1/16/2014 | 390 | 89 | 91 | 5.0 | 4.1 | 34 | 119 | 103 | <0.05 | <1 | 0.20 | <0.1 | 0.06 | 0.043 | 0.34 | 136 | 17 | <10 | 740 | 0.30 | 0.0038 | 262 |
| 32S/13E-31H13 | 10/16/2013 | 410 | 84 | 87 | 4.7 | 5.3 | 33 | 114 | 130 | <0.05 | <1 | 0.17 | <0.1 | 0.08 | 0.053 | 0.3 | 124 | 10 | <10 | 760 | 0.28 | 0.0036 | 280 |
| 32S/13E-31H13 | 7/11/2013 | 420 | 80 | 70 | 4.8 | 4.5 | 35 | 116 | 120 | <0.05 | <1 | 0.19 | <0.1 | 0.06 | 0.047 | 0.21 | 136 | 20 | <10 | 760 | 0.19 | 0.0026 | 381 |
| 32S/13E-31H13 | 4/11/2013 | 450 | 77 | 77 | 4.7 | 5.8 | 38 | 113 | 150 | <0.05 | <1 | 0.19 | <0.1 | 0.06 | 0.069 | 0.2 | 128 | 15 | <10 | 780 | 0.15 | 0.0026 | 385 |
| 32S/13E-31H13 | 1/15/2013 | 420 | 74 | 78 | 4.7 | 7.0 | 40 | 110 | 180 | <0.05 | <1 | 0.18 | <0.1 | <0.01 | 0.087 | <0.1 | 125 | 15 | <10 | 810 | 0.55 | NA | NA |
| 32S/13E-31H13 | 10/30/2012 | 380 | 88 | 99 | 5.7 | 3.3 | 30 | 160 | 63 | <0.05 | <1 | 0.25 | <0.1 | 0.08 | 0.035 | 0.3 | 168 | 7.5 | <10 | 740 | 0.33 | 0.0034 | 293 |
| 32S/13E-31H13 | 7/25/2012 | 390 | 108 | 107 | 5.5 | 2.7 | 29 | 13 | 66 | <0.05 | <1 | 0.28 | <0.1 | 0.079 | 0.0037 | 0.23 | 168 | 155 | <10 | 750 | 0.84 | 0.0021 | 470 |
| 32S/13E-31H13 | 4/19/2012 | 390 | 110 | 83 | 4.3 | 2.5 | 26 | 400 | 68 | <0.1 | <1 | 0.22 | 0.23 | 0.09 | 0.032 | 0.39 | 420 | 20 | <10 | 790 | 0.24 | 0.0035 | 282 |
| 32S/13E-31H13 | 1/12/2012 | 410 | 94 | 95 | 4.5 | 3.0 | 28 | 300 | 68 | <0.1 | <1 | 0.24 | <0.2 | 0.1 | 0.032 | 0.31 | 320 | 20 | <10 | 760 | 0.89 | 0.0033 | 303 |
| 32S/13E-31H13 | 11/21/2011 | 410 | 94 | 83 | 4.6 | 3.4 | 30 | 152 | 72 | <0.05 | <1 | 0.21 | <0.1 | 0.09 | 0.035 | 0.3 | 160 | 8 | <10 | 730 | 0.65 | 0.0032 | 313 |
| 32S/13E-31H13 | 7/25/2011 | 420 | 90 | 84 | 7.1 | 4.4 | 31 | 148 | 91.8 | <0.05 | <1 | 0.20 | <0.1 | 0.071 | 0.046 | 0.297 | 150 | 2.5 | <5 | 760 | 1.90 | 0.0033 | 302 |
| 32S/13E-31H13 | 4/21/2011 | 380 | 88 | 110 | 6.3 | 4.0 | 27 | 140 | 101 | <0.05 | <1 | 0.41 | 0.14 | 0.07 | 0.13 | 0.33 | 140 | <2.0 | <2.0 | 750 | N/A | 0.0038 | 267 |
| 32S/13E-31H13 | 1/24/2011 | 430 | 83 | 73 | 6 | 6.3 | 31 | 160 | 100 | <0.05 | <1.0 | 0.22 | 0.11 | 0.66 | 0.078 | 0.28 | 160 | <2.0 | <2.0 | 780 | 0.49 | 0.0034 | 296 |
| 32S/13E-31H13 | 10/21/2010 | 410 | 87 | 100 | 3.9 | 6.0 | 33 | 148 | 100 | <0.1 | <1.0 | 0.14 | <0.1 | NA | 0.087 | <0.3 | 148 | <10 | <10 | 796 | 0.66 | NA | NA |
| 32S/13E-31H13 | 7/26/2010 | 446 | 94 | 93.0 | 8.81 | 10.2 | 32.0 | 38.4 | 120 | <0.10 | <0.50 | 0.142 | <0.10 | 0.32 | 0.196 | 0.48 | 56.0 | 17.6 | <1.0 | 700 | 22.4 | 0.0051 | 196 |
| 32S/13E-31H13 | 4/26/2010 | 416 | 96 | 87.6 | 9.86 | 14.8 | 37.1 | 46.0 | 150 | <0.1 | 0.63 | 0.132 | <0.10 | 0.39 | 0.579 | 0.44 | 58.0 | 12.0 | <1.0 | 780 | 56.2 | 0.0046 | 218 |
| 32S/13E-31H13 | 1/27/2010 | 498 | 89 | 79.6 | 10.2 | 15.6 | 38.0 | 31.0 | 180 | <0.10 | 0.56 | 0.132 | <0.10 | 0.19 | 0.283 | 0.38 | 51.0 | 20.0 | <1.0 | 810 | 23.6 | 0.0043 | 234 |
| 32S/13E-31H13 | 10/20/2009 | 446 | 100 | 97.1 | 12.8 | 16.4 | 37.9 | 26.6 | 180 | <0.10 | 0.56 | 0.168 | 0.2 | <0.10 | 0.180 | 0.42 | 42.6 | 16.0 | <1.0 | 760 | 18.9 | 0.0042 | 238 |
| 32S/13E-31H13 | 8/19/2009 | 426 | 160 | 101 | 18.9 | 93.2 | 29.1 | 64.4 | 36 | <0.10 | 0.98 | NA | 0.2 | 0.31 | 5.490 | 0.60 | 84.4 | 20.0 | <1.0 | 790 | 682 | 0.0038 | 267 |
| 32S/13E-31H13 | 5/16/1983 | 770 | 60 | 70 | NA | 90 | 70 | 330 | 120 | 9 | NA | NA | 0.1 | NA | 0.02 | NA | 330 | ND | ND | 1,100 | 0.24 | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-------|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|---------|--------------------------|--------------------------|
| 12N/36W-36L01 | 10/11/2017 | 880 | 35 | 65 | 3.7 | 140 | 50 | 190 | 430 | 0.43 | 0.14 | 0.19 | 0.048 | ND | 0.054 | ND | 190 | ND | ND | 1210 | 0.23 | NA | NA |
| 12N/36W-36L01 | 7/12/2017 | 1,000 | 37 | 73 | 3.9 | 150 | 55 | 180 | 420 | 0.36 | 0.15 | 0.17 | 0.034 | ND | 0.0048 | ND | 180 | ND | ND | 1,180 | 0.23 | NA | NA |
| 12N/36W-36L01 | 4/12/2017 | 860 | 37 | 73 | 4 | 130 | 49 | 180 | 420 | 0.45 | 0.14 | 0.17 | 0.017 | ND | 0.0087 | 0.06 | 180 | ND | ND | 1,170 | 0.43 | 0.0017 | 597 |
| 12N/36W-36L01 | 1/12/2017 | 870 | 38 | 76 | 3.8 | 150 | 55 | 190 | 430 | 0.46 | 0.12 | 0.21 | 0.036 | ND | ND | 0.07 | 190 | ND | ND | 1,180 | 0.11 | 0.0018 | 543 |
| 12N/36W-36L01 | 10/12/2016 | 890 | 35 | 72 | 3.8 | 140 | 56 | 190 | 430 | 0.42 | 0.11 | 0.17 | 0.036 | ND | ND | 0.12 | 190 | ND | ND | 1220 | 0.037 | 0.0034 | 292 |
| 12N/36W-36L01 | 7/19/2016 | 920 | 37 | 69 | 3.6 | 130 | 50 | 180 | 430 | 1.9 | 0.25 | 0.15 | 0.043 | <0.010 | <0.0040 | 0.10 | 180 | <8.2 | <8.2 | 1,200 | <0.030 | 0.0027 | 370 |
| 12N/36W-36L01 | 4/12/2016 | 860 | 38 | 65 | 3.5 | 130 | 49 | 180 | 390 | 2.0 | <0.080 | 0.16 | 0.036 | <0.010 | <0.0040 | 0.12 | 180 | <8.2 | <8.2 | 1,210 | <0.05 | 0.0032 | 317 |
| 12N/36W-36L01 | 1/14/2016 | 890 | 36 | 64 | 3.4 | 130 | 49 | 180 | 410 | 0.47 | <0.080 | 0.15 | 0.062 | <0.010 | <0.0040 | 0.10 | 180 | <8.2 | <8.2 | 1,210 | 0.070 | 0.0028 | 360 |
| 12N/36W-36L01 | 10/15/2015 | 920 | 37 | 63 | 4.2 | 120 | 47 | 180 | 400 | 0.68 | <1 | 0.15 | <0.20 | <0.01 | <0.005 | <0.20 | 180 | <10 | <10 | 1,210 | <0.05 | NA | NA |
| 12N/36W-36L01 | 7/16/2015 | 930 | 39 | 74 | 2.8 | 140 | 50 | 180 | 410 | 1.2 | <1 | 0.15 | <0.1 | <0.01 | <0.005 | <0.1 | 180 | <10 | <10 | 1,210 | <0.05 | NA | NA |
| 12N/36W-36L01 | 4/14/2015 | 890 | 38 | 55 | 3.1 | 110 | 44 | 180 | 440 | 0.759 | 1.0 | 0.16 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,160 | <0.05 | NA | NA |
| 12N/36W-36L01 | 1/13/2015 | 880 | 39 | 59 | 3.0 | 120 | 45 | 180 | 440 | 0.584 | <1 | 0.14 | <0.1 | <0.01 | <0.005 | <0.1 | 180 | <10 | <10 | 1,160 | <0.05 | NA | NA |
| 12N/36W-36L01 | 10/15/2014 | 910 | 34 | 58 | 3.7 | 120 | 43 | 180 | 380 | 0.950 | <1 | 0.14 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,210 | <0.05 | NA | NA |
| 12N/36W-36L01 | 7/30/2014 | 890 | 36 | 61 | 3.2 | 120 | 47 | 180 | 390 | 0.603 | <1 | 0.12 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,220 | <0.05 | NA | NA |
| 12N/36W-36L01 | 4/16/2014 | 910 | 36 | 46 | 2.6 | 76 | 27 | 180 | 440 | 0.77 | <1 | 0.15 | <0.1 | <0.01 | <0.005 | <0.1 | 180 | <10 | <10 | 1,200 | <0.05 | NA | NA |
| 12N/36W-36L01 | 1/16/2014 | 910 | 35 | 60 | 3.1 | 110 | 42 | 180 | 416 | 1.00 | 1.1 | 0.14 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,190 | <0.05 | NA | NA |
| 12N/36W-36L01 | 10/16/2013 | 910 | 40 | 63 | 4.5 | 120 | 43 | 170 | 460 | 0.76 | <1 | 0.13 | <0.2 | <0.01 | <0.005 | <0.2 | 170 | <10 | <10 | 1,210 | <0.05 | NA | NA |
| 12N/36W-36L01 | 7/10/2013 | 910 | 39 | 54 | 3.2 | 120 | 42 | 175 | 430 | 0.78 | <1 | 0.14 | <0.1 | <0.01 | <0.005 | <0.1 | 175 | <10 | <10 | 1,210 | 0.18 | NA | NA |
| 12N/36W-36L01 | 4/11/2013 | 890 | 38 | 59 | 3.6 | 110 | 43 | 180 | 420 | 0.82 | <1 | 0.16 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,200 | <0.05 | NA | NA |
| 12N/36W-36L01 | 1/15/2013 | 870 | 39 | 61 | 3.4 | 110 | 41 | 178 | 440 | 0.57 | <1 | 0.15 | <0.2 | <0.01 | <0.005 | <0.2 | 178 | <10 | <10 | 1,190 | 0.13 | NA | NA |
| 12N/36W-36L01 | 10/31/2012 | 910 | 35 | 66 | 4.0 | 130 | 46 | 165 | 400 | 1.60 | <1 | 0.16 | 0.2 | <0.01 | <0.005 | <0.5 | 165 | <10 | <10 | 1,200 | <0.05 | NA | NA |
| 12N/36W-36L01 | 7/24/2012 | 880 | 43 | 65 | 3.9 | 110 | 41 | 168 | 420 | <0.05 | <1 | 0.16 | <0.1 | <0.01 | 0.02 | <0.1 | 168 | <10 | <10 | 1,190 | 0.19 | NA | NA |
| 12N/36W-36L01 | 4/18/2012 | 880 | 47 | 52 | 3.2 | 95 | 36 | 180 | 450 | 0.42 | <1 | 0.12 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,190 | <0.1 | NA | NA |
| 12N/36W-36L01 | 1/11/2012 | 790 | 41 | 64 | 4.1 | 120 | 44 | 170 | 380 | 1.30 | <1 | 0.19 | 0.18 | <0.02 | <0.005 | <0.2 | 170 | <10 | <10 | 1,190 | <0.1 | NA | NA |
| 12N/36W-36L01 | 11/21/2011 | 910 | 39 | 55 | 3.5 | 110 | 40 | 180 | 380 | 0.37 | <1 | 0.16 | <0.2 | <0.01 | <0.005 | <0.2 | 180 | <10 | <10 | 1,200 | <0.1 | NA | NA |
| 12N/36W-36L01 | 7/25/2011 | 890 | 41 | 65 | 5.7 | 110 | 43 | 170 | 408.9 | 0.39 | <1 | 0.15 | <0.1 | <0.01 | <0.005 | <0.1 | 170 | <5 | <5 | 1,200 | 0.024 | NA | NA |
| 12N/36W-36L01 | 4/21/2011 | 890 | 42 | 61 | 4.2 | 100 | 30 | 170 | 415 | 0.60 | <1 | 0.19 | 0.07 | <0.01 | <0.005 | <0.1 | 170 | <2.0 | <2.0 | 1,200 | NA | NA | NA |
| 12N/36W-36L01 | 1/24/2011 | 890 | 41 | 55 | 5.1 | 98 | 36 | 180 | 400 | 0.50 | <1.0 | 0.20 | 0.15 | <0.10 | <0.005 | <0.1 | 180 | <2.0 | <2.0 | 1,200 | <0.1 | NA | NA |
| 12N/36W-36L01 | 10/21/2010 | 910 | 38 | 76 | 3.6 | 130 | 47 | 169 | 400 | 0.39 | <1.0 | 0.10 | <0.1 | NA | <0.005 | <0.3 | 169 | <10 | <10 | 1,213 | <0.1 | NA | NA |
| 12N/36W-36L01 | 7/27/2010 | 707 | 36 | 64.2 | 3.70 | 127 | 47.4 | 182 | 420 | 0.40 | < 0.50 | 0.158 | < 0.10 | < 0.10 | < 0.00500 | 0.11 | 182 | < 1.0 | < 1.0 | 1,100 | < 0.100 | 0.0031 | 327 |
| 12N/36W-36L01 | 4/26/2010 | 860 | 42 | 70.3 | 4.13 | 129 | 48.9 | 191 | 400 | 0.45 | 0.77 | 0.223 | < 0.1 | 0.15 | 0.057 | 0.14 | 191 | < 1.0 | < 1.0 | 1,100 | 4.53 | 0.0033 | 300 |
| 12N/36W-36L01 | 10/21/2009 | 856 | 38 | 72.0 | 4.64 | 131 | 48.2 | 192 | 420 | 0.49 | 0.84 | 0.150 | 0.12 | < 0.10 | 0.0994 | 0.13 | 192 | < 1.0 | < 1.0 | 1,100 | 1.68 | 0.0034 | 292 |
| 12N/36W-36L01 | 8/20/2009 | 890 | 39 | 78.0 | 4.21 | 138 | 48.1 | 184 | 390 | 0.49 | 0.56 | NA | < 0.10 | < 0.10 | 0.185 | 0.14 | 184 | < 1.0 | < 1.0 | 1,200 | 2.03 | 0.0036 | 279 |
| 12N/36W-36L01 | 5/11/2009 | 832 | 63 | 83.8 | 4.88 | 111 | 45.4 | 204 | 330 | NA | NA | NA | 0.12 | NA | 0.551 | 0.22 | 204 | < 1.0 | < 1.0 | 1,200 | 4.02 | 0.0035 | 286 |
| 12N/36W-36L01 | 3/26/1996 | 882 | 35 | 66 | 4.8 | 124 | 47 | 233 | 408 | 2 | NA | 0.24 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 12N/36W-36L01 | 6/8/1976 | 936 | 38 | 72 | 3.5 | 130 | 48 | 223 | 423 | 0.6 | NA | 0.15 | 0.7 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 12N/36W-36L02 | 10/11/2017 | 830 | 100 | 100 | 5.9 | 97 | 44 | 280 | 230 | ND | 1.8 | 0.36 | 0.087 | 0.13 | 0.16 | 0.66 | 280 | ND | ND | 1220 | 0.41 | 0.0066 | 152 |
| 12N/36W-36L02 | 7/12/2017 | 940 | 97 | 100 | 6.1 | 98 | 45 | 250 | 230 | ND | 2.2 | 0.32 | 0.096 | 0.13 | 0.16 | 0.59 | 250 | ND | ND | 1,200 | 0.75 | 0.0061 | 164 |
| 12N/36W-36L02 | 4/12/2017 | 780 | 97 | 120 | 6.7 | 98 | 43 | 250 | 240 | ND | 2.2 | 0.35 | 0.082 | 0.14 | 0.16 | 0.51 | 250 | ND | ND | 1,190 | 0.77 | 0.0053 | 190 |
| 12N/36W-36L02 | 1/12/2017 | 810 | 94 | 120 | 6.6 | 110 | 48 | 270 | 240 | ND | 2 | 0.36 | 0.08 | 0.19 | 0.19 | 0.53 | 270 | ND | ND | 1,200 | 1.1 | 0.0056 | 177 |
| 12N/36W-36L02 | 10/12/2016 | 820 | 99 | 120 | 6.6 | 110 | 50 | 270 | 240 | ND | 2 | 0.35 | 0.084 | 0.14 | 0.17 | 0.58 | 270 | ND | ND | 1230 | 0.1 | 0.0059 | 171 |
| 12N/36W-36L02 | 7/19/2016 | 820 | 97 | 110 | 6.2 | 95 | 45 | 270 | 240 | <0.096 | 2 | 0.33 | 0.081 | 0.1 | 0.15 | 0.65 | 270 | <8.2 | <0.82 | 1,220 | 0.14 | 0.0067 | 149 |
| 12N/36W-36L02 | 4/12/2016 | 800 | 96 | 100 | 6 | 94 | 44 | 270 | 230 | <0.096 | 1.8 | 0.32 | 0.12 | 0.12 | 0.14 | 0.81 | 270 | <8.2 | <0.82 | 1,240 | 0.37 | 0.0084 | 119 |
| 12N/36W-36L02 | 1/14/2016 | 860 | 96 | 110 | 6.4 | 99 | 47 | 260 | 230 | <0.018 | 1.6 | 0.34 | 0.10 | 0.078 | 0.17 | 0.65 | 260 | <8.2 | <8.2 | 1,240 | 1.9 | 0.0068 | 148 |
| 12N/36W-36L02 | 10/15/2015 | 800 | 89 | 96 | 6.0 | 91 | 0.15 | 266 | 230 | <0.05 | 2.2 | 0.32 | 0.22 | 0.098 | 0.15 | 0.37 | 266 | <10 | <10 | 1,220 | 0.32 | 0.0042 | 241 |
| 12N/36W-36L02 | 7/16/2015 | 840 | 97 | 120 | 5.9 | 110 | 46 | 260 | 240 | <0.05 | 2.44 | 0.34 | 0.11 | 0.11 | 0.15 | 0.59 | 260 | <10 | <10 | 1,230 | 0.16 | 0.0061 | 164 |
| 12N/36W-36L02 | 4/14/2015 | 800 | 98 | 88 | 5.3 | 83 | 39 | 270 | 240 | <0.05 | 2.9 | 0.33 | 0.104 | 0.089 | 0.13 | 0.380 | 270 | <10 | <10 | 1,180 | 0.40 | 0.0039 | 258 |
| 12N/36W-36L02 | 1/13/2015 | 820 | 100 | 91 | 5.5 | 86 | 39 | 250 | 250 | <0.05 | 2.2 | 0.31 | 0.105 | 0.09 | 0.13 | 0.322 | 250 | <10 | <10 | 1,190 | 0.077 | 0.0032 | 311 |
| 12N/36W-36L02 | 10/15/2014 | 800 | 88 | 96 | 6.4 | 91 | 40 | 260 | 210 | <0.05 | 2.1 | 0.32 | <0.1 | 0.092 | 0.14 | 0.358 | 260 | <10 | <10 | 1,230 | 0.12 | 0.0041 | 246 |
| 12N/36W-36L02 | 7/30/2014 | 800 | 98 | 99 | 5.8 | 88 | 39 | 280 | 210 | <0.05 | 2.4 | 0.28 | 0.11 | 0.09 | 0.14 | 0.19 | 280 | <10 | <10 | 1,240 | 0.27 | 0.0019 | 516 |
| 12N/36W-36L02 | 4/16/2014 | 820 | 95 | 89 | 6.3 | 73 | 31 | 280 | 210 | <0.05 | 2.3 | 0.31 | <0.1 | 0.09 | 0.13 | 0.35 | 280 | <10 | <10 | 1,240 | 0.22 | 0.0037 | 271 |
| 12N/36W-36L02 | 1/16/2014 | 800 | 100 | 87 | 5 | 76 | 33 | 270 | 230 | <0.05 | 2.3 | 0.31 | 0.23 | 0.09 | 0.14 | 0.44 | 270 | <10 | <10 | 1,230 | 0.41 | 0.0044 | 227 |
| 12N/36W-36L02 | 10/16/2013 | 810 | 90 | 110 | 6.4 | 91 | 40 | 260 | 240 | <0.05 | 2.2 | 0.32 | <0.1 | 0.1 | 0.15 | 0.32 | 260 | <10 | <10 | 1,220 | 0.54 | 0.0036 | 281 |
| 12N/36W-36L02 | 7/10/2013 | 790 | 105 | 94 | 5.8 | 88 | 38 | 260 | 240 | <0.05 | 2.5 | 0.34 | <0.1 | 0.08 | 0.13 | 0.11 | 260 | <10 | <10 | 1,240 | 0.31 | 0.0010 | 955 |
| 12N/36W-36L02 | 4/11/2013 | 830 | 100 | 99 | 6.2 | 83 | 37 | 260 | 220 | <0.05 | 2.2 | 0.35 | <0.1 | 0.098 | 0.14 | 0.45 | 260 | <10 | <10 | 1,240 | 0.60 | 0.0045 | 222 |
| 12N/36W-36L02 | 1/15/2013 | 770 | 110 | 110 | 6.7 | 84 | 38 | 265 | 220 | <0.05 | 2.8 | 0.36 | <0.1 | 0.02 | 0.14 | 0.20 | 265 | <10 | <10 | 1,240 | 0.61 | 0.0018 | 550 |
| 12N/36W-36L02 | 10/31/2012 | 800 | 100 | 120 | 7.3 | 90 | 39 | 265 | 200 | <0.1 | 2.4 | 0.4 | 0.34 | 0.12 | 0.14 | 0.34 | 265 | <10 | <10 | 1,250 | 0.30 | 0.0034 | 294 |
| 12N/36W-36L02 | 7/24/2012 | 800 | 134 | 125 | 7.4 | 83 | 35 | 277 | 200 | <0.05 | 2.3 | 0.42 | 0.13 | 0.12 | 0.14 | 0.31 | 277 | <10 | <10 | 1,250 | 0.52 | 0.0023 | 432 |
| 12N/36W-36L02 | 4/18/2012 | 770 | 130 | 95 | 6.2 | 75 | 33 | 270 | 210 | 0.42 | 4 | 0.35 | 0.36 | 0.12 | 0.13 | <0.2 | 270 | <10 | <10 | 1,250 | 0.77 | NA | NA |
| 12N/36W-36L02 | 1/11/2012 | 900 | 122 | 110 | 7.2 | 95 | 37 | 290 | 170 | <0.1 | 4.8 | 0.48 | 0.28 | <0.02 | 0.17 | 0.45 | 290 | <10 | <10 | 1,250 | 1.80 | 0.0037 | 271 |
| 12N/36W-36L02 | 11/21/2011 | 780 | 130 | 95 | 6.1 | 77 | 33 | 270 | 160 | <0.1 | <1 | 0.4 | <0.2 | <0.01 | 0.13 | 0.45 | 270 | <10 | <10 | 1,240 | 0.40 | 0.0035 | 289 |
| 12N/36W-36L02 | 7/25/2011 | 790 | 129 | 110 | 9.1 | 74 | 33 | 280 | 177 | <0.05 | 2.3 | 0.36 | 0.12 | 0.14 | 0.13 | 0.51 | 280 | <5 | <5 | 1,280 | 2.30 | 0.0040 | 252 |
| 12N/36W-36L02 | 4/21/2011 | 770 | 120 | 90 | 5.3 | 86 | 26 | 280 | 206 | <0.05 | 2.3 | 0.24 | 0.26 | 0.14 | 0.004 | 0.57 | 280 | <2.0 | <2.0 | 1,270 | NA | 0.0048 | 211 |
| 12N/36W-36L02 | 1/24/2011 | 800 | 120 | 95 | 7.6 | 75 | 30 | 300 | 190 | <0.05 | 2.3 | 0.39 | 0.16 | 1.31 | 0.13 | 0.53 | 300 | <2.0 | <2.0 | 1,270 | 1.40 | 0.0044 | 226 |
| 12N/36W-36L02 | 10/21/2010 | 770 | 120 | 130 | 7.6 | 89 | 44 | 275 | 160 | <0.1 | 3.4 | 0.48 | <0.1 | NA | 0.15 | 0.54 | 275 | <10 | <10 | 1,293 | 0.12 | 0.0045 | 222 |
| 12N/36W-36L02 | 7/27/2010 | 737 | 110 | 121 | 7.81 | 91.1 | 38.9 | 268 | 190 | <0.10 | <0.50 | 0.427 | 0.10 | 0.77 | 0.180 | 0.80 | 268 | <1.0 | <1.0 | 1,200 | 0.845 | 0.0073 | 138 |
| 12N/36W-36L02 | 4/26/2010 | 720 | 100 | 116 | 6.88 | 85.4 | 32.4 | 215 | 210 | 1.5 | 0.77 | 0.382 | 0.2 | 0.28 | 0.167 | 0.7 | 215 | <1.0 | <1.0 | 1,100 | 3.870 | 0.0070 | 143 |
| 12N/36W-36L02 | 10/21/2009 | 638 | 99 | 113 | 6.15 | 81.6 | 23.0 | 172 | 200 | <0.10 | 3.2 | 0.268 | 0.33 | 57 | 0.128 | 0.61 | 172 | <1.0 | <1.0 | 940 | 0.255 | 0.0062 | 162 |
| 12N/36W-36L02 | 8/20/2009 | 785 | 100 | 131 | 6.66 | 89.8 | 36.6 | 290 | 190 | <0.10 | 3.8 | NA | 0.15 | 0.27 | 0.307 | 0.75 | 290 | <1.0 | <1.0 | 1,200 | 0.830 | 0.0075 | 133 |
| 12N/36W-36L02 | 5/11/2009 | 775 | 120 | 132 | 7.24 | 84 | 39.7 | 294 | 180 | NA | NA | NA | 0.18 | NA | 0.426 | 0.78 | 294 | <1.0 | <1.0 | 1,300 | 0.958 | 0.0065 | 154 |
| 12N/36W-36L02 | 3/26/1996 | 772 | 127 | 130 | 8.7 | 86 | 36 | 390 | 148 | 0.2 | NA | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |
| 12N/36W-36L02 | 6/8/1976 | 820 | 126 | 118 | 6.6 | 94 | 44 | 393 | 184 | 0 | NA | NA | 0.5 | NA | NA | NA | NA | NA | NA | NA | NA | NA | NA |

Appendix A: NCMA Sentry Wells Water Quality Data



| Well | Date | TDS | Chloride | Sodium | Potassium | Calcium | Magnesium | Bicarbonate as CaCO3 | Sulfate | Nitrate (as N) | Total Kjeldahl Nitrogen | Boron | Fluoride | Iodide | Manganese | Bromide | Total Alkalinity as CaCO3 | Carbonate as CaCO3 | Hydroxide as CaCO3 | Specific Conductivity | Iron | Bromide / Chloride Ratio | Chloride / Bromide Ratio |
|---------------|------------|-----|----------|--------|-----------|---------|-----------|----------------------|---------|----------------|-------------------------|-------|----------|--------|-----------|---------|---------------------------|--------------------|--------------------|-----------------------|-------|--------------------------|--------------------------|
| 12N/35W-32C03 | 10/11/2017 | 320 | 64 | 63 | 2.8 | 14 | 6.5 | 53 | 28 | 8.4 | 0.11 | 0.11 | 0.04 | ND | 0.01 | 0.17 | 53 | ND | ND | 445 | 0.6 | 0.0027 | 376 |
| 12N/35W-32C03 | 7/11/2017 | 370 | 63 | 71 | 2.9 | 16 | 7 | 55 | 28 | 7.9 | ND | 0.094 | 0.035 | ND | 0.0062 | 0.21 | 55 | ND | ND | 450 | 0.3 | 0.0033 | 300 |
| 12N/35W-32C03 | 4/11/2017 | 300 | 65 | 66 | 2.8 | 14 | 6.6 | 52 | 28 | 8 | ND | 0.082 | 0.038 | ND | ND | 0.19 | 52 | ND | ND | 442 | 0.077 | 0.0029 | 342 |
| 12N/35W-32C03 | 1/13/2017 | 300 | 67 | 72 | 3 | 16 | 7.1 | 53 | 29 | 8.2 | ND | 0.093 | 0.033 | ND | ND | 0.21 | 53 | ND | ND | 449 | 0.072 | 0.0031 | 319 |
| 12N/35W-32C03 | 10/13/2016 | 310 | 64 | 68 | 2.9 | 14 | 6.5 | 53 | 25 | 8.1 | 0.12 | 0.088 | 0.08 | ND | ND | 0.18 | 53 | ND | ND | 433 | ND | 0.0028 | 356 |
| 12N/35W-32C03 | 7/20/2016 | 300 | 66 | 65 | 2.8 | 13 | 6.4 | 57 | 26 | 35 | <0.08 | 0.087 | 0.03 | <0.010 | <0.0040 | 0.16 | 57 | <4.1 | <4.1 | 450 | 0.039 | 0.0024 | 413 |
| 12N/35W-32C03 | 4/13/2016 | 290 | 65 | 66 | 2.8 | 14 | 6.5 | 51 | 26 | 36 | 0.086 | 0.083 | 0.039 | <0.010 | <0.0040 | 0.22 | 51 | <4.1 | <4.1 | 438 | 0.08 | 0.0034 | 295 |
| 12N/35W-32C03 | 1/14/2016 | 290 | 69 | 68 | 2.9 | 14 | 6.3 | 50 | 27 | 8.6 | <0.08 | 0.094 | 0.083 | <0.010 | <0.0040 | 0.16 | 50 | <4.1 | <4.1 | 430 | 0.079 | 0.0023 | 431 |
| 12N/35W-32C03 | 10/14/2015 | 280 | 61 | 57 | 2.6 | 12 | 5.8 | 51 | 28 | 8.4 | <1 | 0.090 | <0.10 | <0.01 | <0.005 | <0.10 | 51 | <10 | <10 | 430 | 0.33 | NA | NA |
| 12N/35W-32C03 | 7/14/2015 | 280 | 64 | 67 | 2.7 | 14 | 6.2 | 50 | 30 | 8.0 | <1 | 0.10 | <0.1 | <0.01 | <0.005 | <0.1 | 50 | <10 | <10 | 440 | 0.22 | NA | NA |
| 12N/35W-32C03 | 4/15/2015 | 280 | 62 | 52 | 2.4 | 12 | 5.4 | 51 | 30 | 7.8 | <1 | 0.081 | <0.1 | <0.01 | <0.005 | 0.11 | 51 | <10 | <10 | 420 | 0.11 | 0.0018 | 564 |
| 12N/35W-32C03 | 1/14/2015 | 290 | 63 | 56 | 2.3 | 13 | 5.8 | 51 | 30 | 8.2 | <1 | 0.077 | <0.1 | <0.01 | <0.005 | 0.1 | 51 | <10 | <10 | 420 | 0.38 | 0.0016 | 630 |
| 12N/35W-32C03 | 10/16/2014 | 270 | 55 | 54 | 2.7 | 13 | 5.7 | 51 | 26 | 7.3 | 0.3 | 0.069 | <0.1 | <0.01 | 0.005 | <0.1 | 51 | <10 | <10 | 430 | 0.35 | NA | NA |
| 12N/35W-32C03 | 7/30/2014 | 280 | 60 | 58 | 1.9 | 14 | 6.5 | 60 | 29 | 7.3 | <1 | <0.1 | <0.1 | <0.01 | <0.005 | <0.1 | 60 | 17 | <10 | 450 | 0.16 | NA | NA |
| 12N/35W-32C03 | 4/15/2014 | 270 | 57 | 55 | 2.2 | 12 | 5 | 54 | 29 | 7.1 | <1 | 0.096 | <0.1 | <0.01 | <0.005 | 0.11 | 54 | <10 | <10 | 430 | 0.21 | 0.0019 | 518 |
| 12N/35W-32C03 | 1/16/2014 | 300 | 62 | 57 | 2.8 | 14 | 6.3 | 54 | 35 | 8.1 | 8.2 | <0.1 | <0.1 | <0.01 | 0.008 | 0.12 | 54 | <10 | <10 | 450 | 0.47 | 0.0019 | 517 |
| 12N/35W-32C03 | 10/16/2013 | 310 | 58 | 62 | 2.9 | 15 | 6.4 | 54 | 38 | 7.5 | <1 | 0.06 | <0.1 | <0.01 | 0.009 | 0.1 | 54 | <10 | <10 | 450 | 0.21 | 0.0017 | 580 |
| 12N/35W-32C03 | 7/11/2013 | 290 | 60 | 45 | 2.4 | 14 | 5.9 | 61 | 30 | 7.4 | <1 | 0.071 | <0.1 | <0.01 | 0.006 | <0.1 | 61 | <10 | <10 | 440 | 0.17 | NA | NA |
| 12N/35W-32C03 | 4/12/2013 | 330 | 58 | 55 | 2.9 | 16 | 6.6 | 60 | 35 | 7.5 | <1 | 0.091 | <0.1 | <0.01 | 0.019 | 0.1 | 60 | <10 | <10 | 460 | 0.49 | 0.0017 | 580 |
| 12N/35W-32C03 | 1/15/2013 | 290 | 62 | 57 | 2.8 | 15 | 6.3 | 55 | 38 | 8.3 | <1 | 0.089 | <0.1 | <0.01 | 0.01 | <0.1 | 55 | <10 | <10 | 470 | 0.23 | NA | NA |
| 12N/35W-32C03 | 10/30/2012 | 330 | 57 | 60 | 3.3 | 19 | 7.5 | 60 | 36 | 7.8 | <1 | 0.09 | <0.1 | <0.01 | 0.033 | <0.1 | 60 | <10 | <10 | 470 | 1.9 | NA | NA |
| 12N/35W-32C03 | 7/25/2012 | 330 | 67 | 61 | 3.3 | 17 | 6.4 | 59 | 35 | 8.2 | <1 | <0.1 | <0.1 | <0.01 | 0.068 | <0.1 | 59 | <10 | <10 | 460 | 0.49 | NA | NA |
| 12N/35W-32C03 | 4/19/2012 | 370 | 74 | 52 | 2.9 | 30 | 12 | 120 | 58 | 5 | <1 | 0.17 | 0.2 | <0.01 | 0.056 | <0.2 | 120 | <10 | <10 | 580 | 1.3 | NA | NA |